


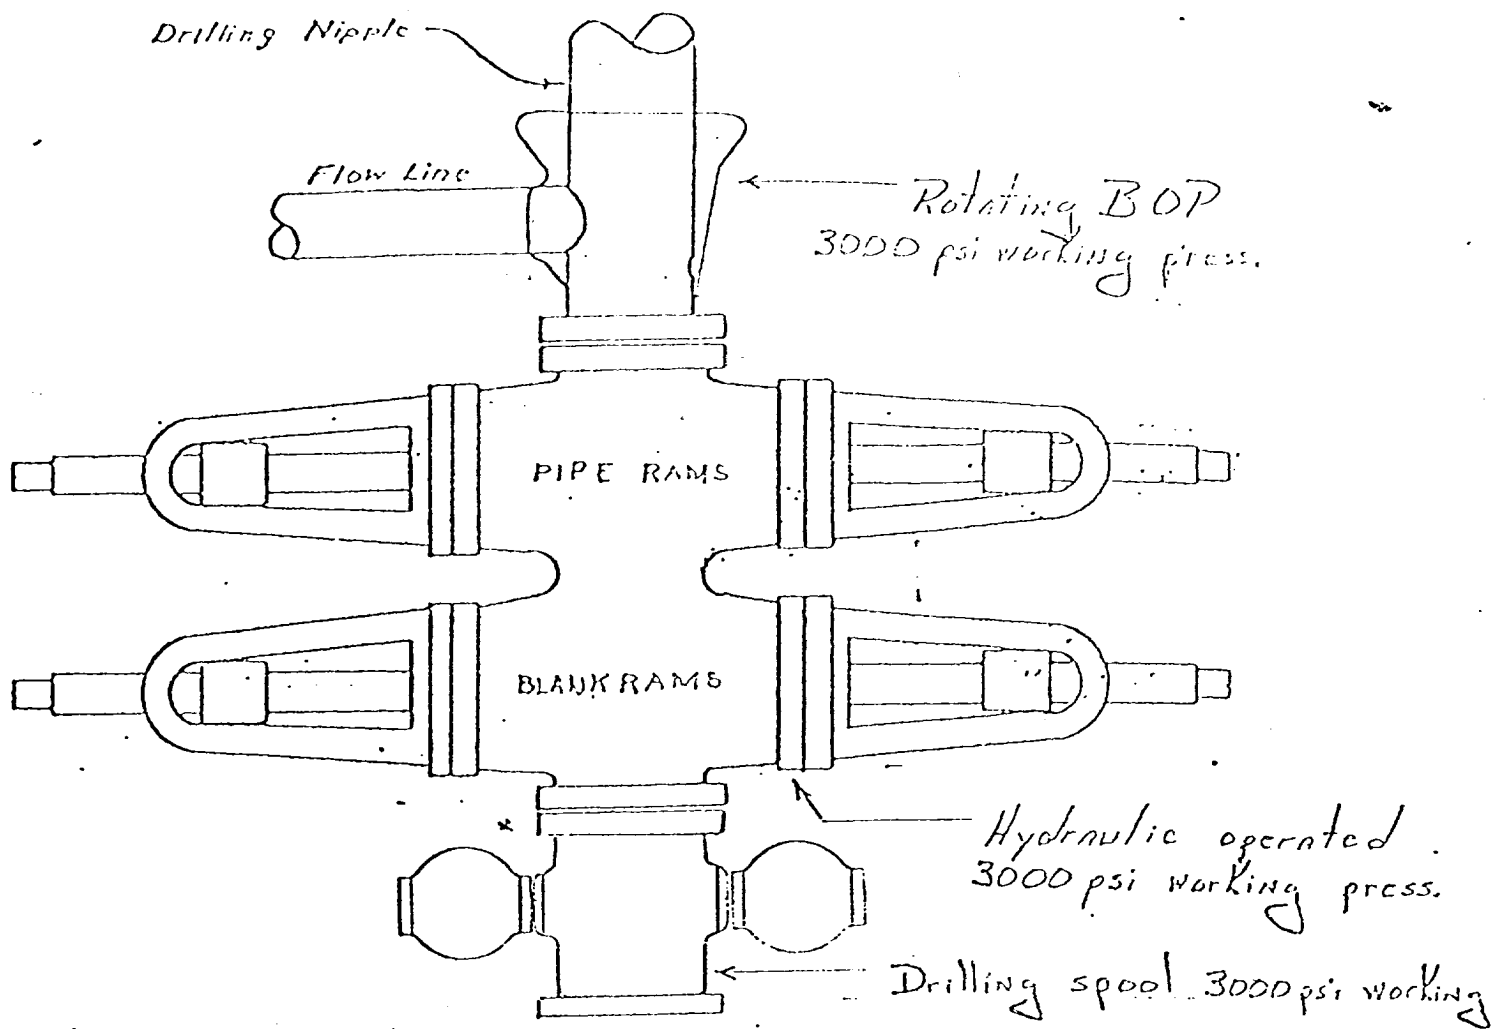

Preventers and spools are to have
through bore of 6" - 3000# PSI or larger.

1021V57
AUG 21 1978