
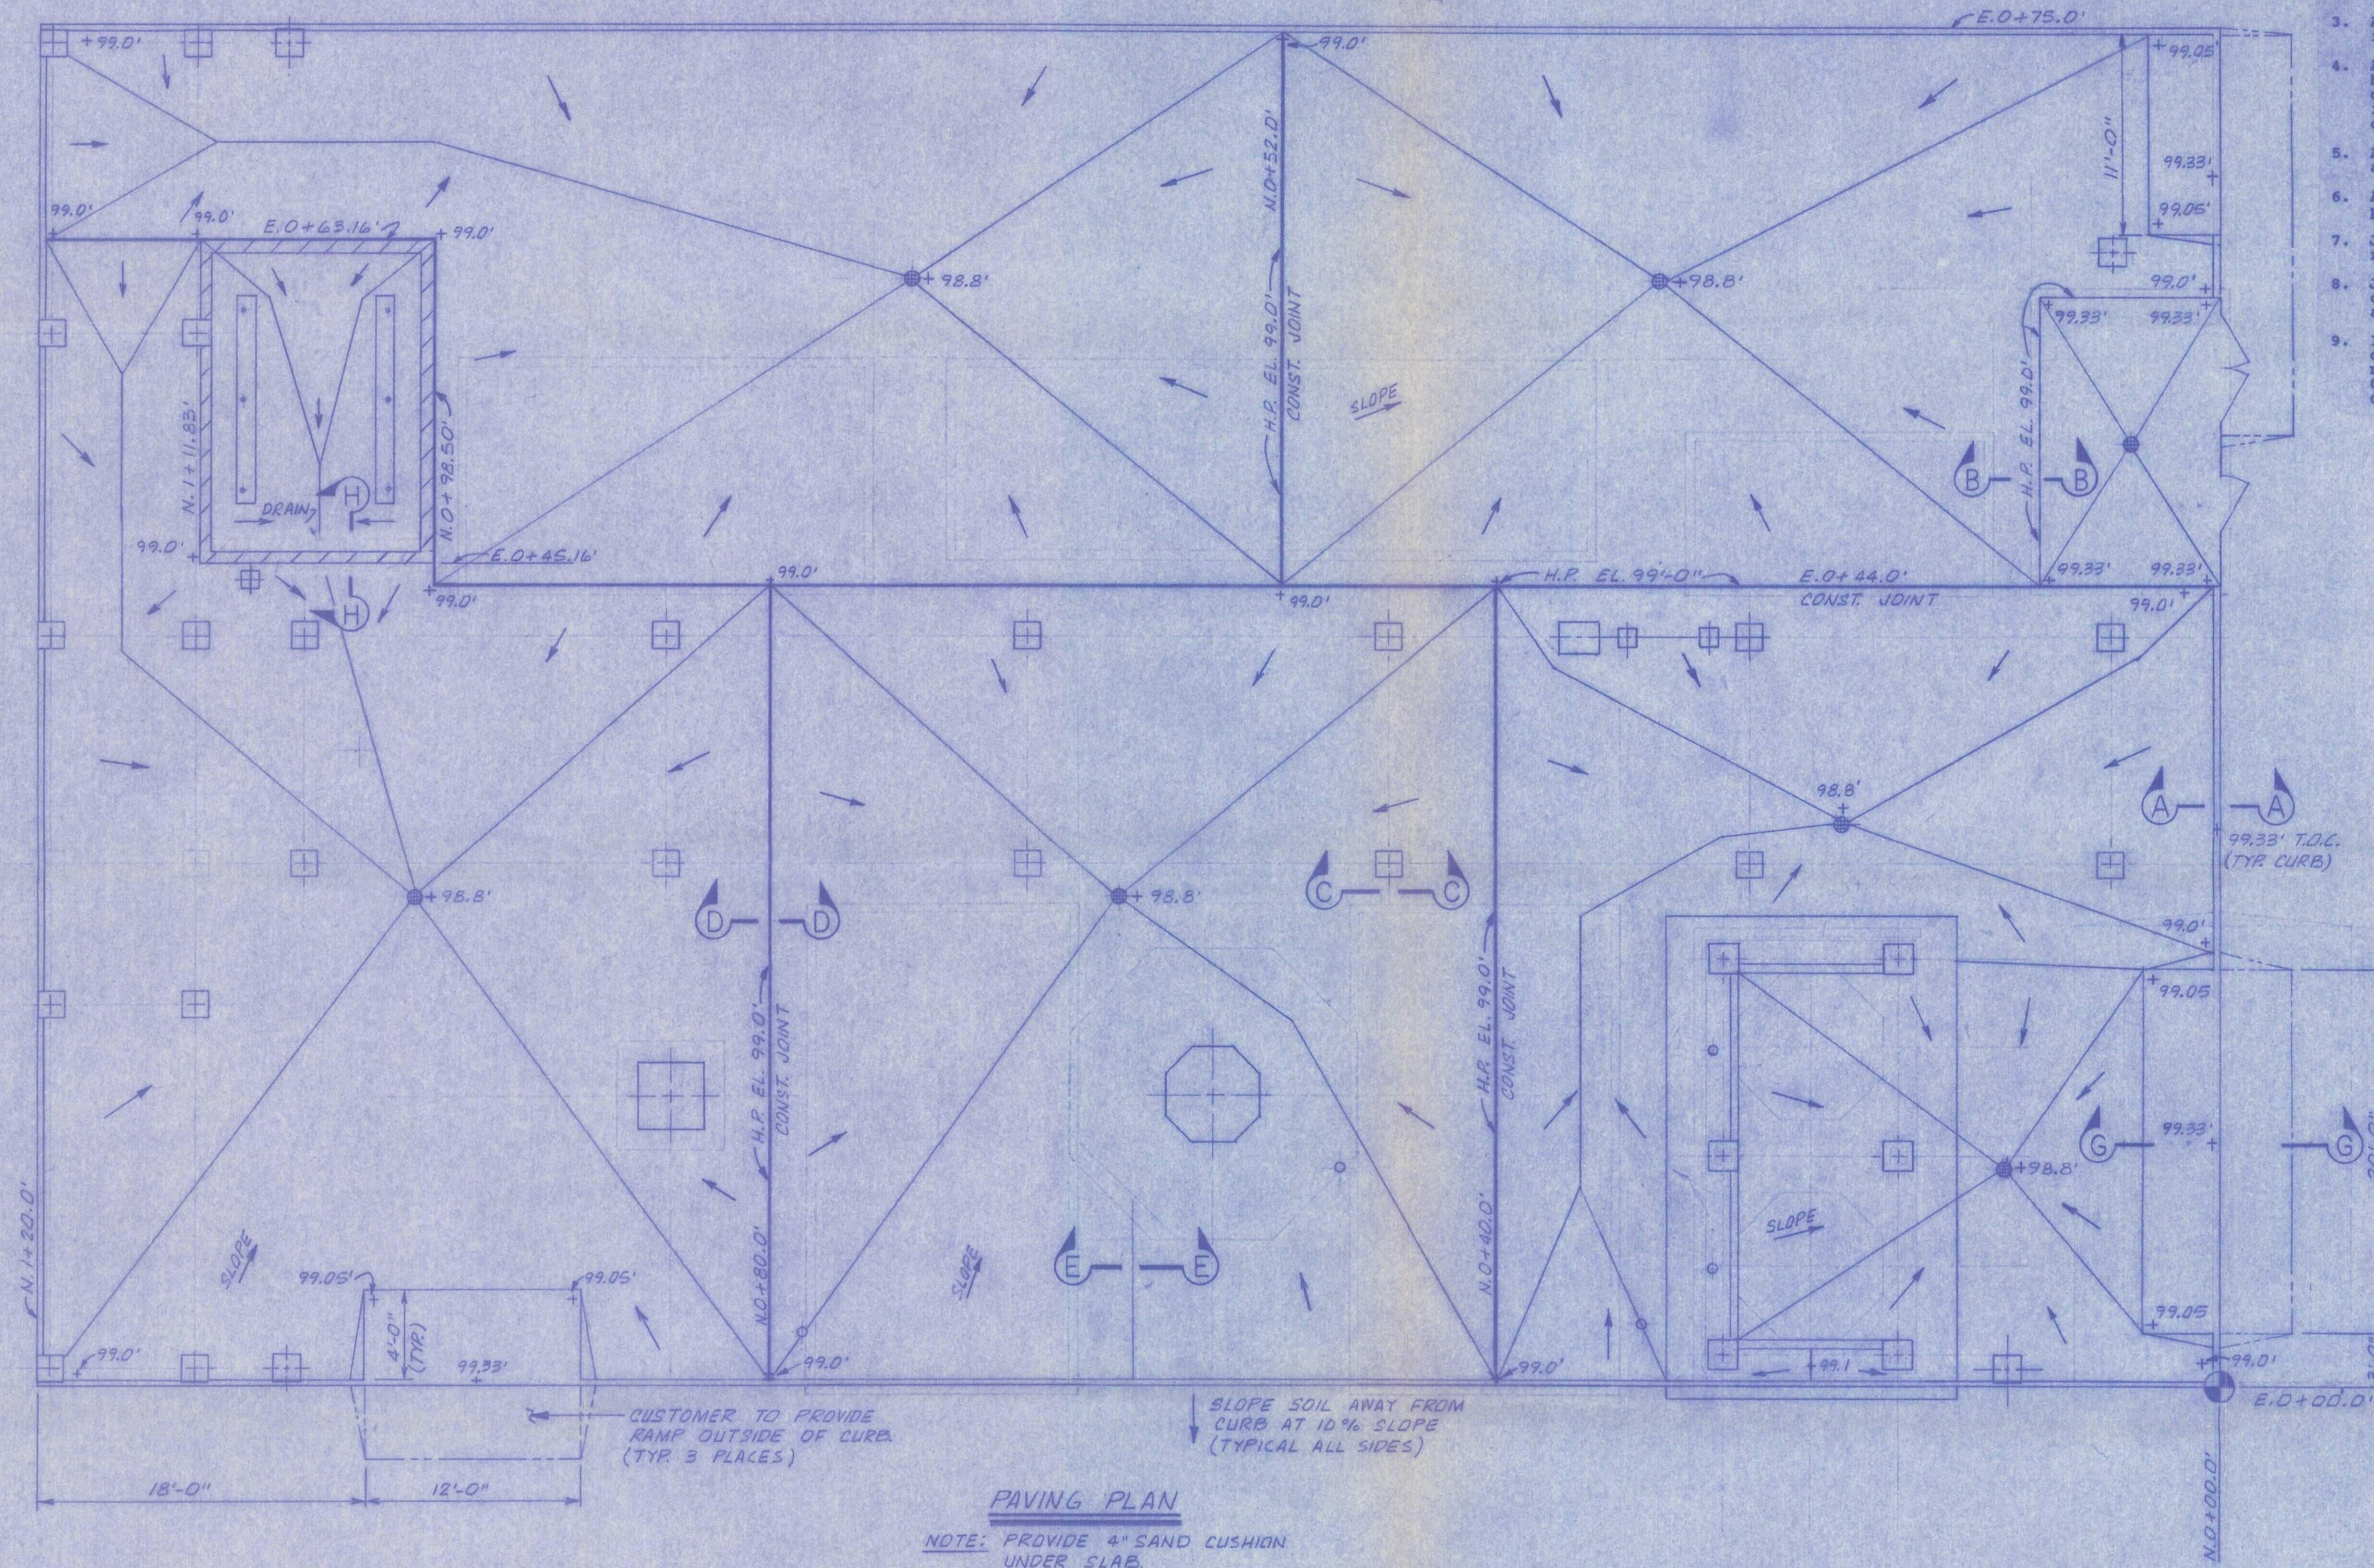


# GW - 001

## PERMITS, RENEWALS, & MODS APPLICATION MAPS

March 1984



### GENERAL NOTES:

1. All grades shown represent top of finish grade or pavement in paved areas.
2. All grades shall be held true and straight to within 1/8 inch tolerance.
3. Areas to be filled shall be scarified for a depth of 6 inches before placing fill material and recompact.
4. All paving fill material shall be select material and shall be placed in 3 inch lifts and compacted to a minimum density of 90% modified proctor density per ASTM D-1557. Performed in place density test are required to insure proper compaction.
5. A 1/2 inch premolded expansion joint shall be placed adjacent to all building slabs and equipment foundations.
6. All underground utilities shall be installed prior to paving. See PetroFac Drawing 395-D-.
7. Joint edges at top of paving will be rounded at 1/8 inch radius.
8. Joint sealer will be a resilient material placed in a cleaned-out and dry groove no earlier than two (2) weeks after paving has been placed.
9. If construction joint cannot be located as shown on the drawing, #6 deformed bars X 5'-0" long on 2'-6" centers (at mid-depth) are required across the joint. Construction joint locations as shown on the drawing shall be maintained.

### LEGEND

- + SPOT ELEVATIONS
- CONSTRUCTION JOINT SEE SECT. "D-D"
- SLOPE TO DRAIN
- ⊙ DRAINS
- T.O.C. TOP OF CURB
- ▨ CONC. BLOCK WALL

### REFERENCE DRAWINGS

- 395-D-501 FOUNDATION LOCATION PLAN
- 395-D-508(2) PAVING SECTIONS
- 395-D-613 UNDERGROUND DRAINAGE


### PAVING PLAN

NOTE: PROVIDE 4" SAND CUSHION UNDER SLAB.



| PETROFAC, INC.                                                               |                                          |
|------------------------------------------------------------------------------|------------------------------------------|
| DRAWING ISSUED                                                               |                                          |
| <input type="checkbox"/> CERTIFIED CORRECT                                   | <input type="checkbox"/> APPROVED        |
| <input type="checkbox"/> FOR CONSTRUCTION                                    | <input type="checkbox"/> FOR APPROVAL    |
| <input type="checkbox"/> PRELIMINARY                                         | <input type="checkbox"/> FOR INFORMATION |
| <input type="checkbox"/> REVISED DESTROY ALL PREVIOUS COPIES OF THIS DRAWING |                                          |
| NO. 395                                                                      | DATE 1/27/84                             |
| BY BLOOMFIELD REFINING CO.                                                   |                                          |

| PETROFAC, INC.                  |  |
|---------------------------------|--|
| DRAWING ISSUED                  |  |
| NO. 395                         |  |
| DATE 1/27/84                    |  |
| BY BLOOMFIELD REFINING CO.      |  |
| FOR BLOOMFIELD REFINING COMPANY |  |
| DWG. 395-D-508 SHT. 1           |  |

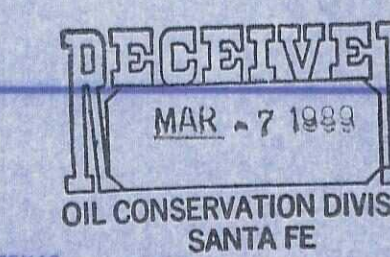

### FOUNDATIONS

### AREA PAVING AND DRAINAGE

### POLYMERIZATION UNIT