




BEFORE EXAMINER NUTTER
OIL CONSERVATION COMMISSION
EXHIBIT NO. 2
CASE NO. 1745

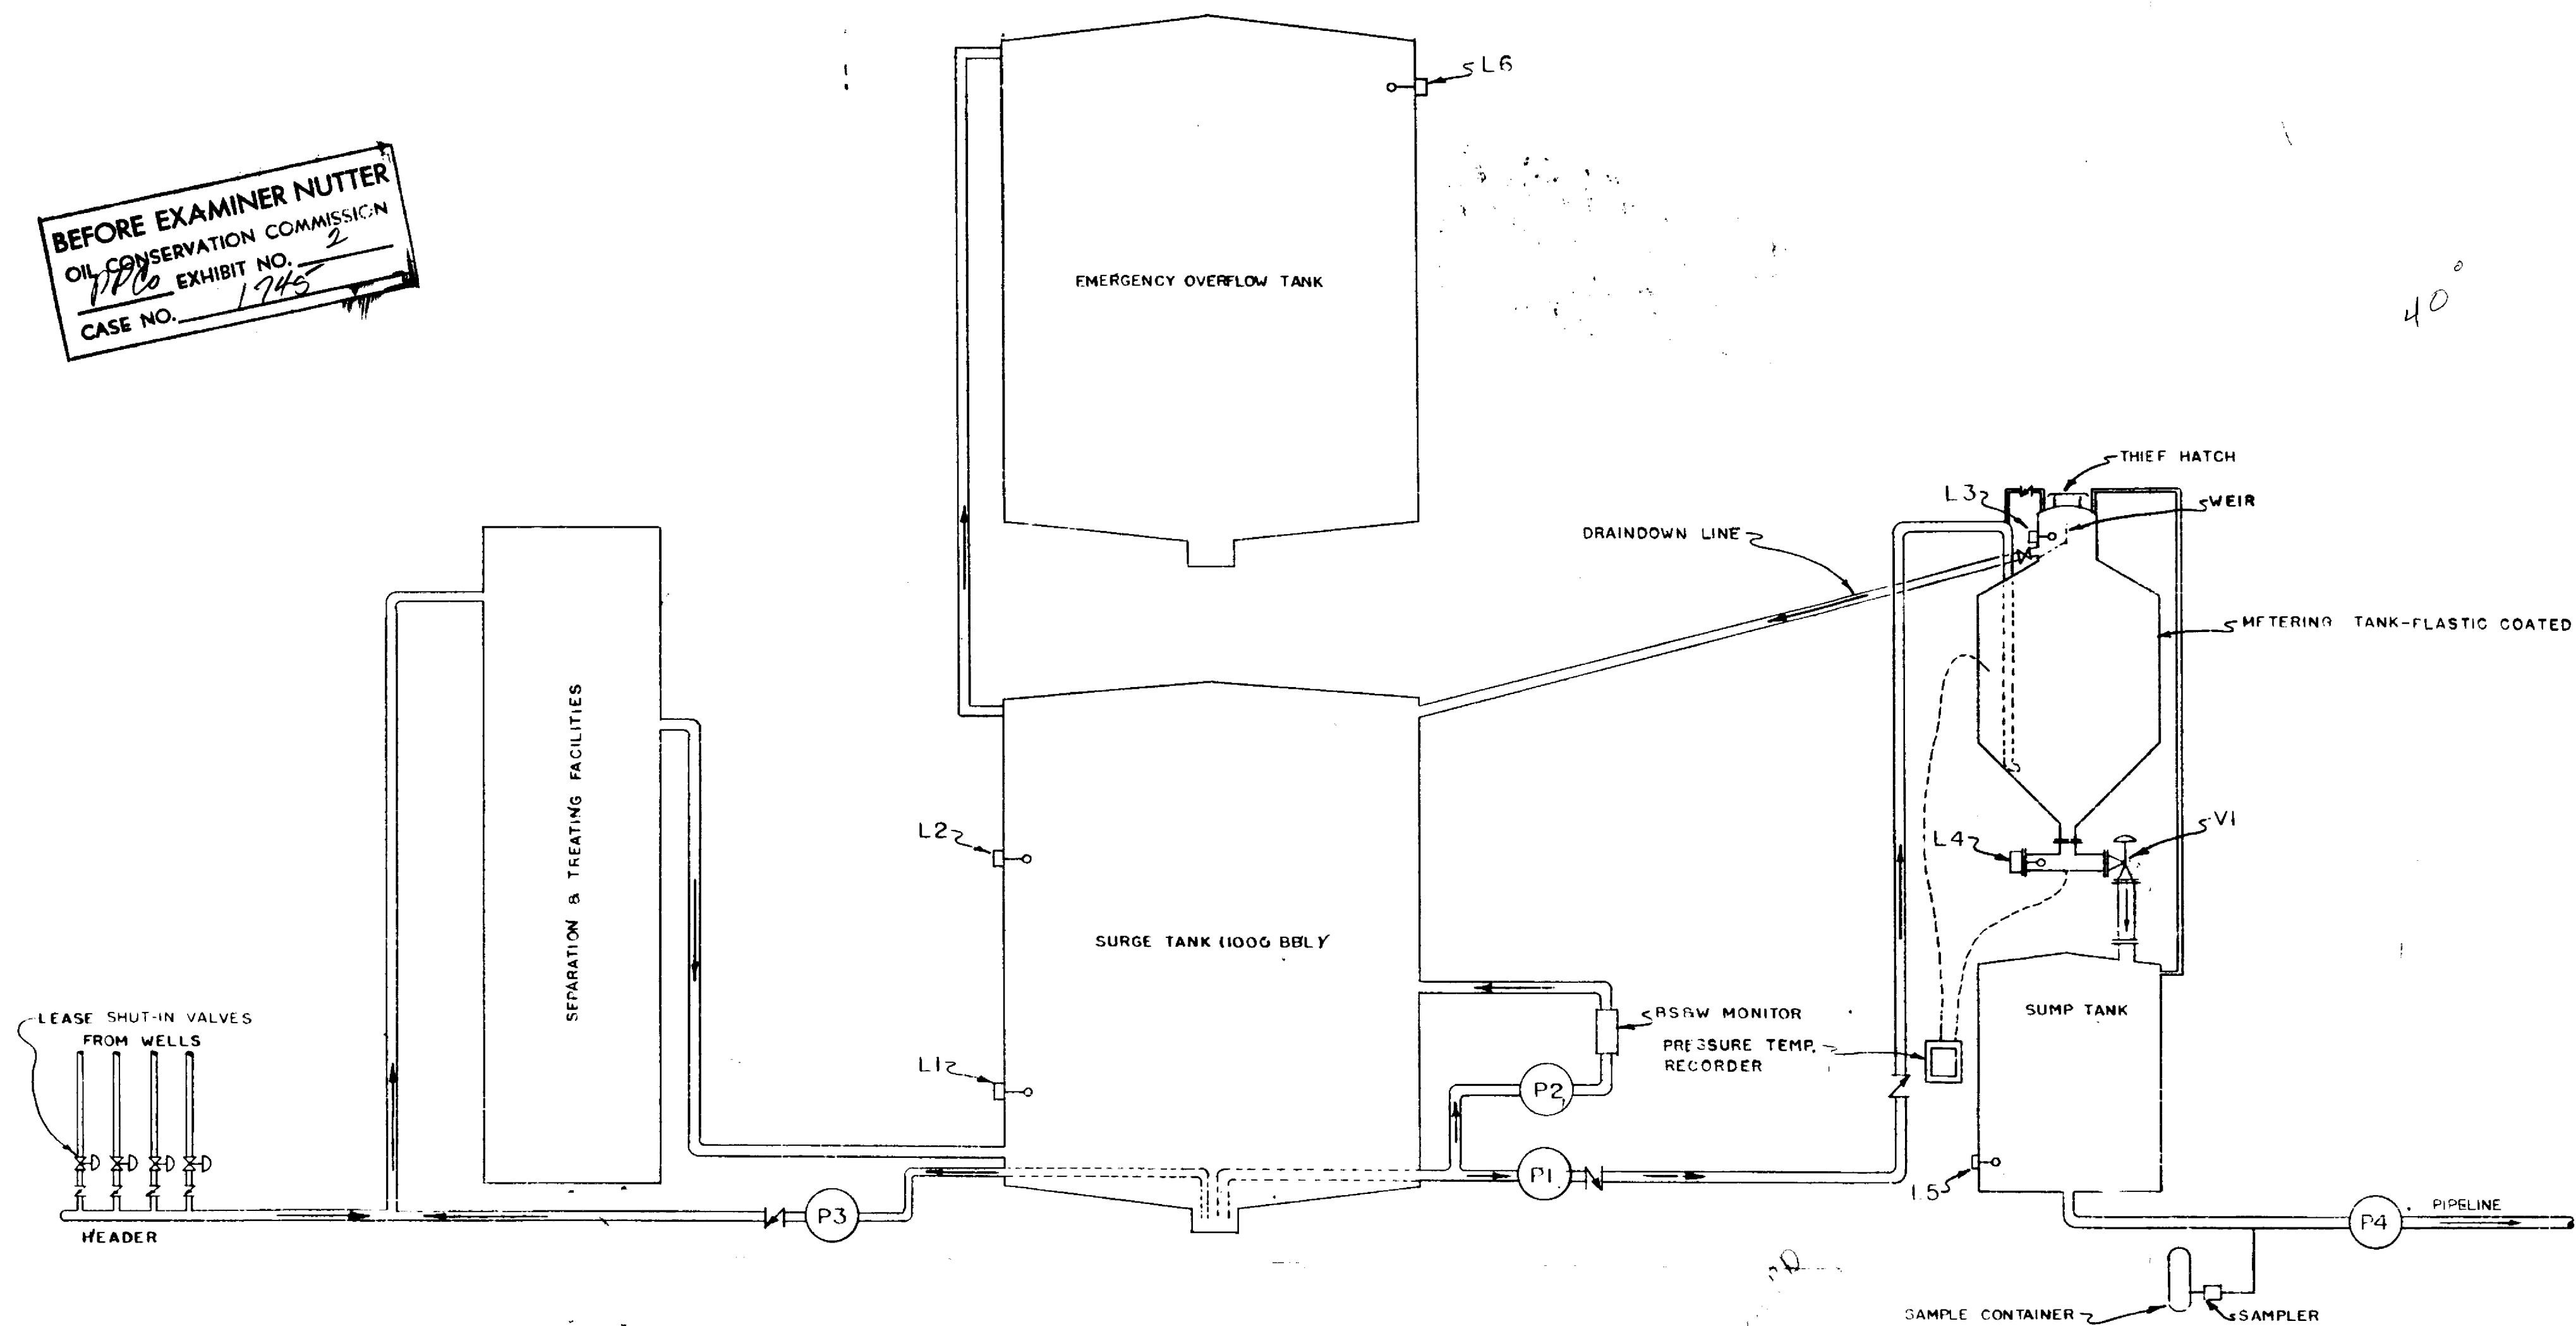

- P1 - TRANSFER PUMP
P2 - MONITOR PUMP
P3 - CIRCULATING PUMP
P4 - PIPELINE PUMP
L1 THRU L6 - LIQUID LEVEL CONTROLS
V1 - DIAPHRAGM VALVE
~~V4~~ - CHECK VALVE

[illegible]