


ILLEGIBLE

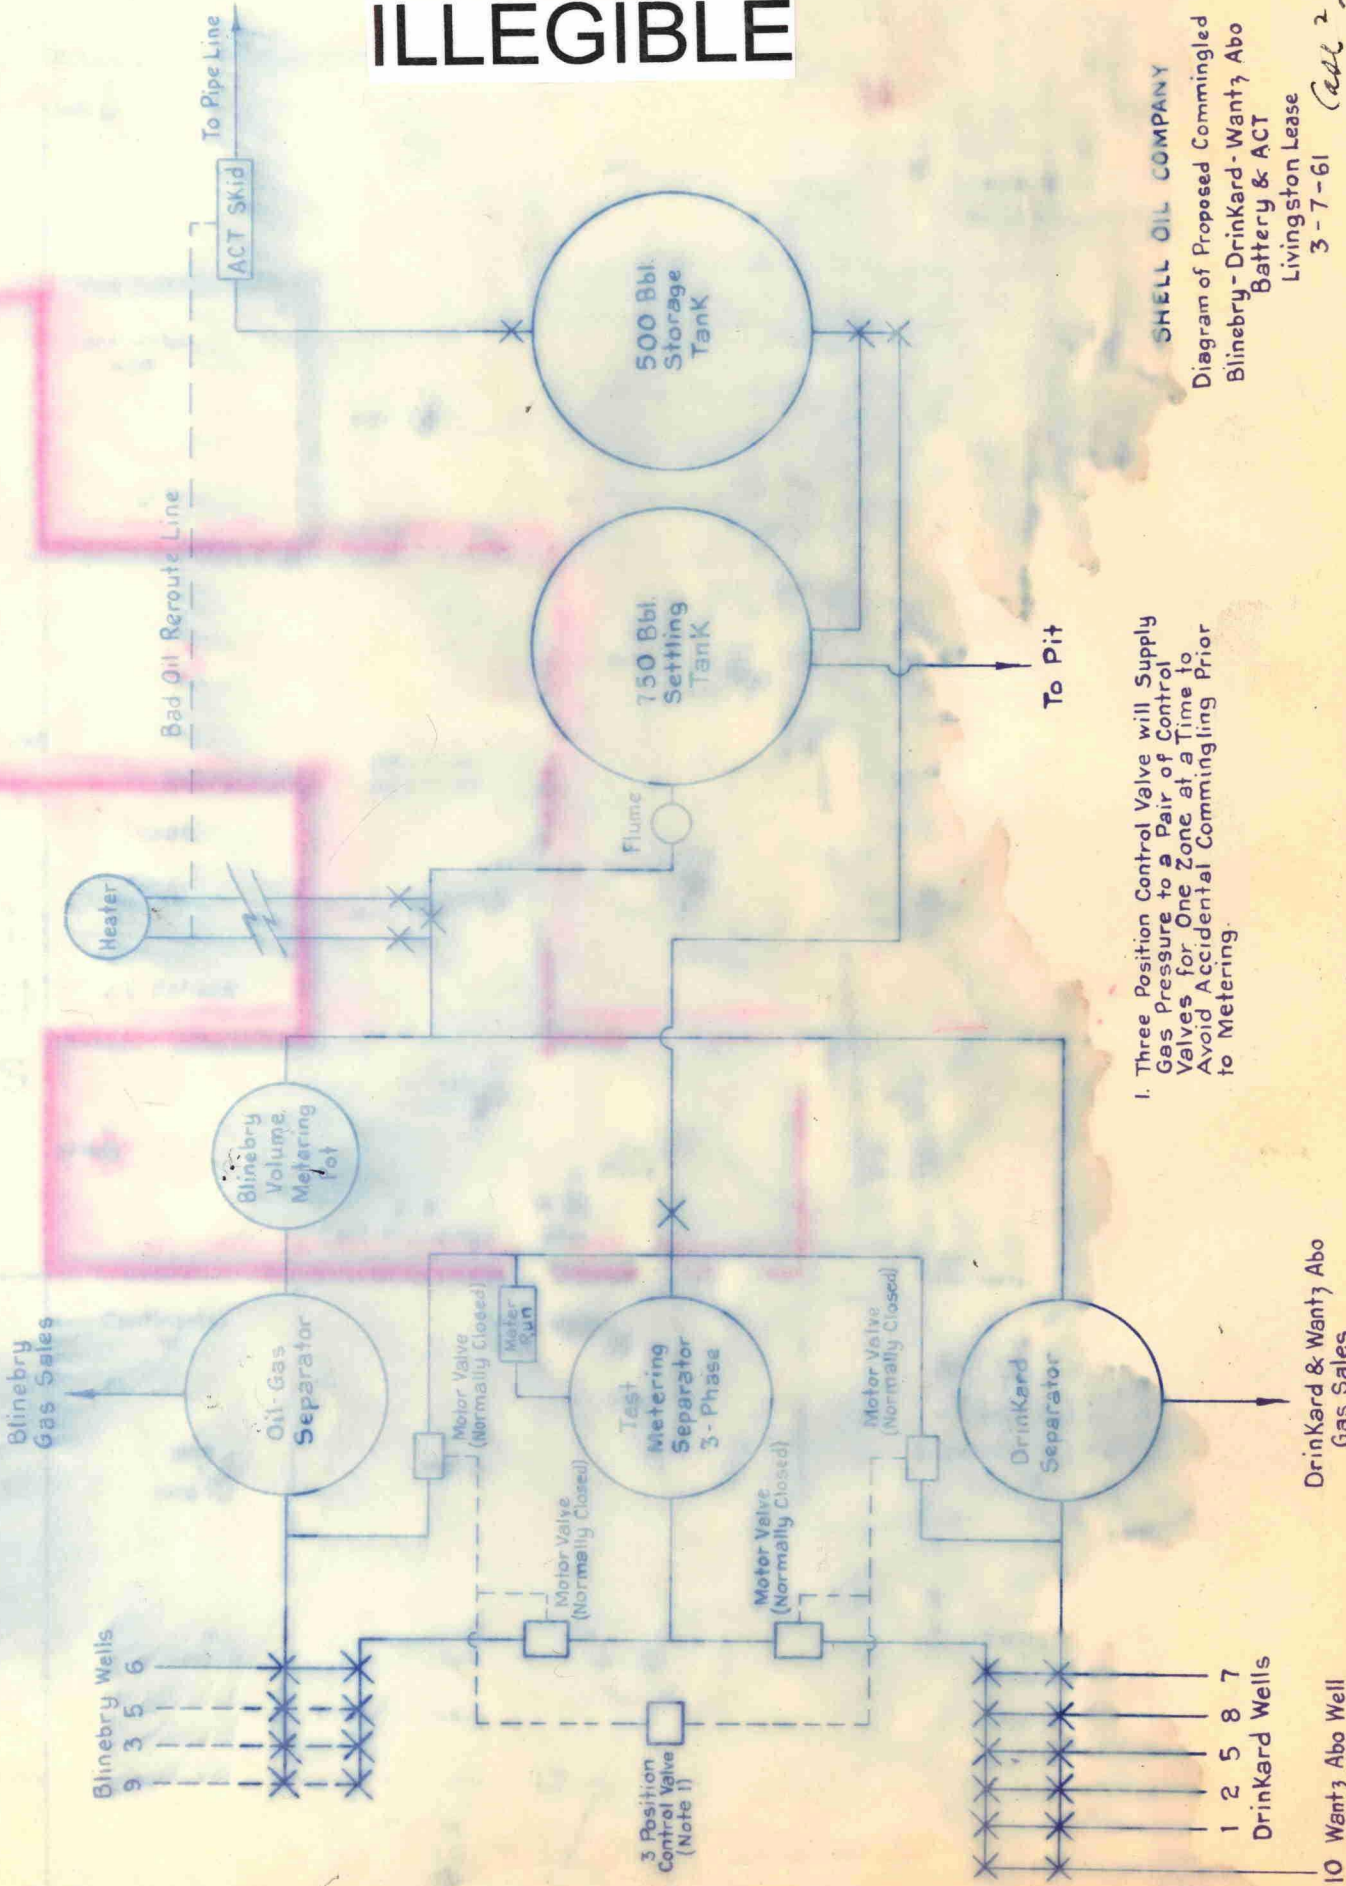

1. Three Position Control Valve will Supply Gas pressure to a Pair of Control Valves for One Zone at a Time to Avoid Accidental Commingling Prior to Metering.

SHELL OIL COMPANY
Diagram of Proposed Commingled
Blinebry-DrinkKard-Wantz Abo
Battery & ACT
Livingston Lease
3-7-61

Case 2:20
Exhibit 3 - Shell