


POROSITY VERSUS WATER SATURATION @400 psi

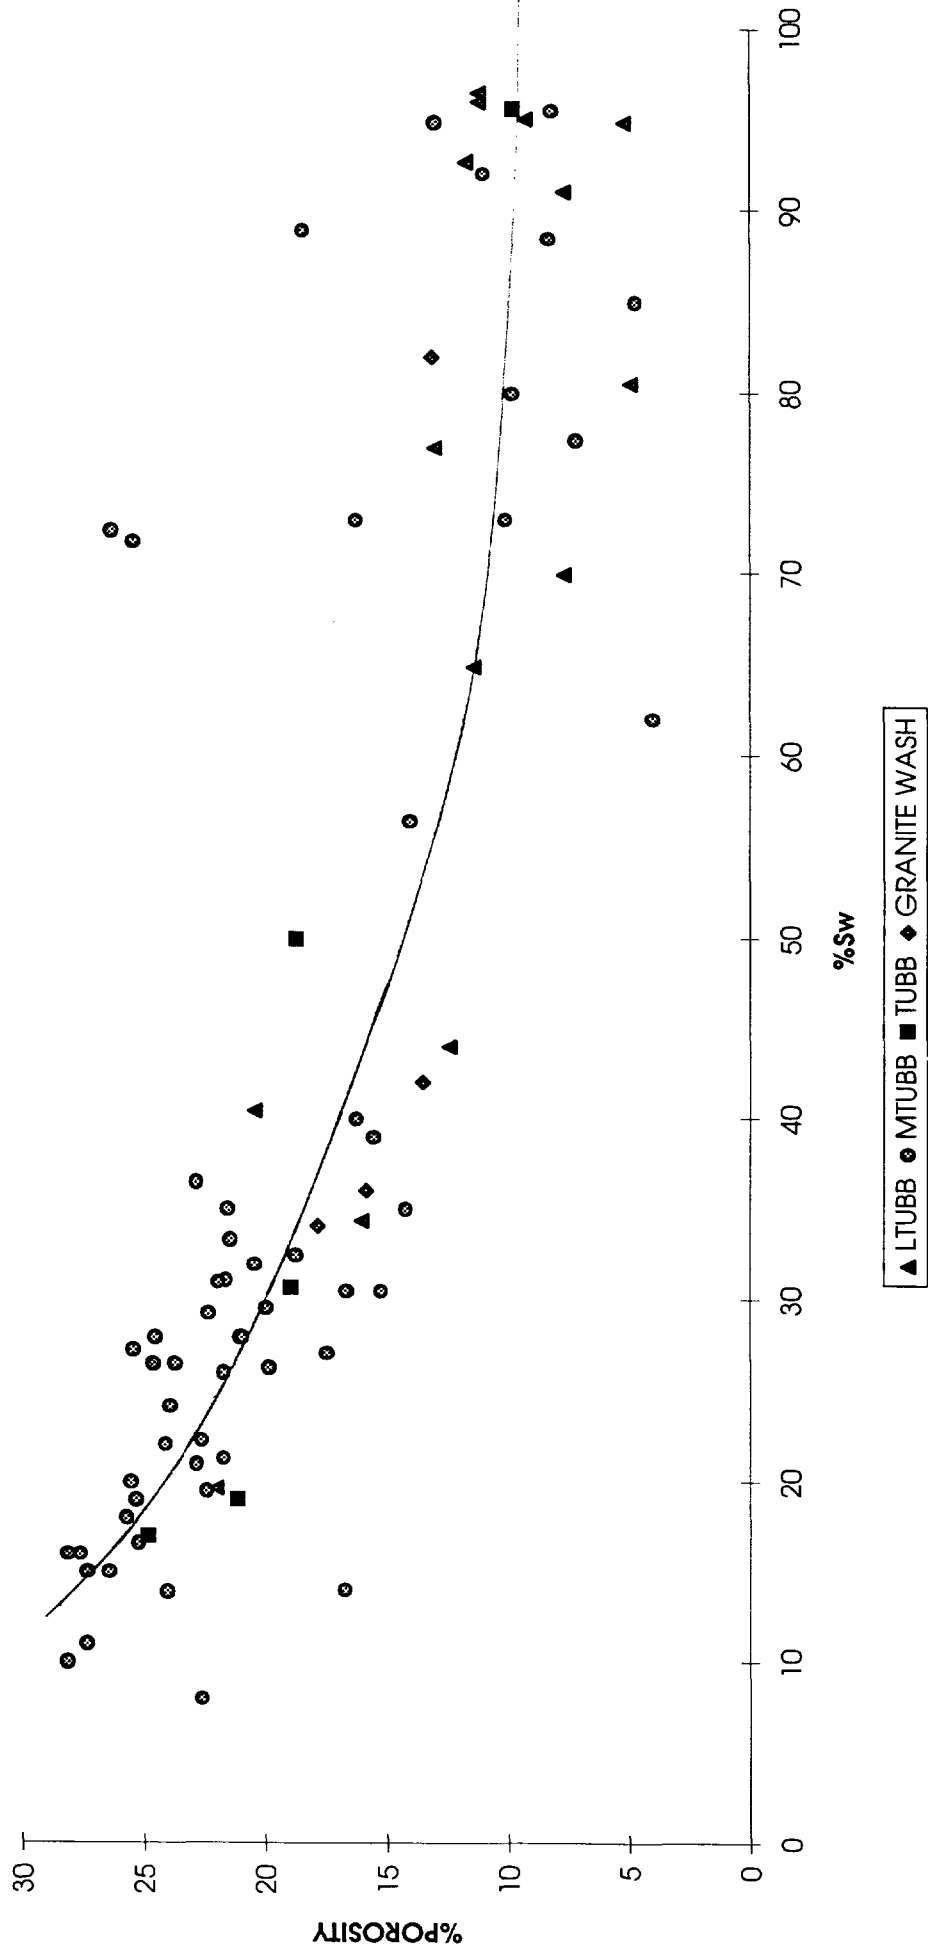

Bravo Dome CO₂ Arr

Height Above 100% Water vs.
Percent SW
Capillary Pressure Data
Various Porosity Values

$\phi = 12 \text{ \& } 20\%$
 $8 \text{ \& } 10\%$

