




1.0 Incident Reporting Guidelines

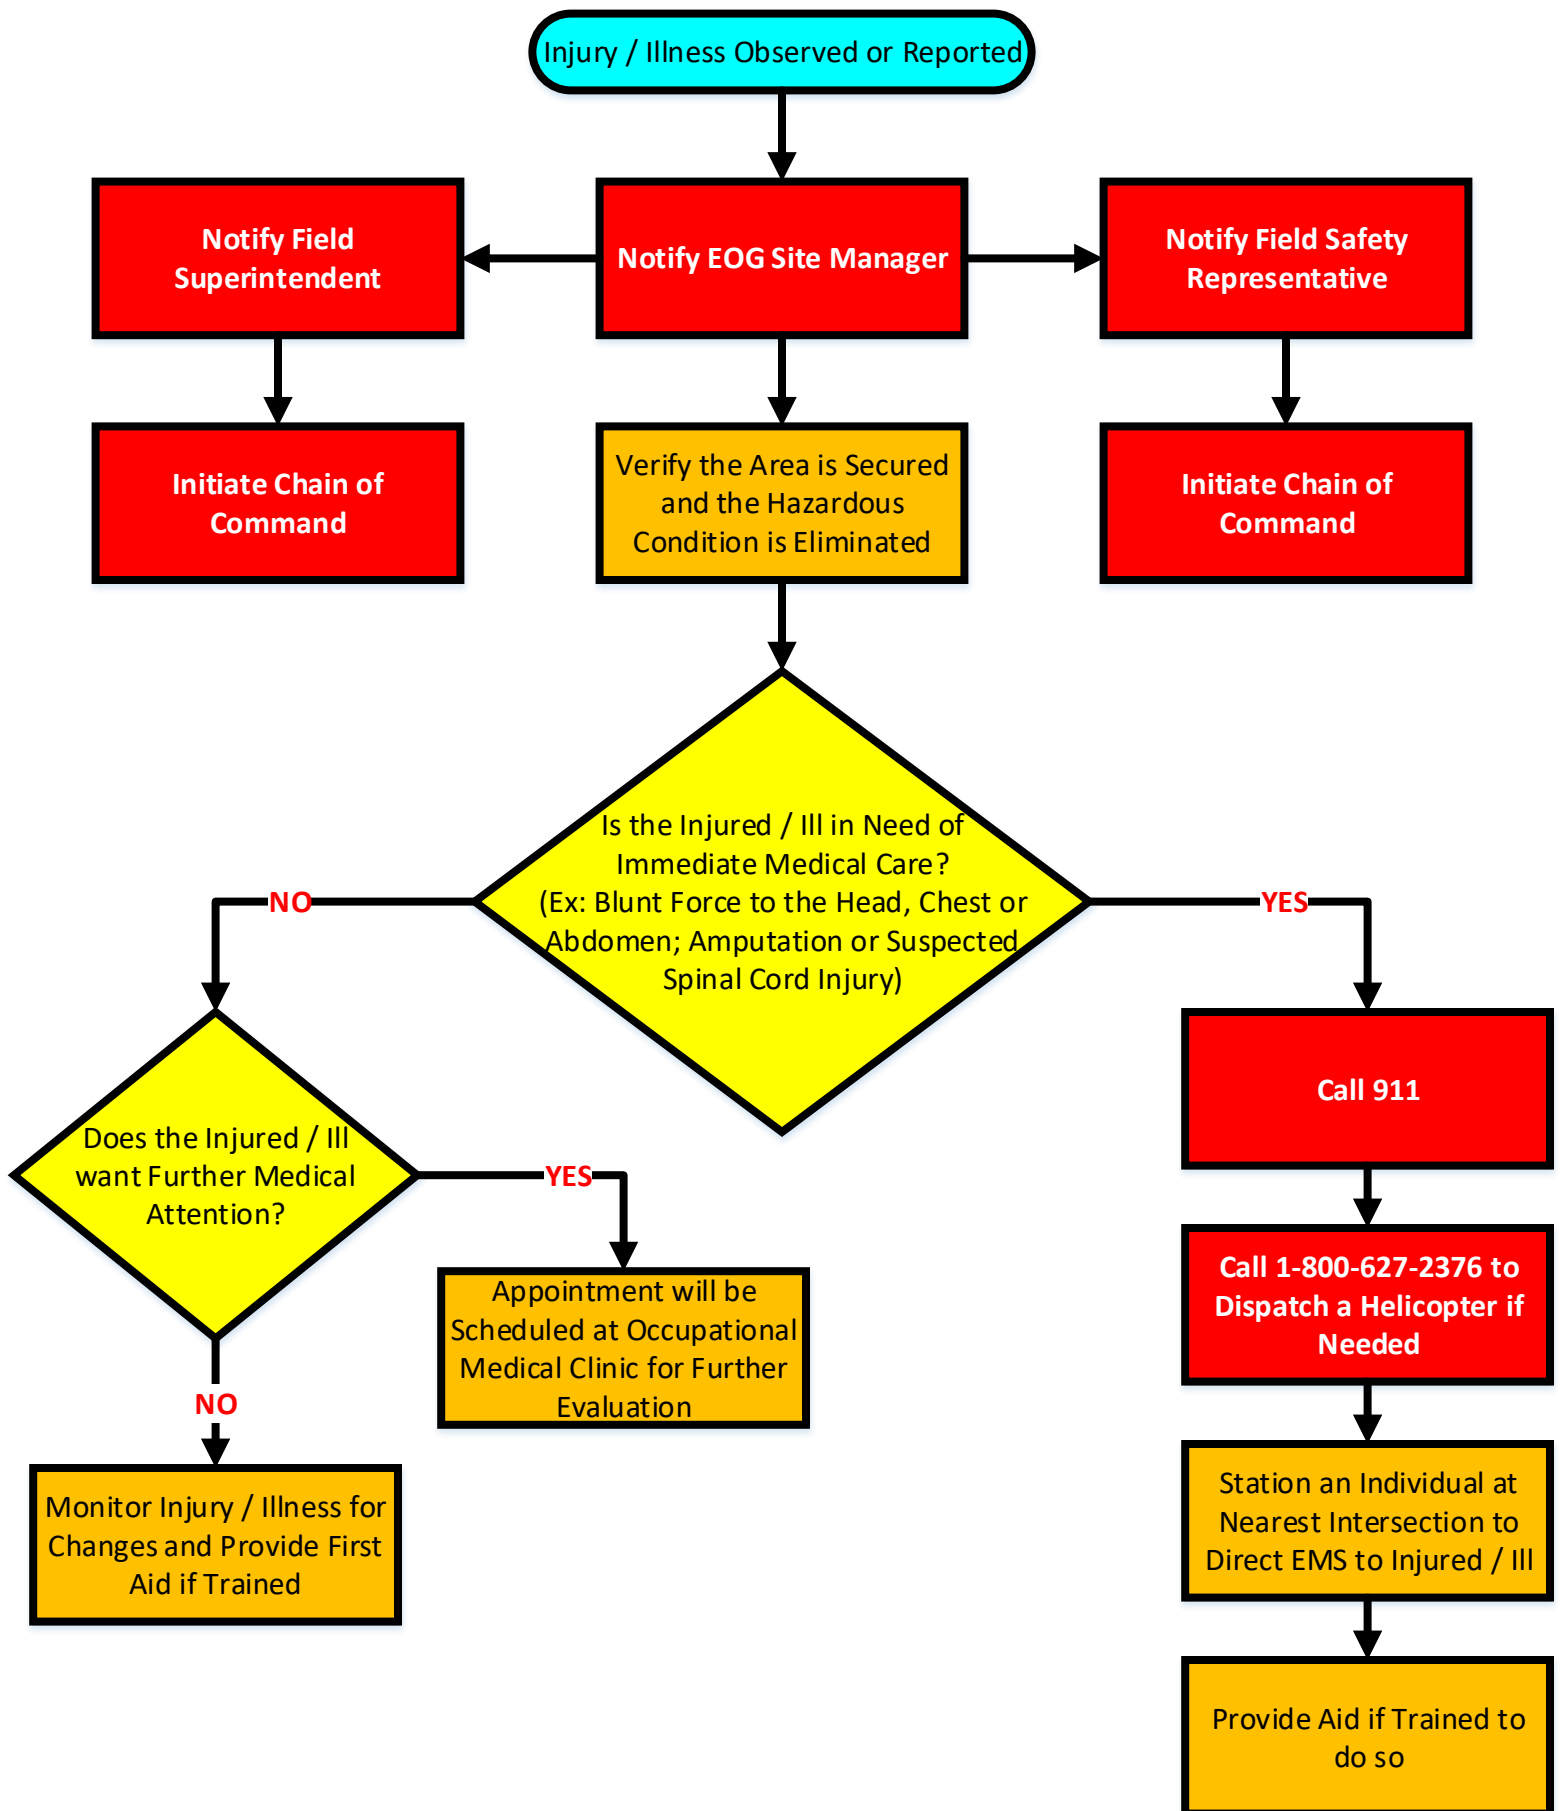


1.1 Personnel Injury or Illness on EOG Facility Guidelines

1.2 H₂S Monitor Alarm Guidelines

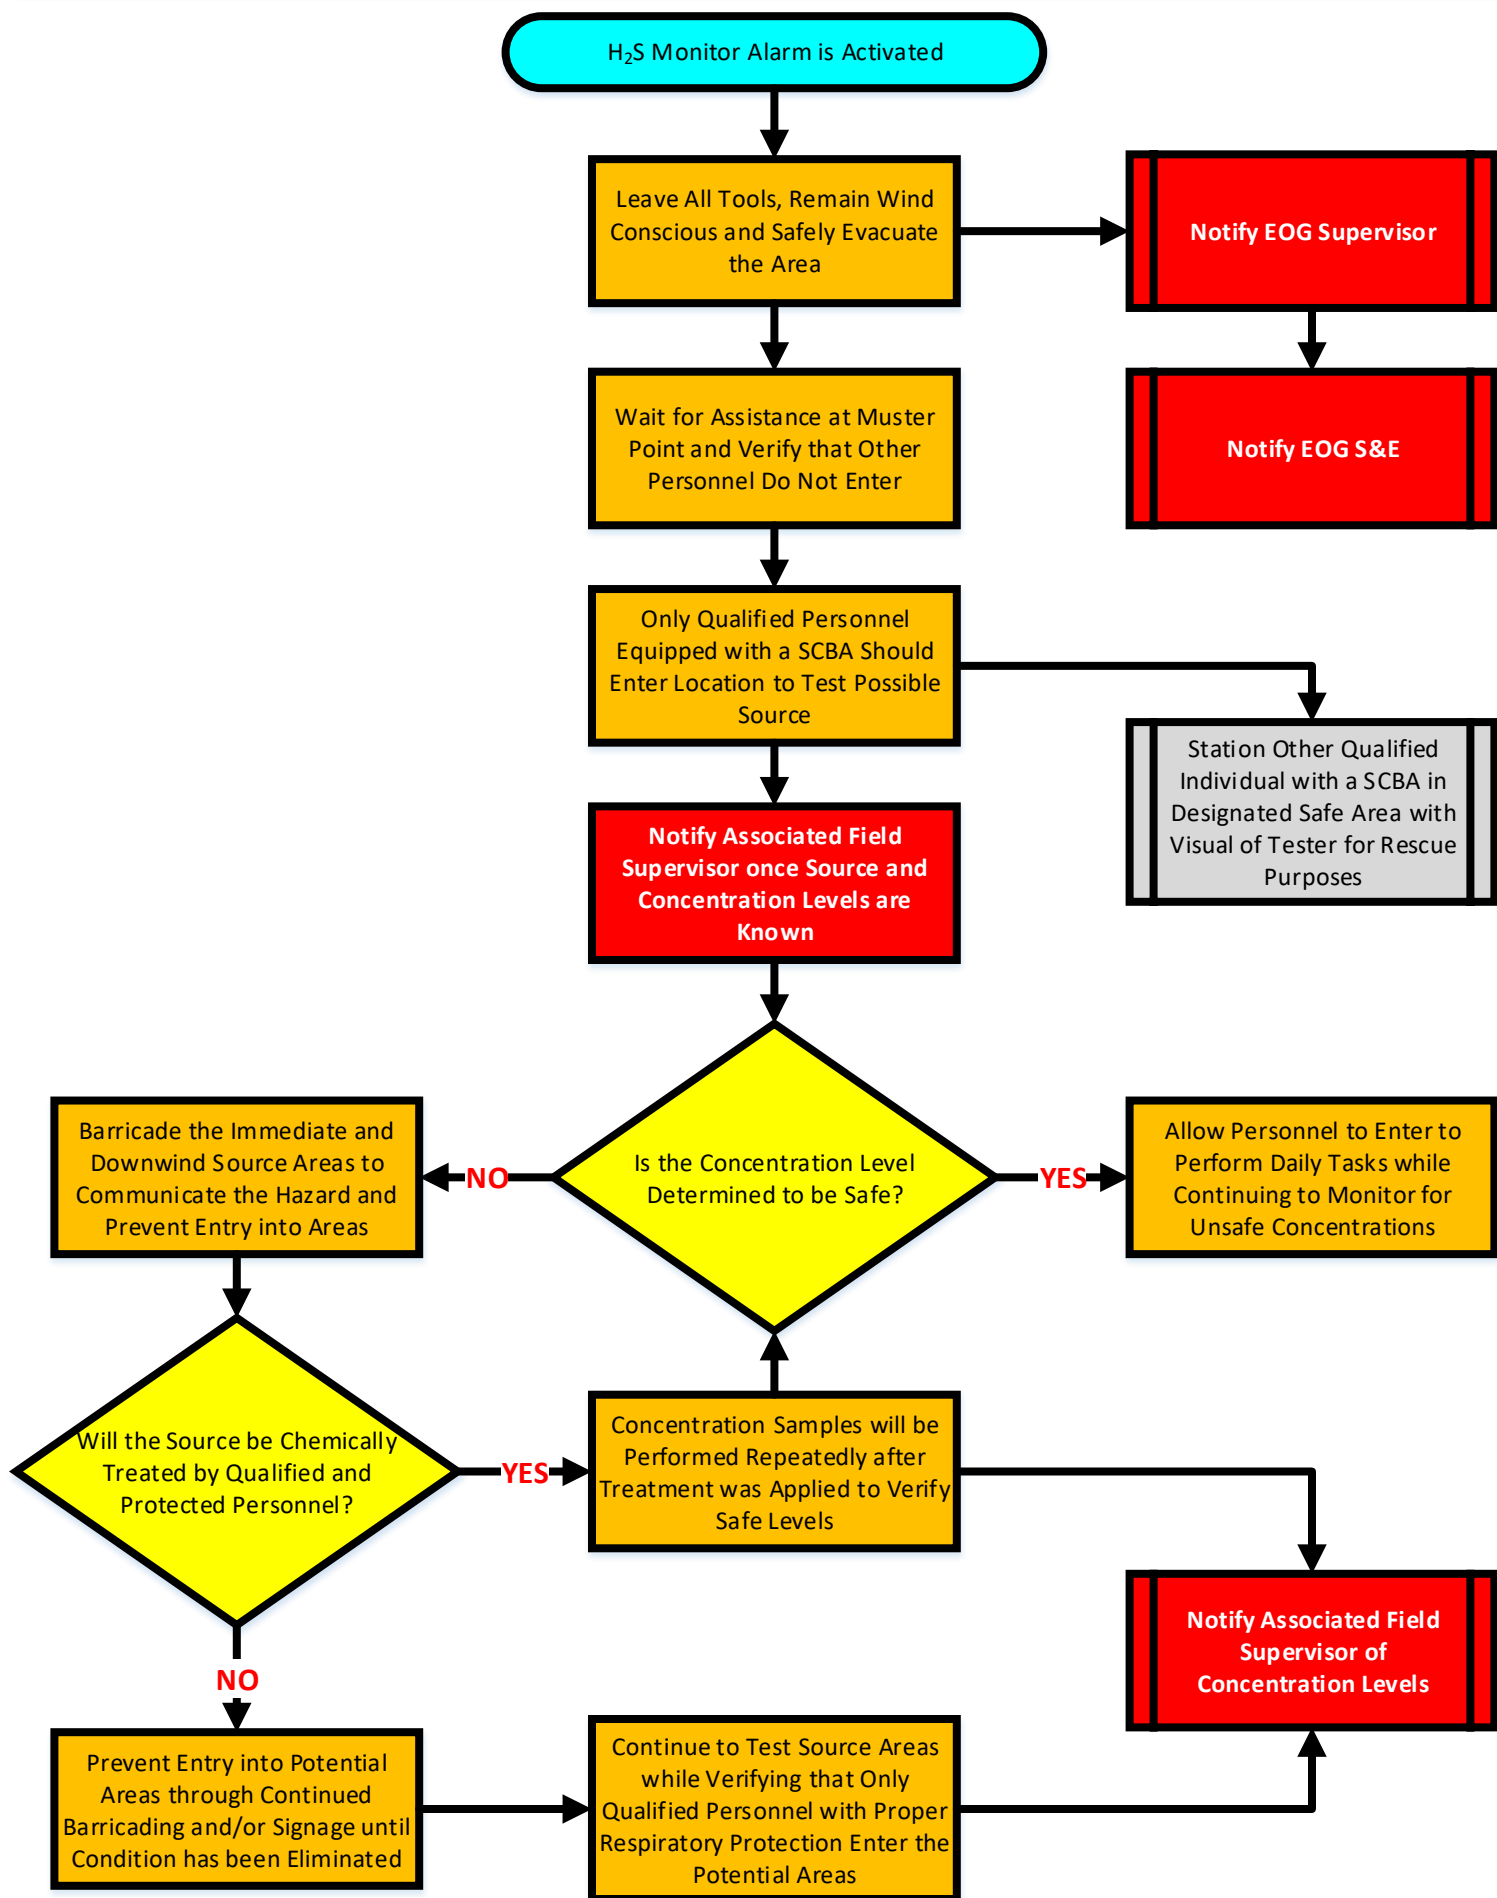


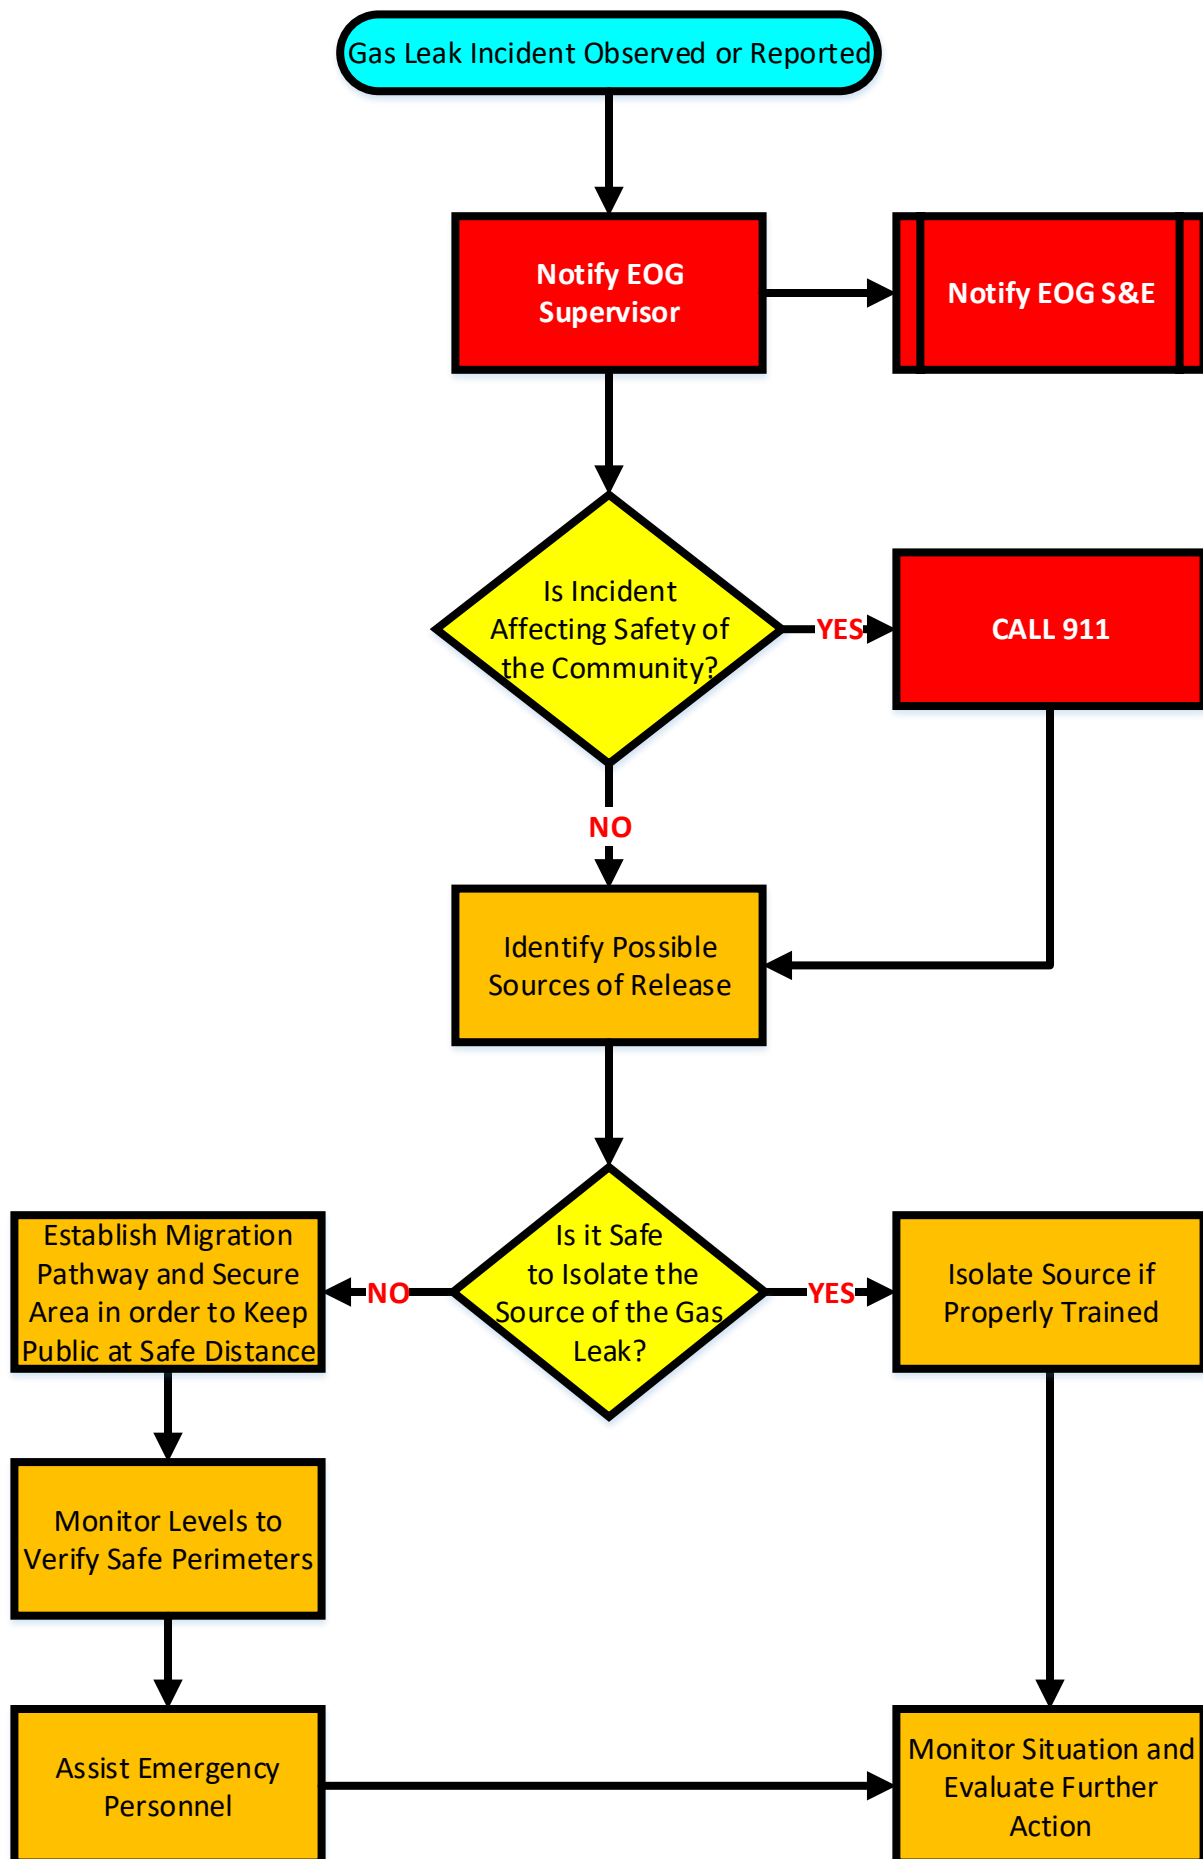


1.3 Gas Leak on EOG Facility Guidelines

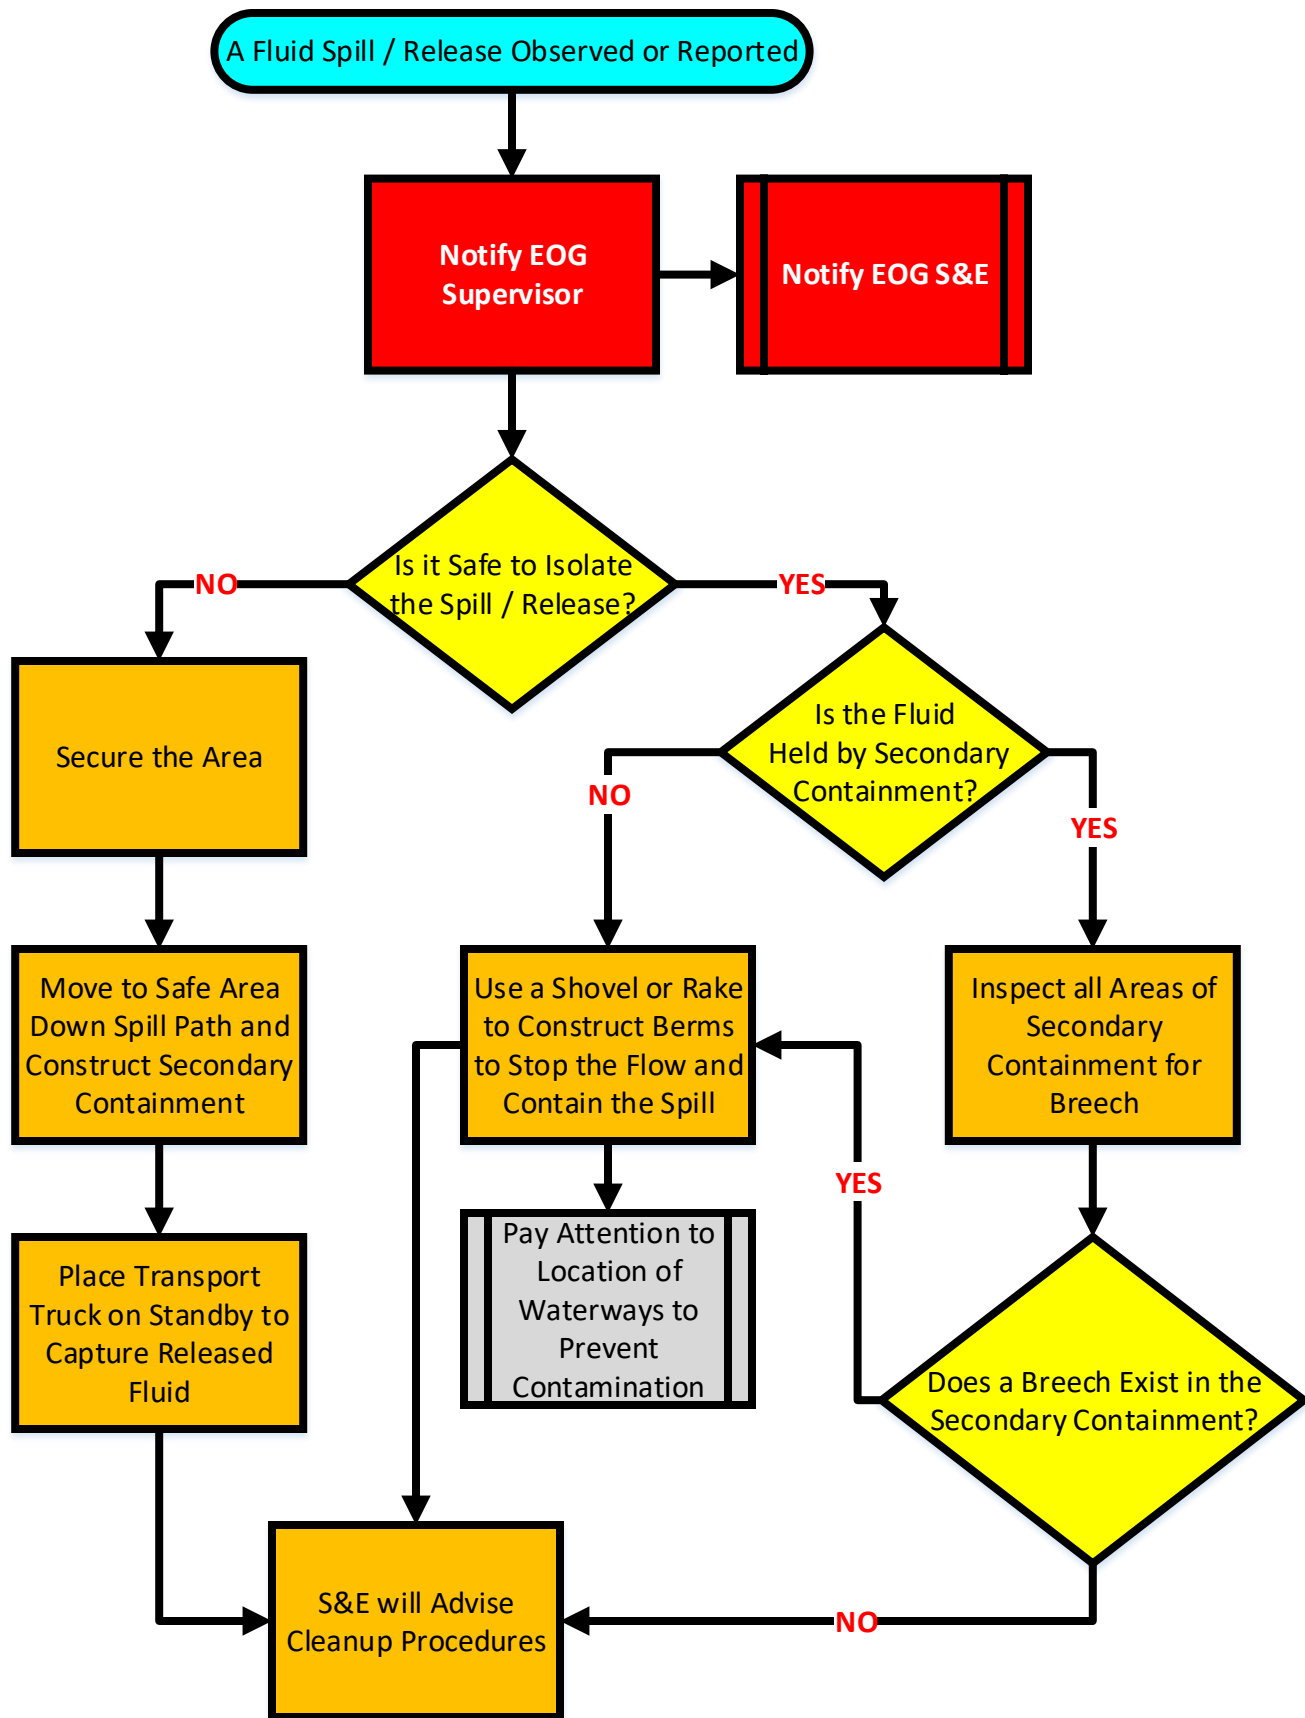


1.4 Fluid Spill on EOG Facility Guidelines

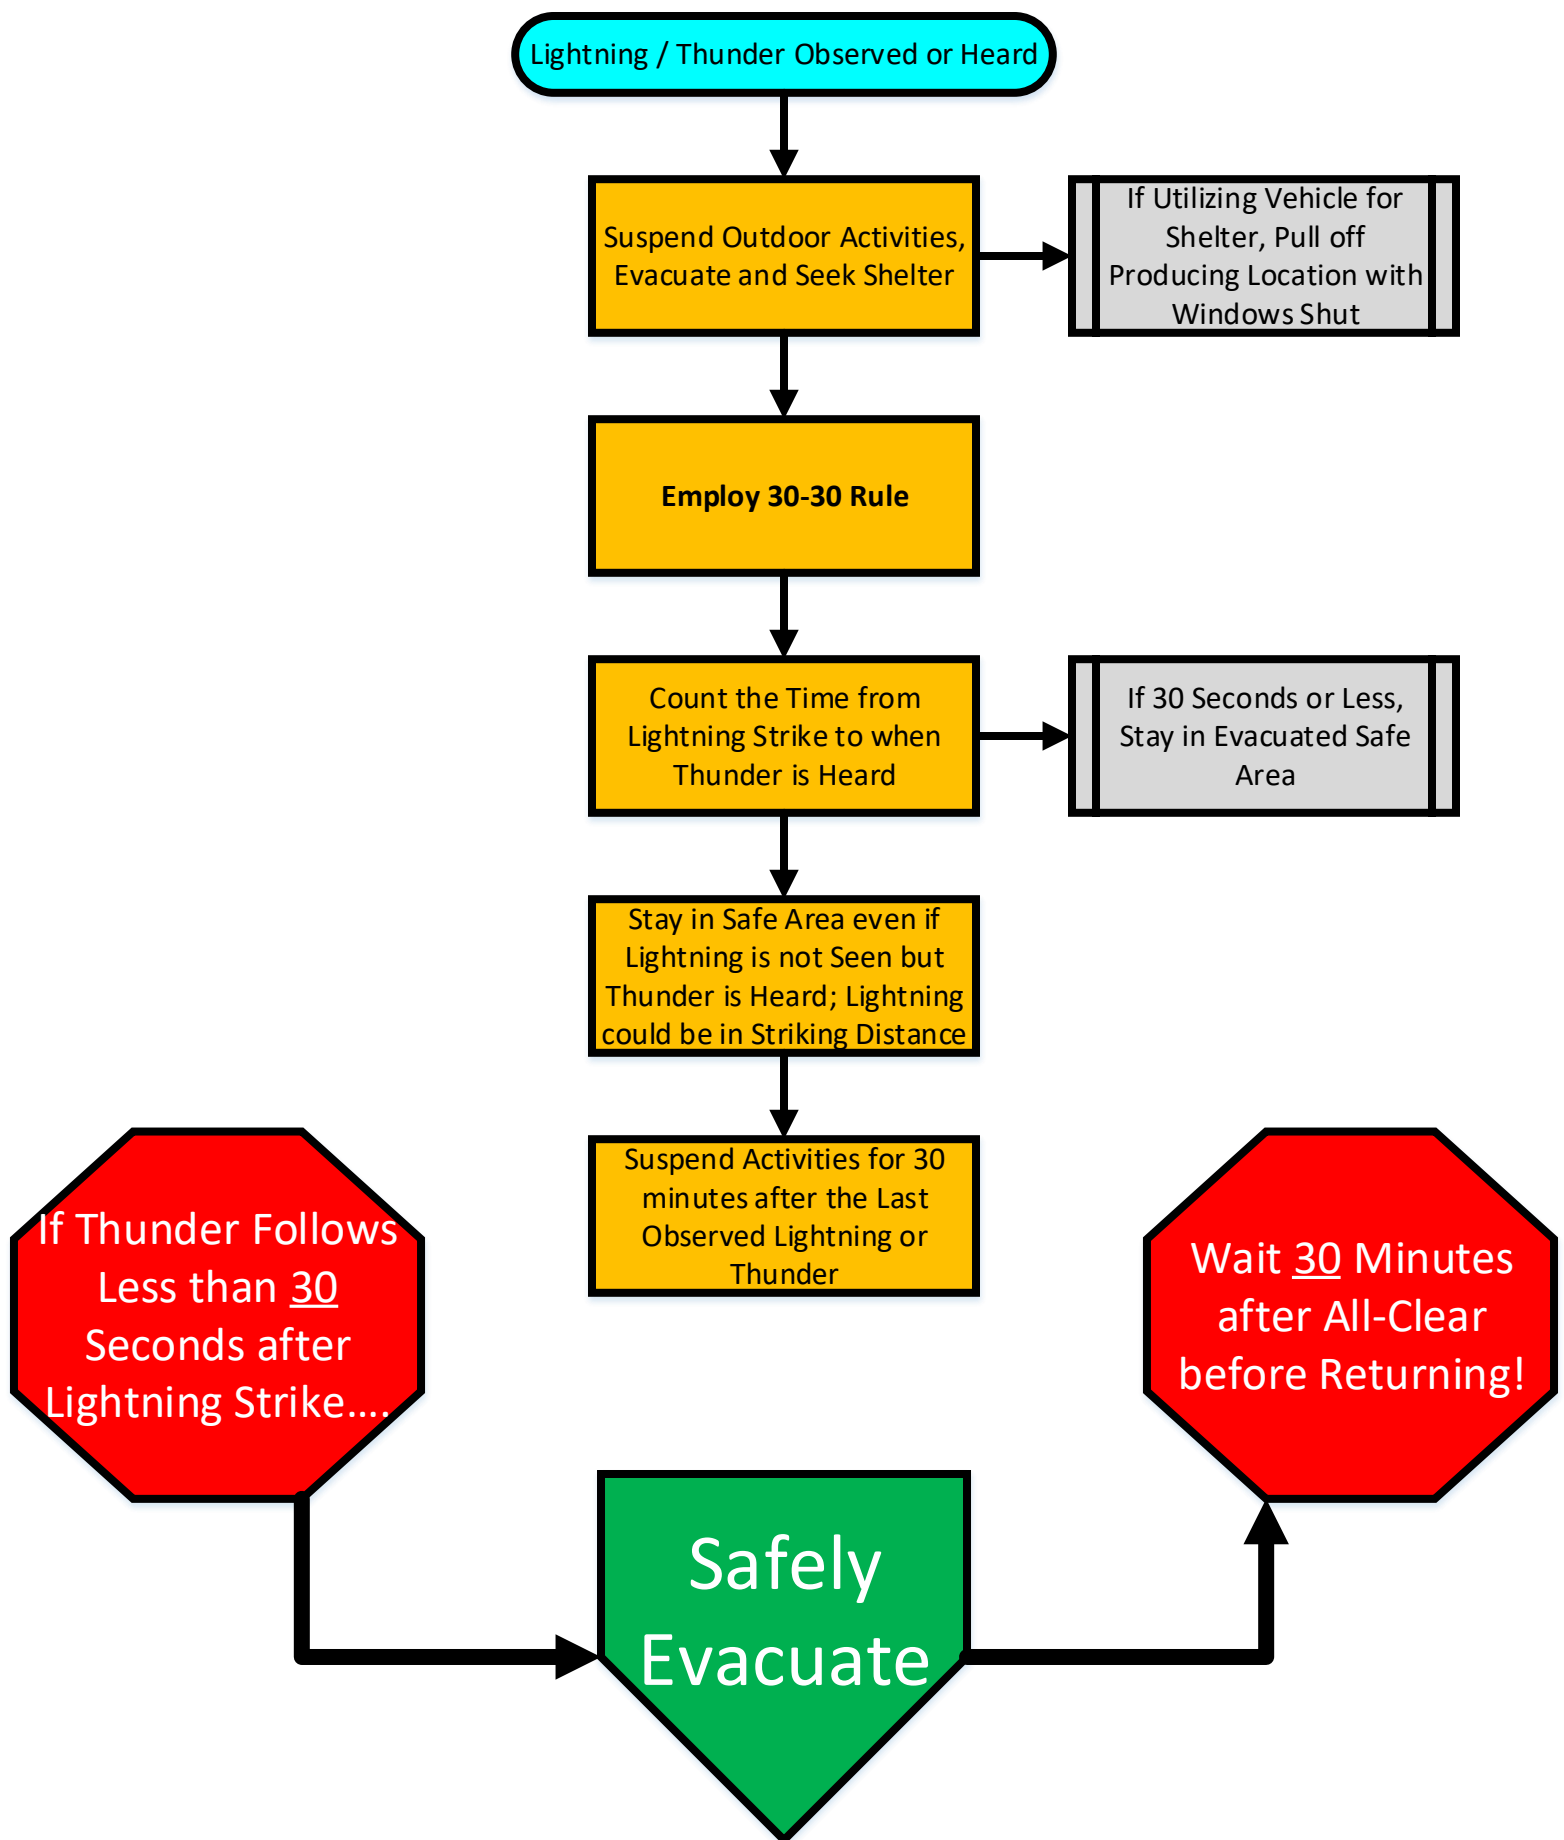


1.5 Lightning / Thunder Guidelines

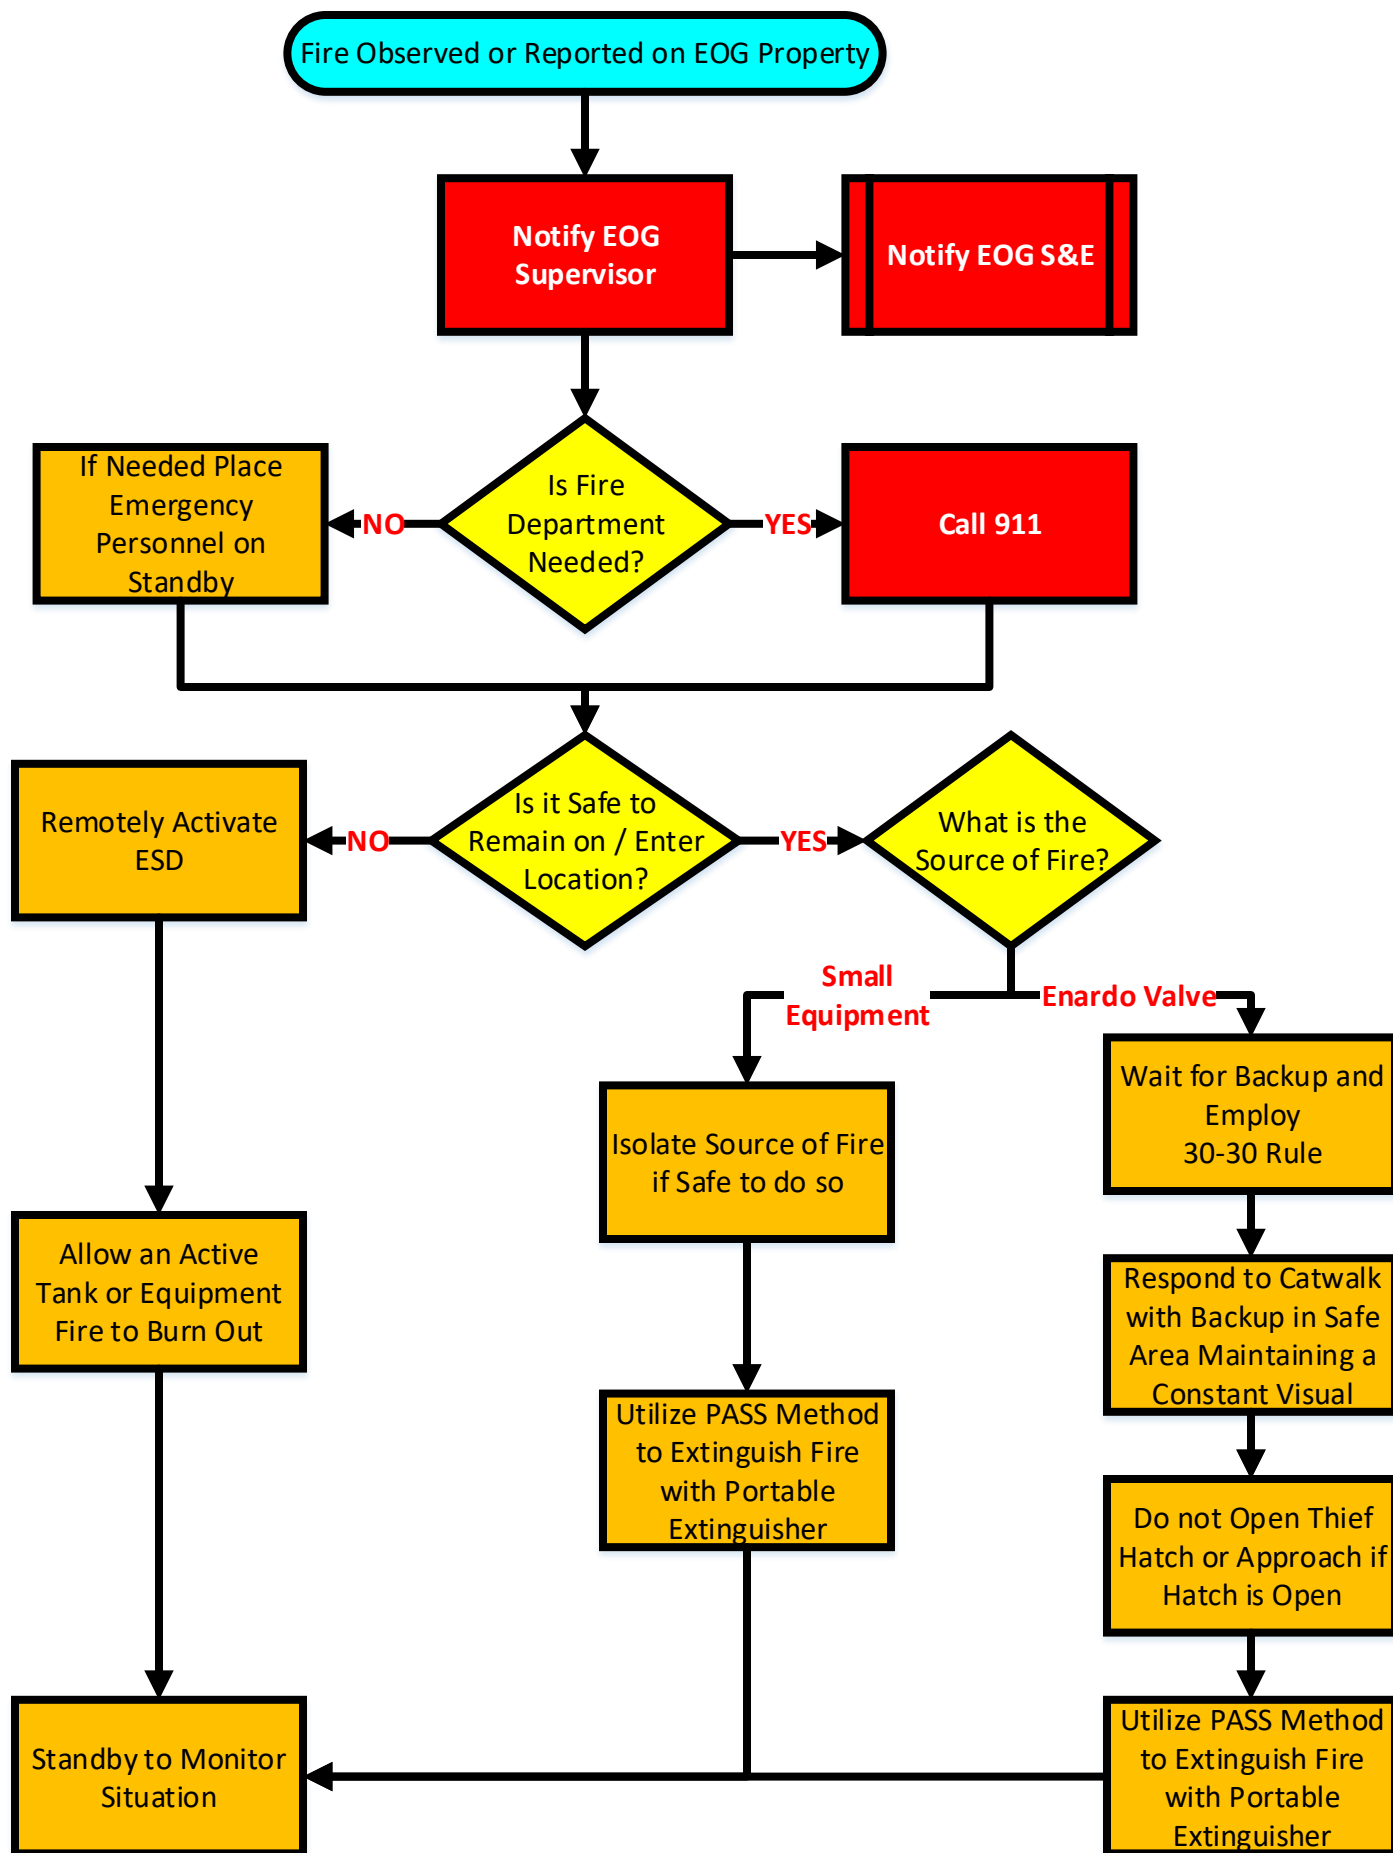

1.6 Fire on EOG Facility Guidelines

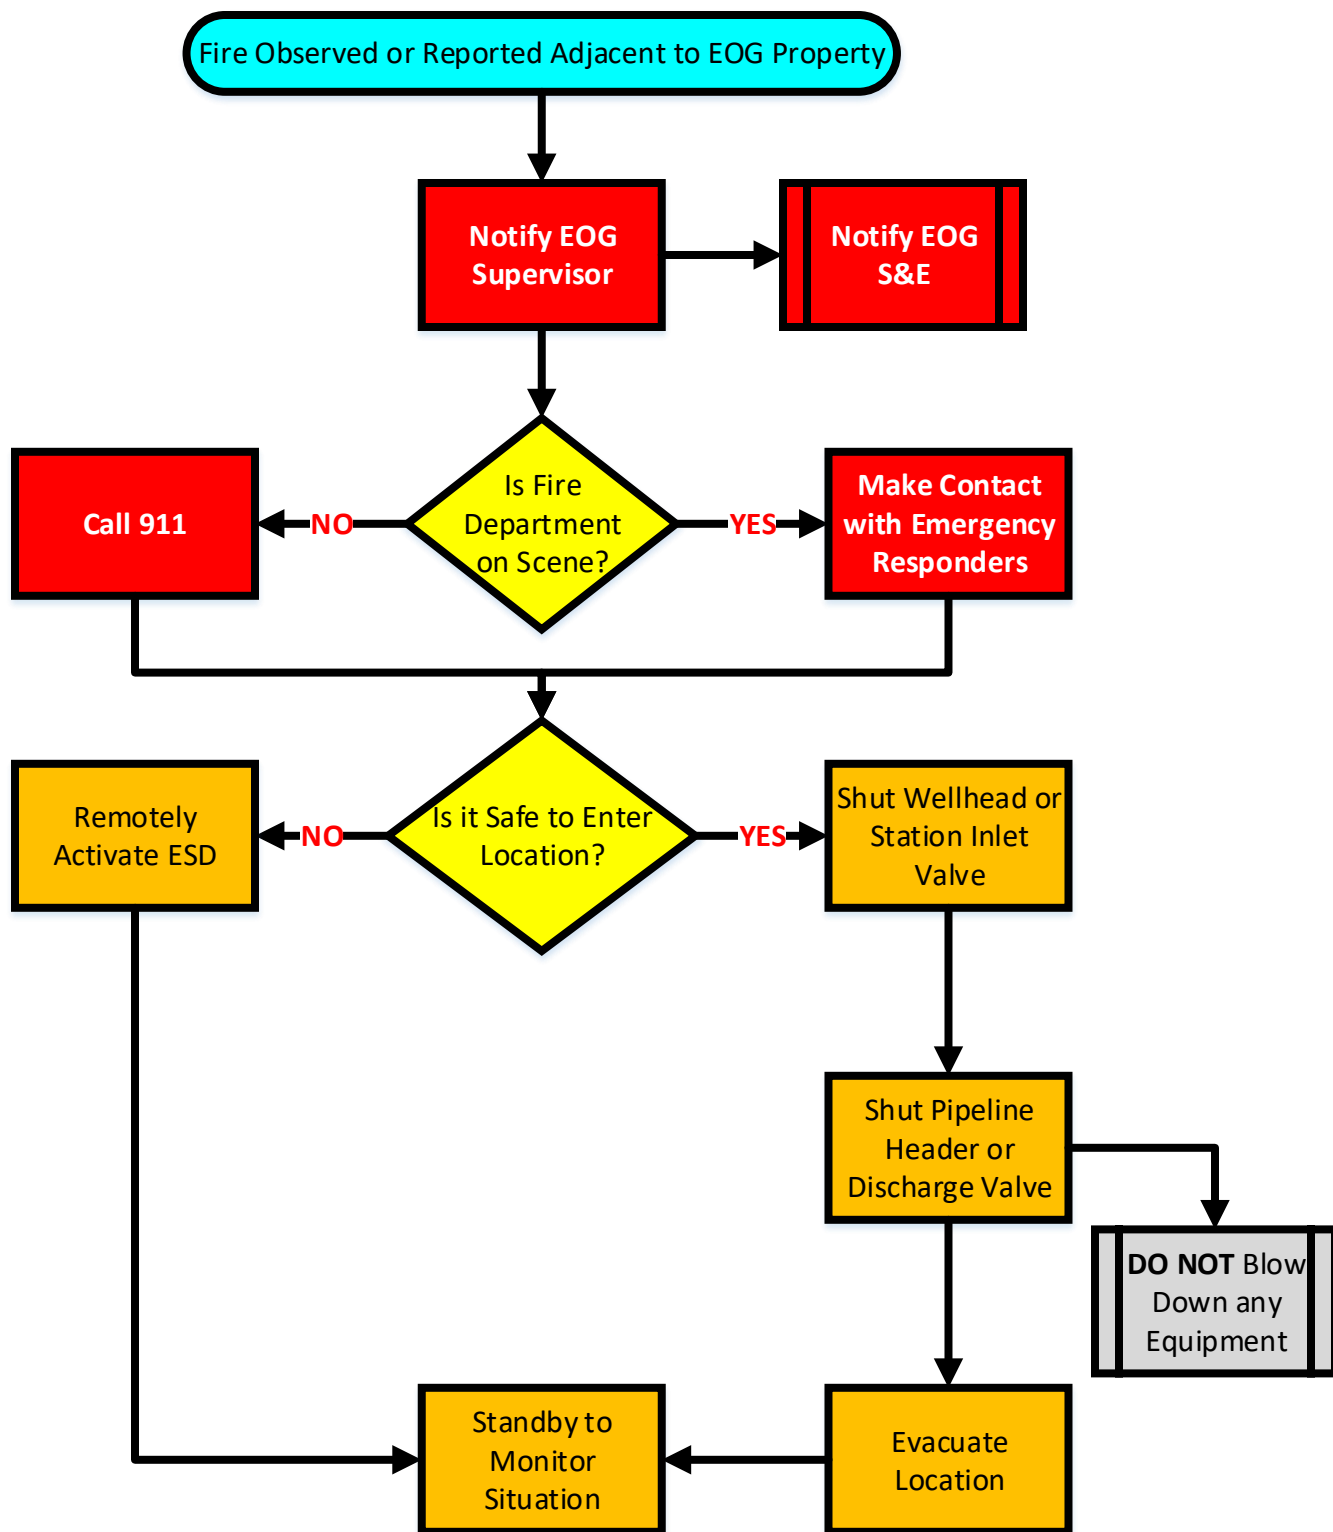

1.7 Fire Adjacent to EOG Facility Guidelines

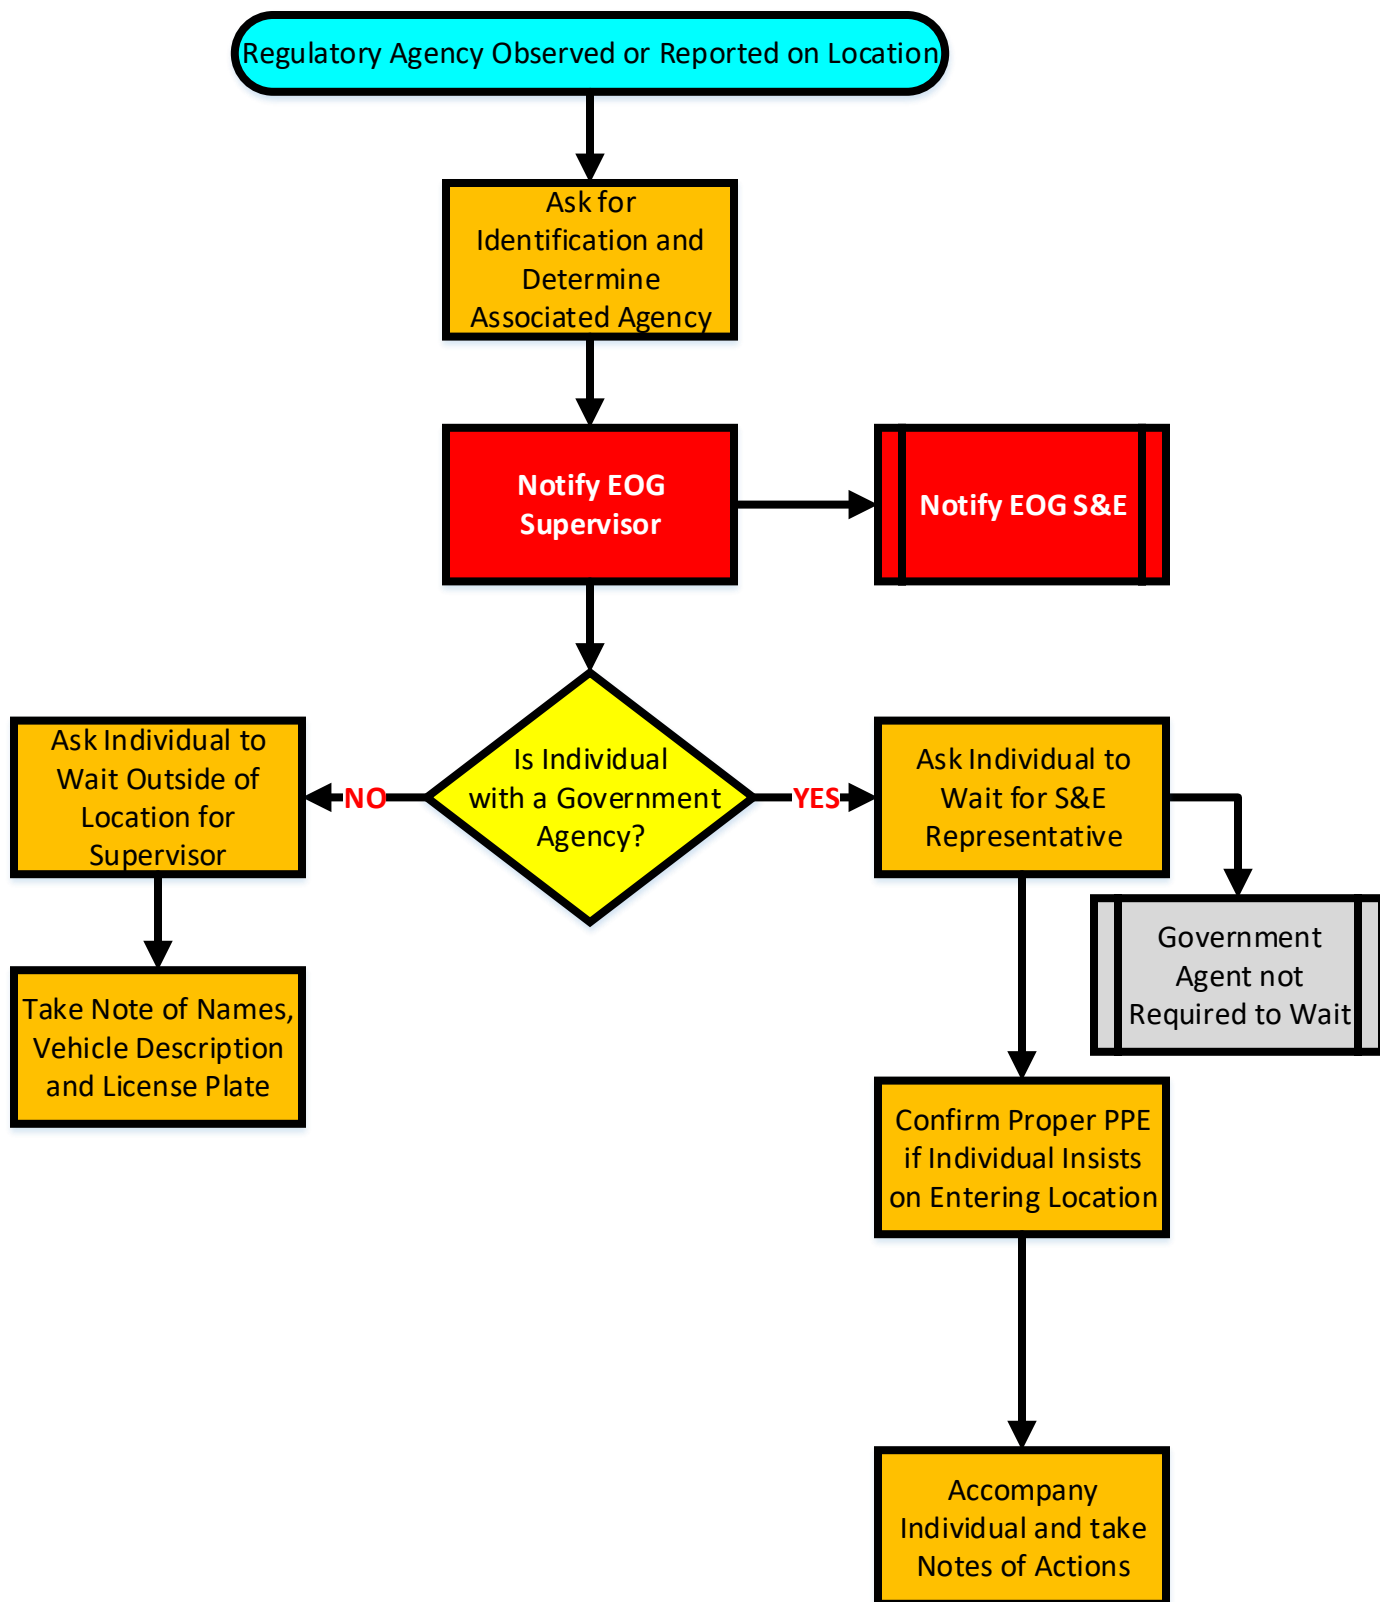

1.8 Regulatory Agency Onsite Guidelines

Suspicious Person / Vehicle Observed or Reported on Location

Do Not Approach or Confront Individual if Criminal Activity is Suspected

Notify EOG Supervisor

Notify EOG S&E

Is there Unannounced Approved Activity by a Contractor?

Contact Contract Company Representative to Verify

Call 911

Supply Law Enforcement with the Nearest Intersection

Wait at a Nearby Safe Area for Law Enforcement

Once Law Enforcement Arrives Standby at Safe Area until Instructed Otherwise

1.9 Criminal Activity on EOG Property Guidelines