

BLOW OUT PREVENTION EQUIPMENT
 10" 900s ALL FLANGED CONNECTIONS
 3,000/ WORKING PRESSURE - 6,000/ TEST

Exhibit C,

RECEIVED

MAY 31 1991

1991

HOBBS OFFICE

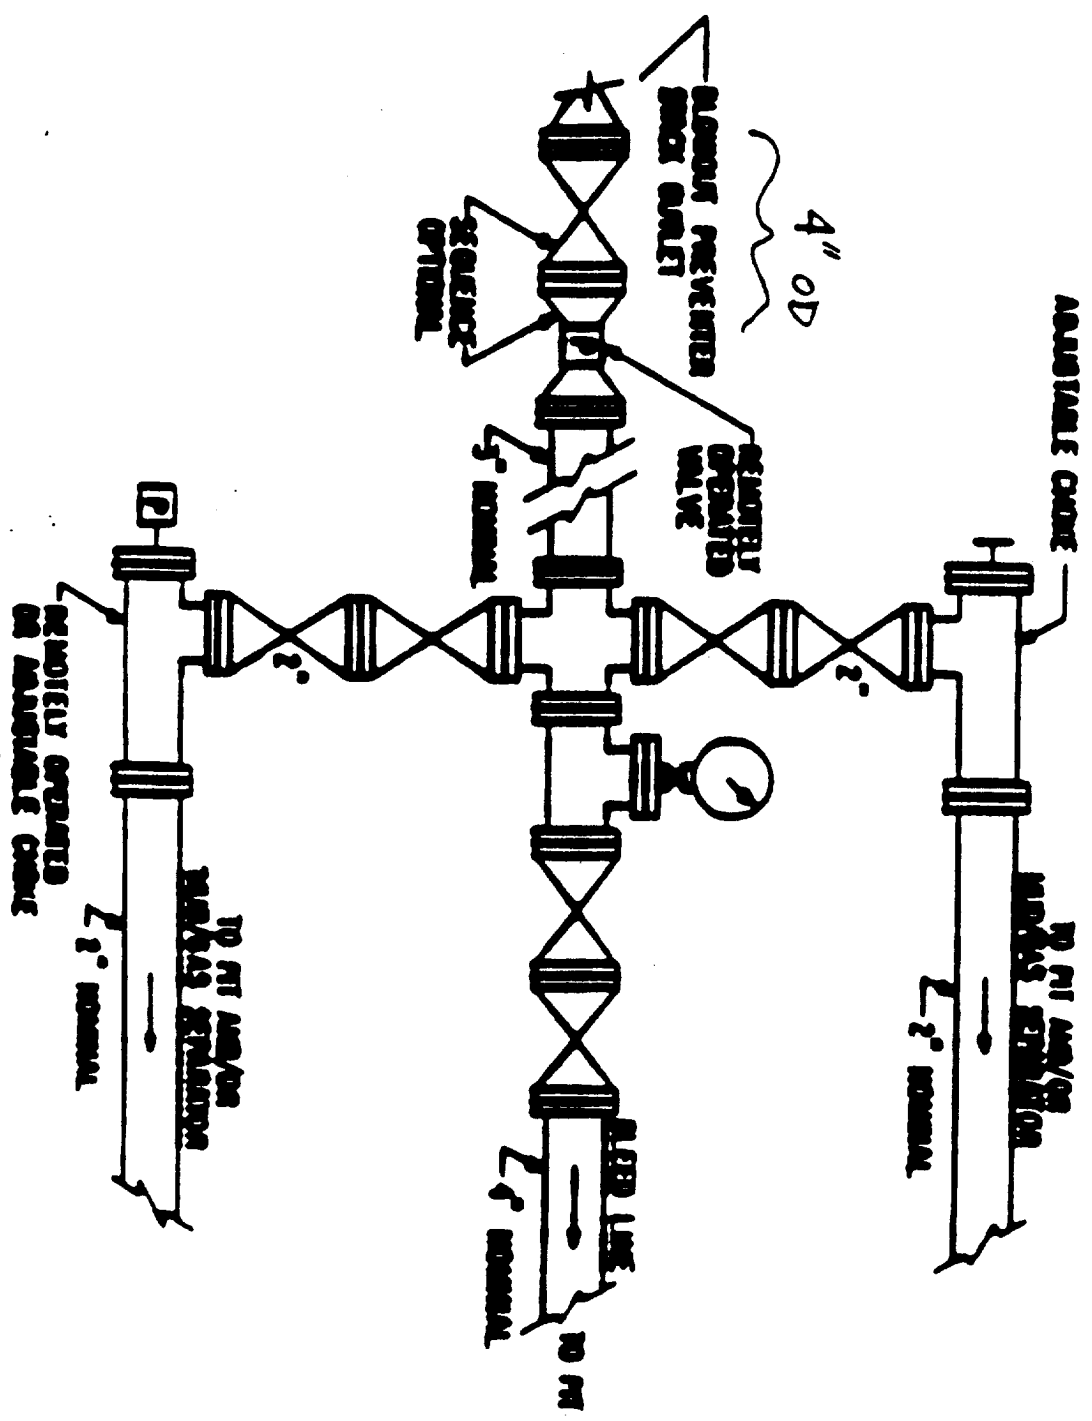


FIG. 2.A.2
 TYPICAL CHOKE MANIFOLD ASSEMBLY FOR SM
 RATED WORKING PRESSURE SERVICE -
 SURFACE INSTALLATION

RECEIVED

MAY 31 1991

000
HOBAS OFFICE