Case No.

1970

Large Exhibits

W.N.N.C.F. MICROGRAPHICS

BEST AVAILABLE COPY

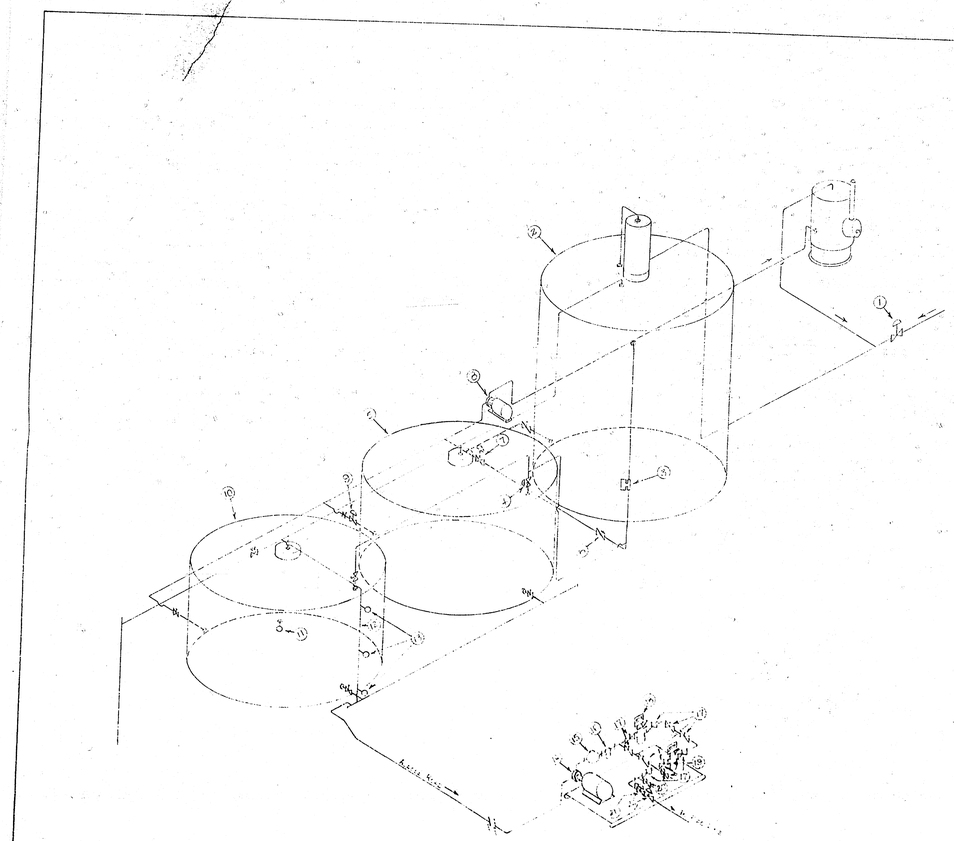

No.	Description
1	LEASE SHUT-IN VALVE
2	GAS SERVICE
3	BREW VALVE
4	SUCTION FILL VALVE
5	FILL TUBE
6	CHECK VALVE
7	BAD OIL VALVE
8	RECIRCULATING PUMP
9	RECYCLE RECIRCULATING VALVE
10	BAD OIL TANK
11	HIGH-LEVEL SPLIT SCHMT SWITCH
12	3" STOCK TANK
13	LACT PUMP CONTROL SWITCHES
14	LACT CHARGE PUMP
15	A.O. SMITH REGULATOR 11 1630
16	A.O. SMITH STRAINER
17	3-WAY VALVES
18	A.O. SMITH 3-12-C METER
19	A.O. SMITH 3-12-A METER
20	PROVER CONNEC.
21	SPRING RETURN 3 WAY VALVE
22	FUEL GAS SHUT-IN VALVE

Yates A
Ballard A
Ballard B

Salt New Mex. Pipeline Co.

EX. 1

BLACK, SIVALLS & BRYSON, INC.
NEWMONT OIL CO.
LOCO HILLS WATER FLOOD SYSTEM
YATES, YATES "A", BALLARD "A" AND "B" LEASES
DRAWN BY: [illegible] 10-14-69 | APPROVED BY: [illegible] 10-14-69

U.S.N.R.C.F. MICROGRAPHICS

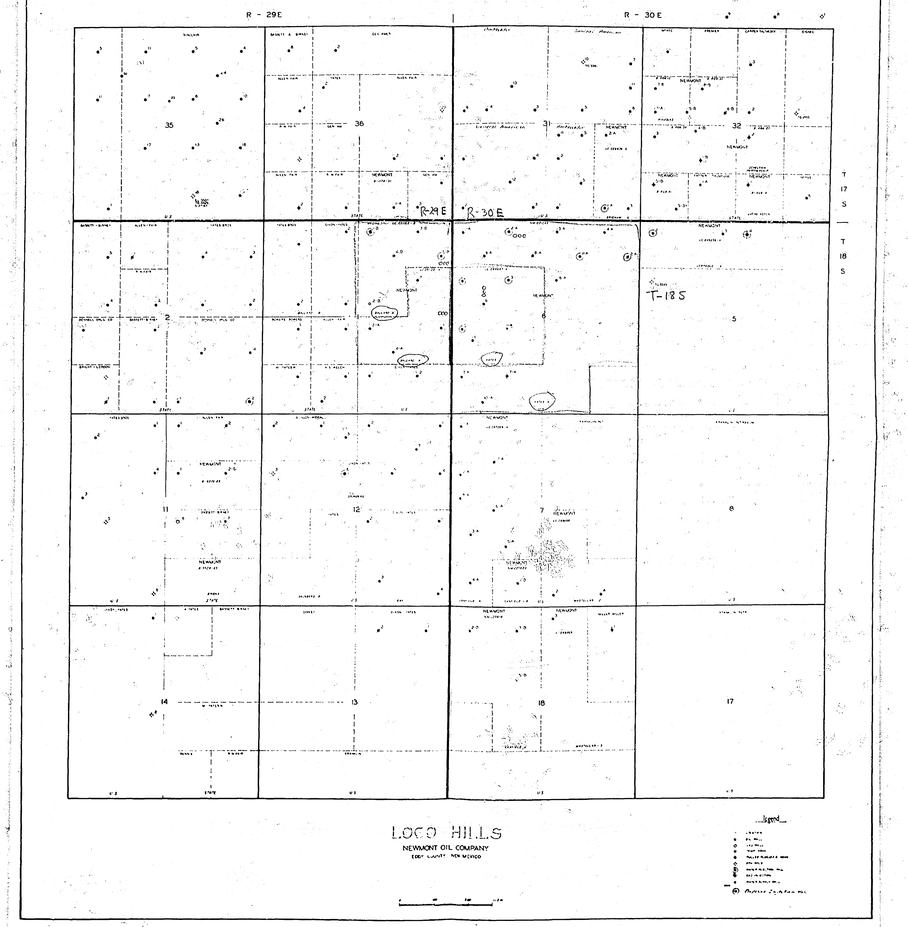

N.M.M.C.P. MICROGRAPHICS

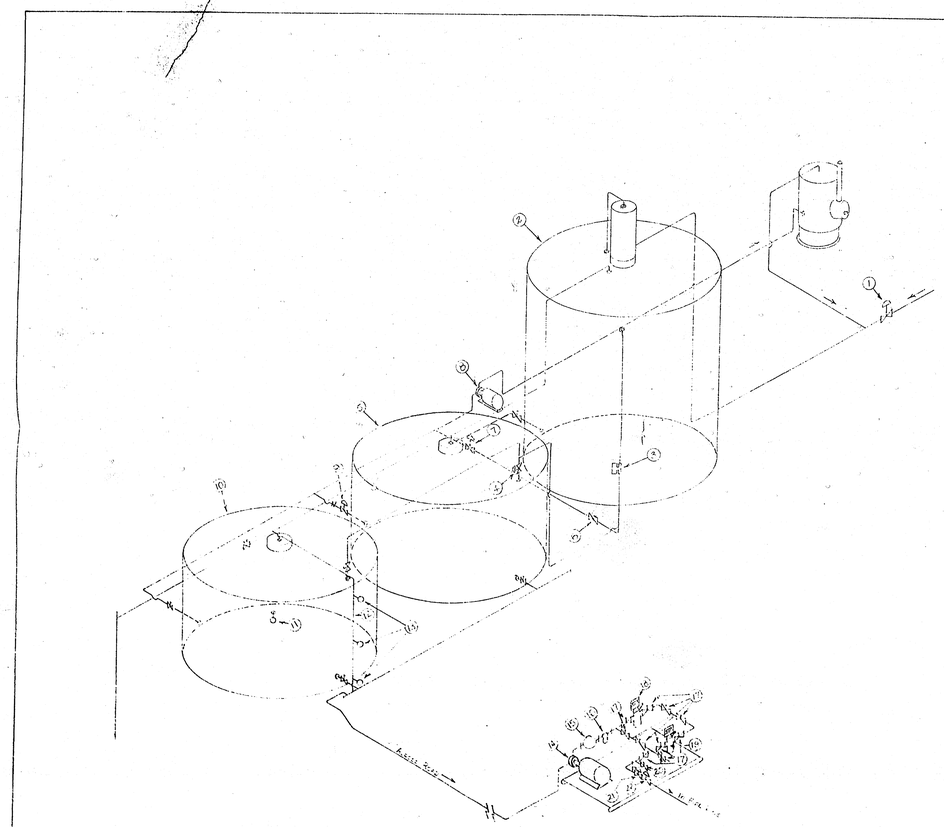

No.	Description
1	LEASE SHUT IN VALVE
2	GAUGE SERVICE
3	BS&W MONITOR
4	RUN TANK FILL VALVE
5	RUN TANK
6	CHECK VALVE
7	BAD OIL VALVE
8	RECIRCULATING PUMP
9	HEATER RECIRCULATING VALVE
10	BAD OIL TANK
11	HIGH-LEVEL SHUT DOWN SWITCH
12	3" STAN TUBE
13	LACT PUMP CONTROL SWITCHES
14	LACT CHARGE PUMP
15	A.O. SMITH - DEARBORN - H1030
16	A.O. SMITH STRAINER
17	BLOCK VALVE
18	A.O. SMITH 5-12-C METER
19	A.O. SMITH 5-12-B METER
20	PROVER & PIPE
21	PACK RECEIVER VALVE
22	FIRE-LINE SHUT IN VALVE

BEFORE EXAMINER UTZ
OIL CONSERVATION COMMISSION
NOC Exhibit NO. 1
CASE NO. 1870

BLACK, SIVALLS & BRYSON, INC.
NEWMONT OIL CO.
LOCO HILLS WATER FLOOD SYSTEM
YATES, YATES-7R, BALLARD & BALLARD-A LOCO

W.R.H.C.F. MICROGRAPHICS

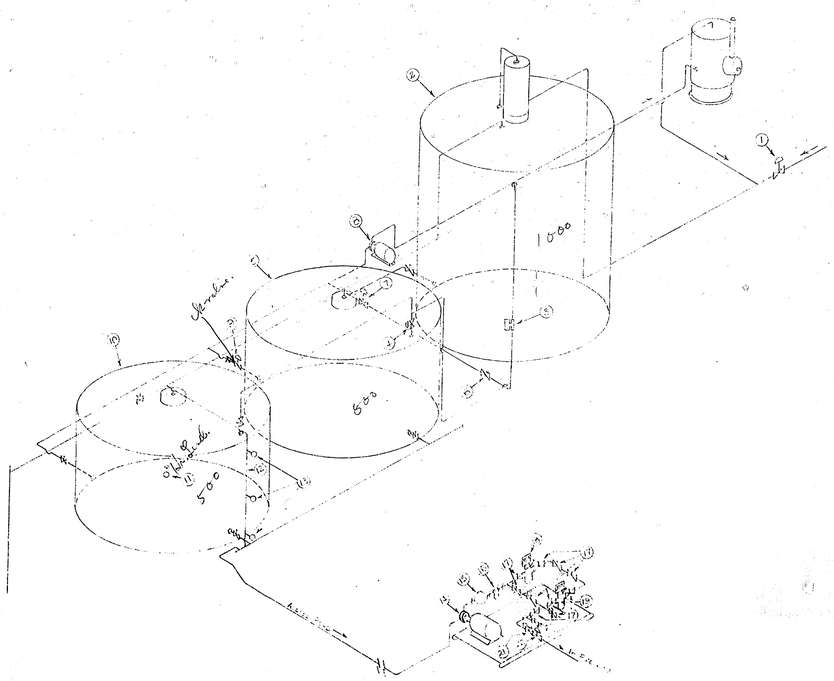

No.	Description
1	Lease Shut-In Valve
2	Gun Barrel
3	BS&W Monitor
4	Run Tank Fill Valve
5	Run Tank
6	Check Valve
7	Run Oil Valve
8	Recirculating Pump
9	Pressure Recirculating Valve
10	Bad Oil Tank
11	High-Level Shut Down Switch
12	2" Stan Pipe
13	Lact Pump Controls, Switches
14	Lact Charge Pump
15	A.O. Smith Deaerator, Model
16	A.O. Smith Strainer
17	Block Valves
18	A.O. Smith, S-13-C Meter
19	A.O. Smith, S-12-B Meter
20	Prover Loop
21	Back Pressure Valve
22	Pipe Line, Shut-In Valve

Feb 1970

BLACK, SIVALLS & BRYSON, INC.
Newmont Oil Co.
Lodo Hills Water Flood System
Yates, Yates W. Eumont & Eumont Ises
Drawn by [illegible] Approved by [illegible]

V.P.R.C.F. MICROGRAPHICS