


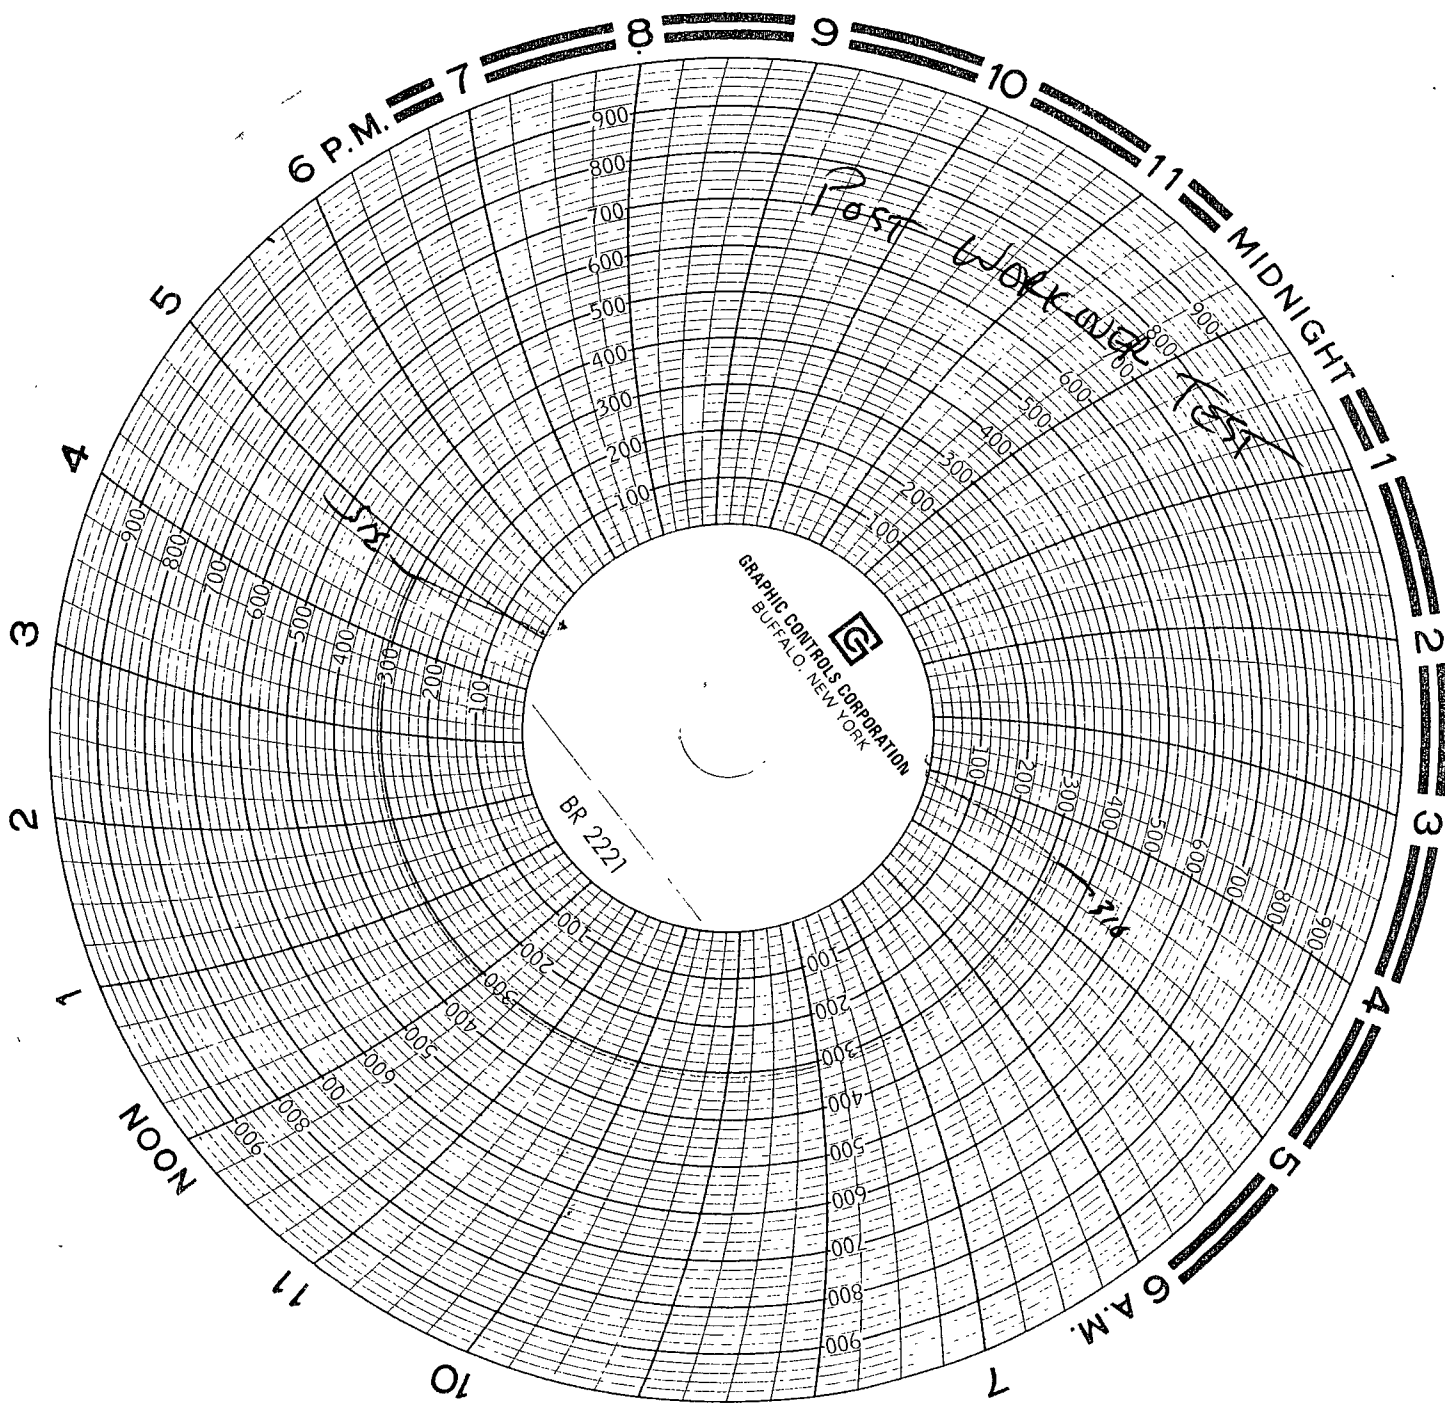

Tandem Energy
Ballant 26-01
Ballant Greybues
SAN Address 30-015-03413-00-00
CLNIT 001

Calibrated by
W:ldcat Measurement
4/5/07
Kurt D. Smith

Recorder S/N 6068

TRK #4 HD
I & J

9:45A - 10:15A

11/16/07 MIT