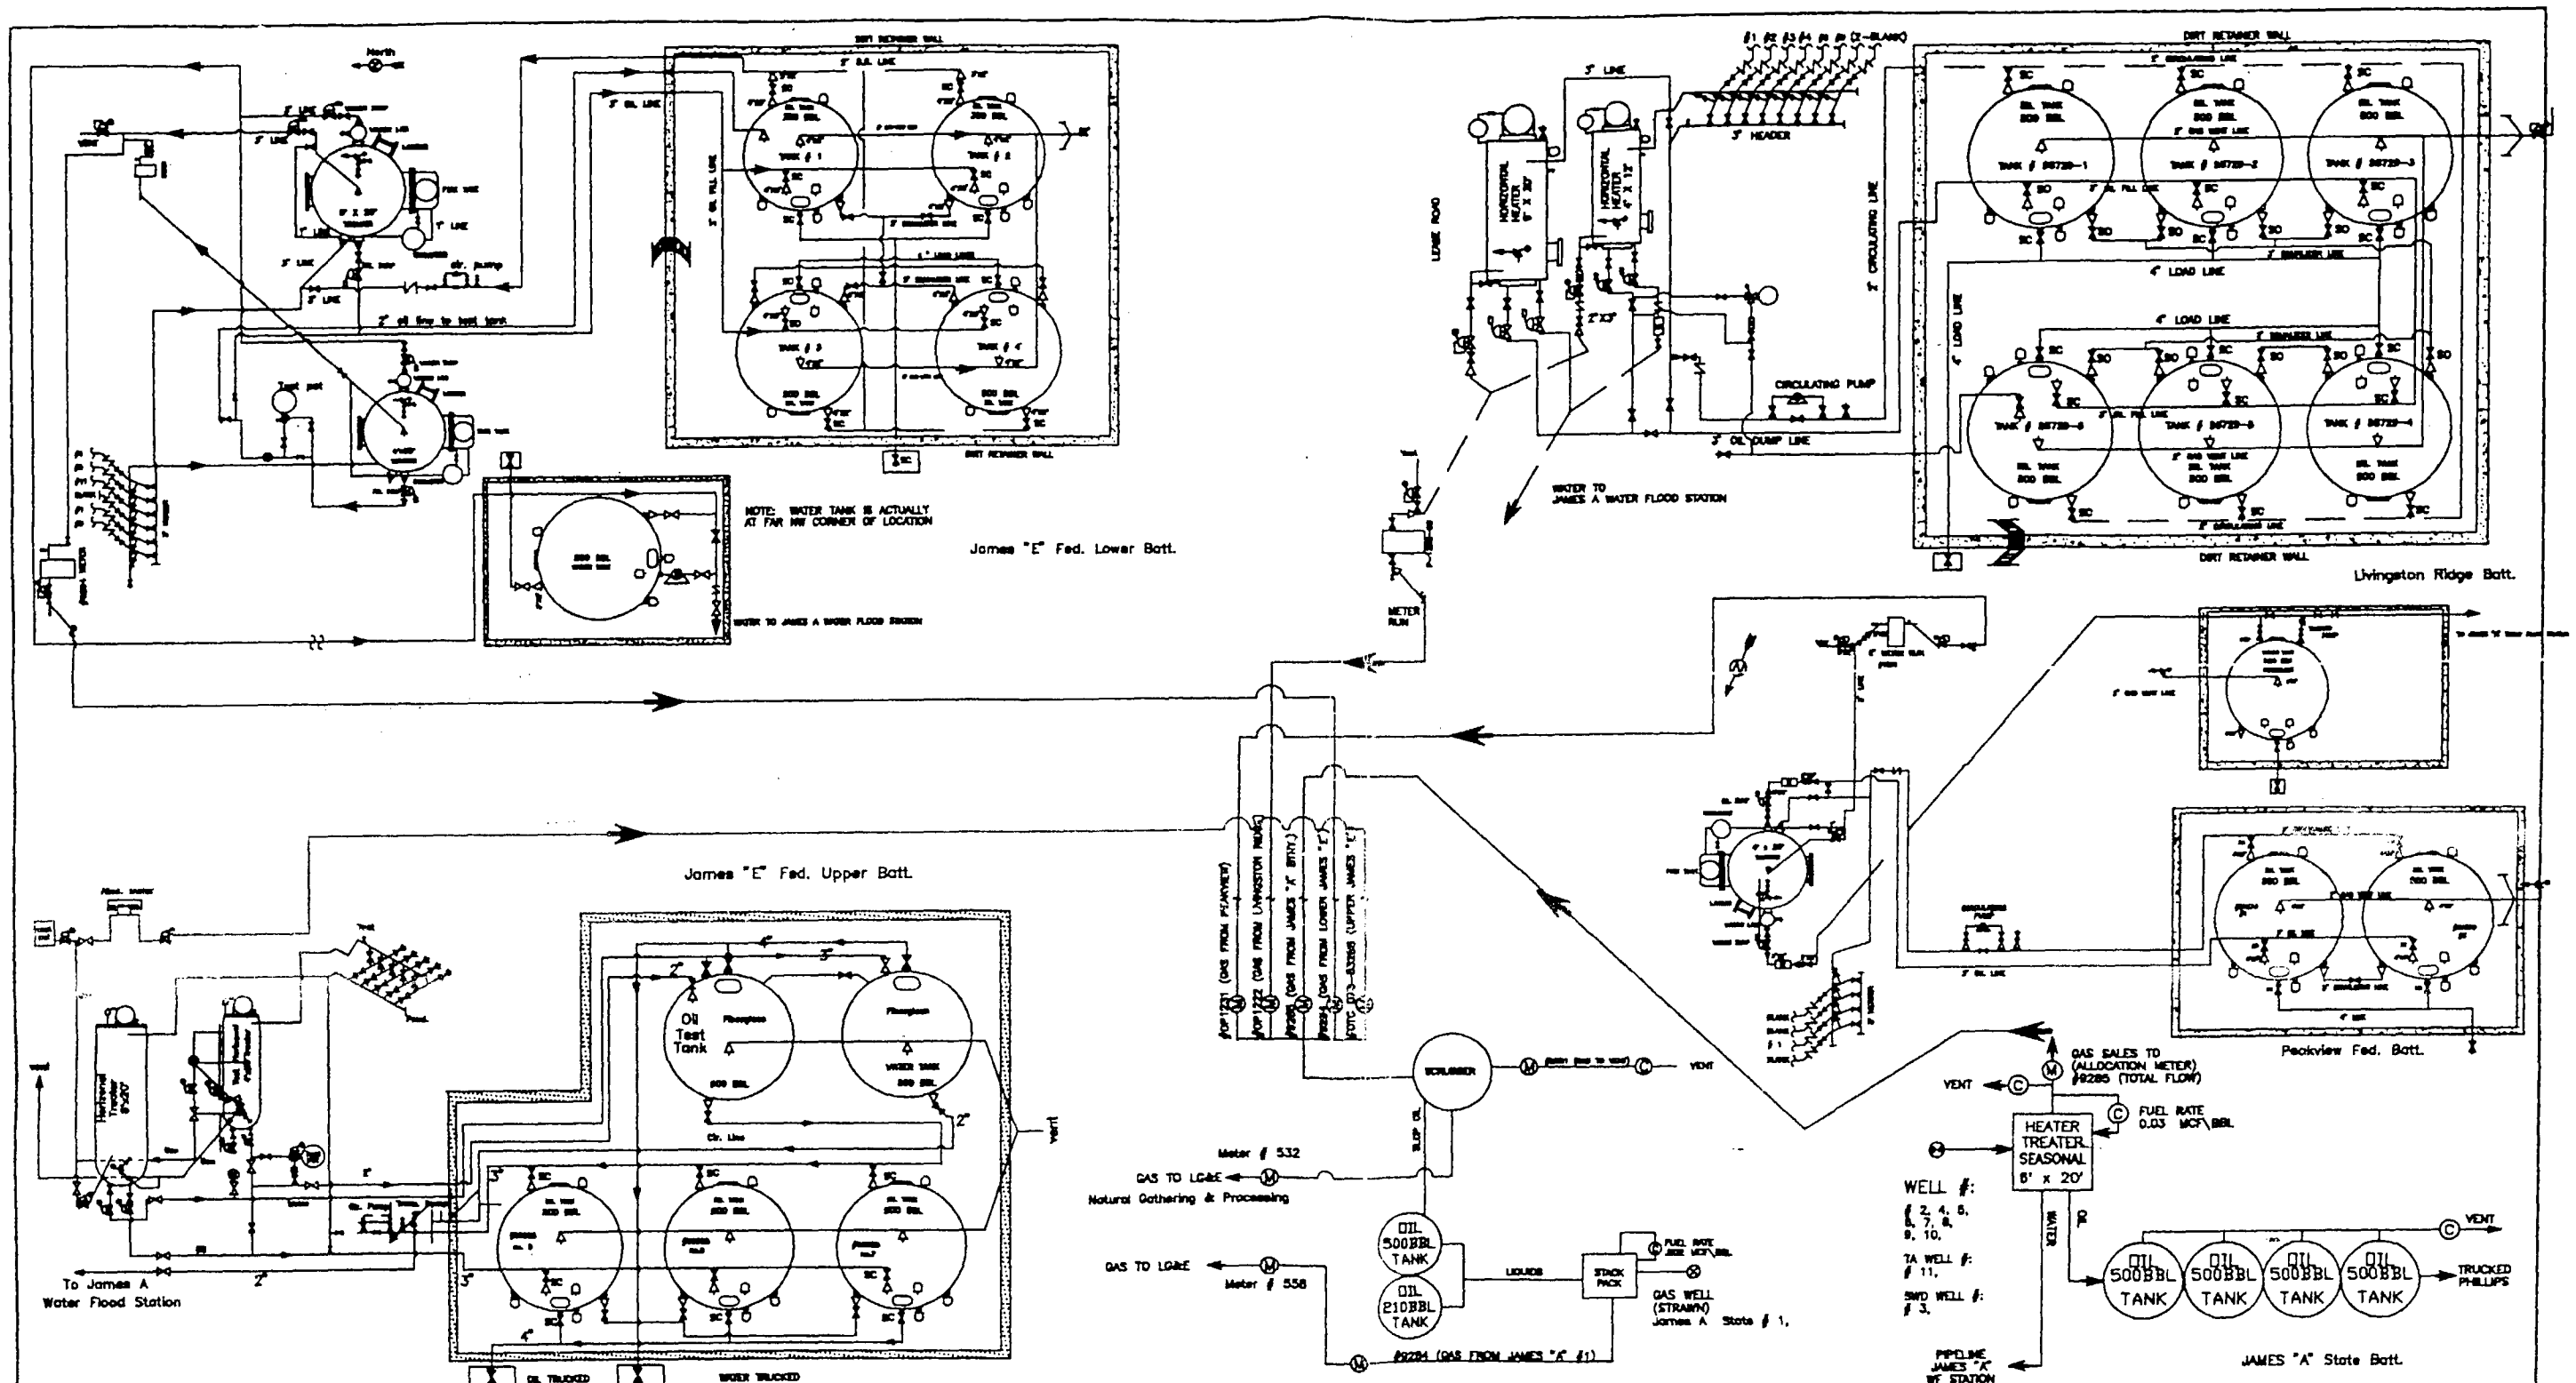

NO.	REVISION	BY	DATE
		CHECKED	APP'D

BLOCK VALVE CLOSED	BLOCK VALVE OPEN	FOR BIDS	
CENTRIFUGAL PUMP	DUMP VALVE	FOR APPR	
CHECK VALVE	BULL PLUG	FOR CONST	
PRESSURE CONTROL VALVE	SWEDGE	UPDATED BY:05/20/96-DGU	
PRESSURE MOTOR VALVE	METER	DRAWN 05/20/96	DGU
PRESSURE SAFETY VALVE	SC = SEALED CLOSED	CHECKED	
		APP'D	

PHILLIPS PETROLEUM COMPANY
BARTLESVILLE, OKLAHOMA

LEASE NAME: James A & E, Peakview, Livingston Ridge

Eddy NM

SITES SECURITY DIAGRAM

JA NO.	FILE CODE
AFE NO.	SCALE NO
FILE NAME: Gassites	
DWG NO. 1.0	

RC-ORIGINAL

FORM 2401