


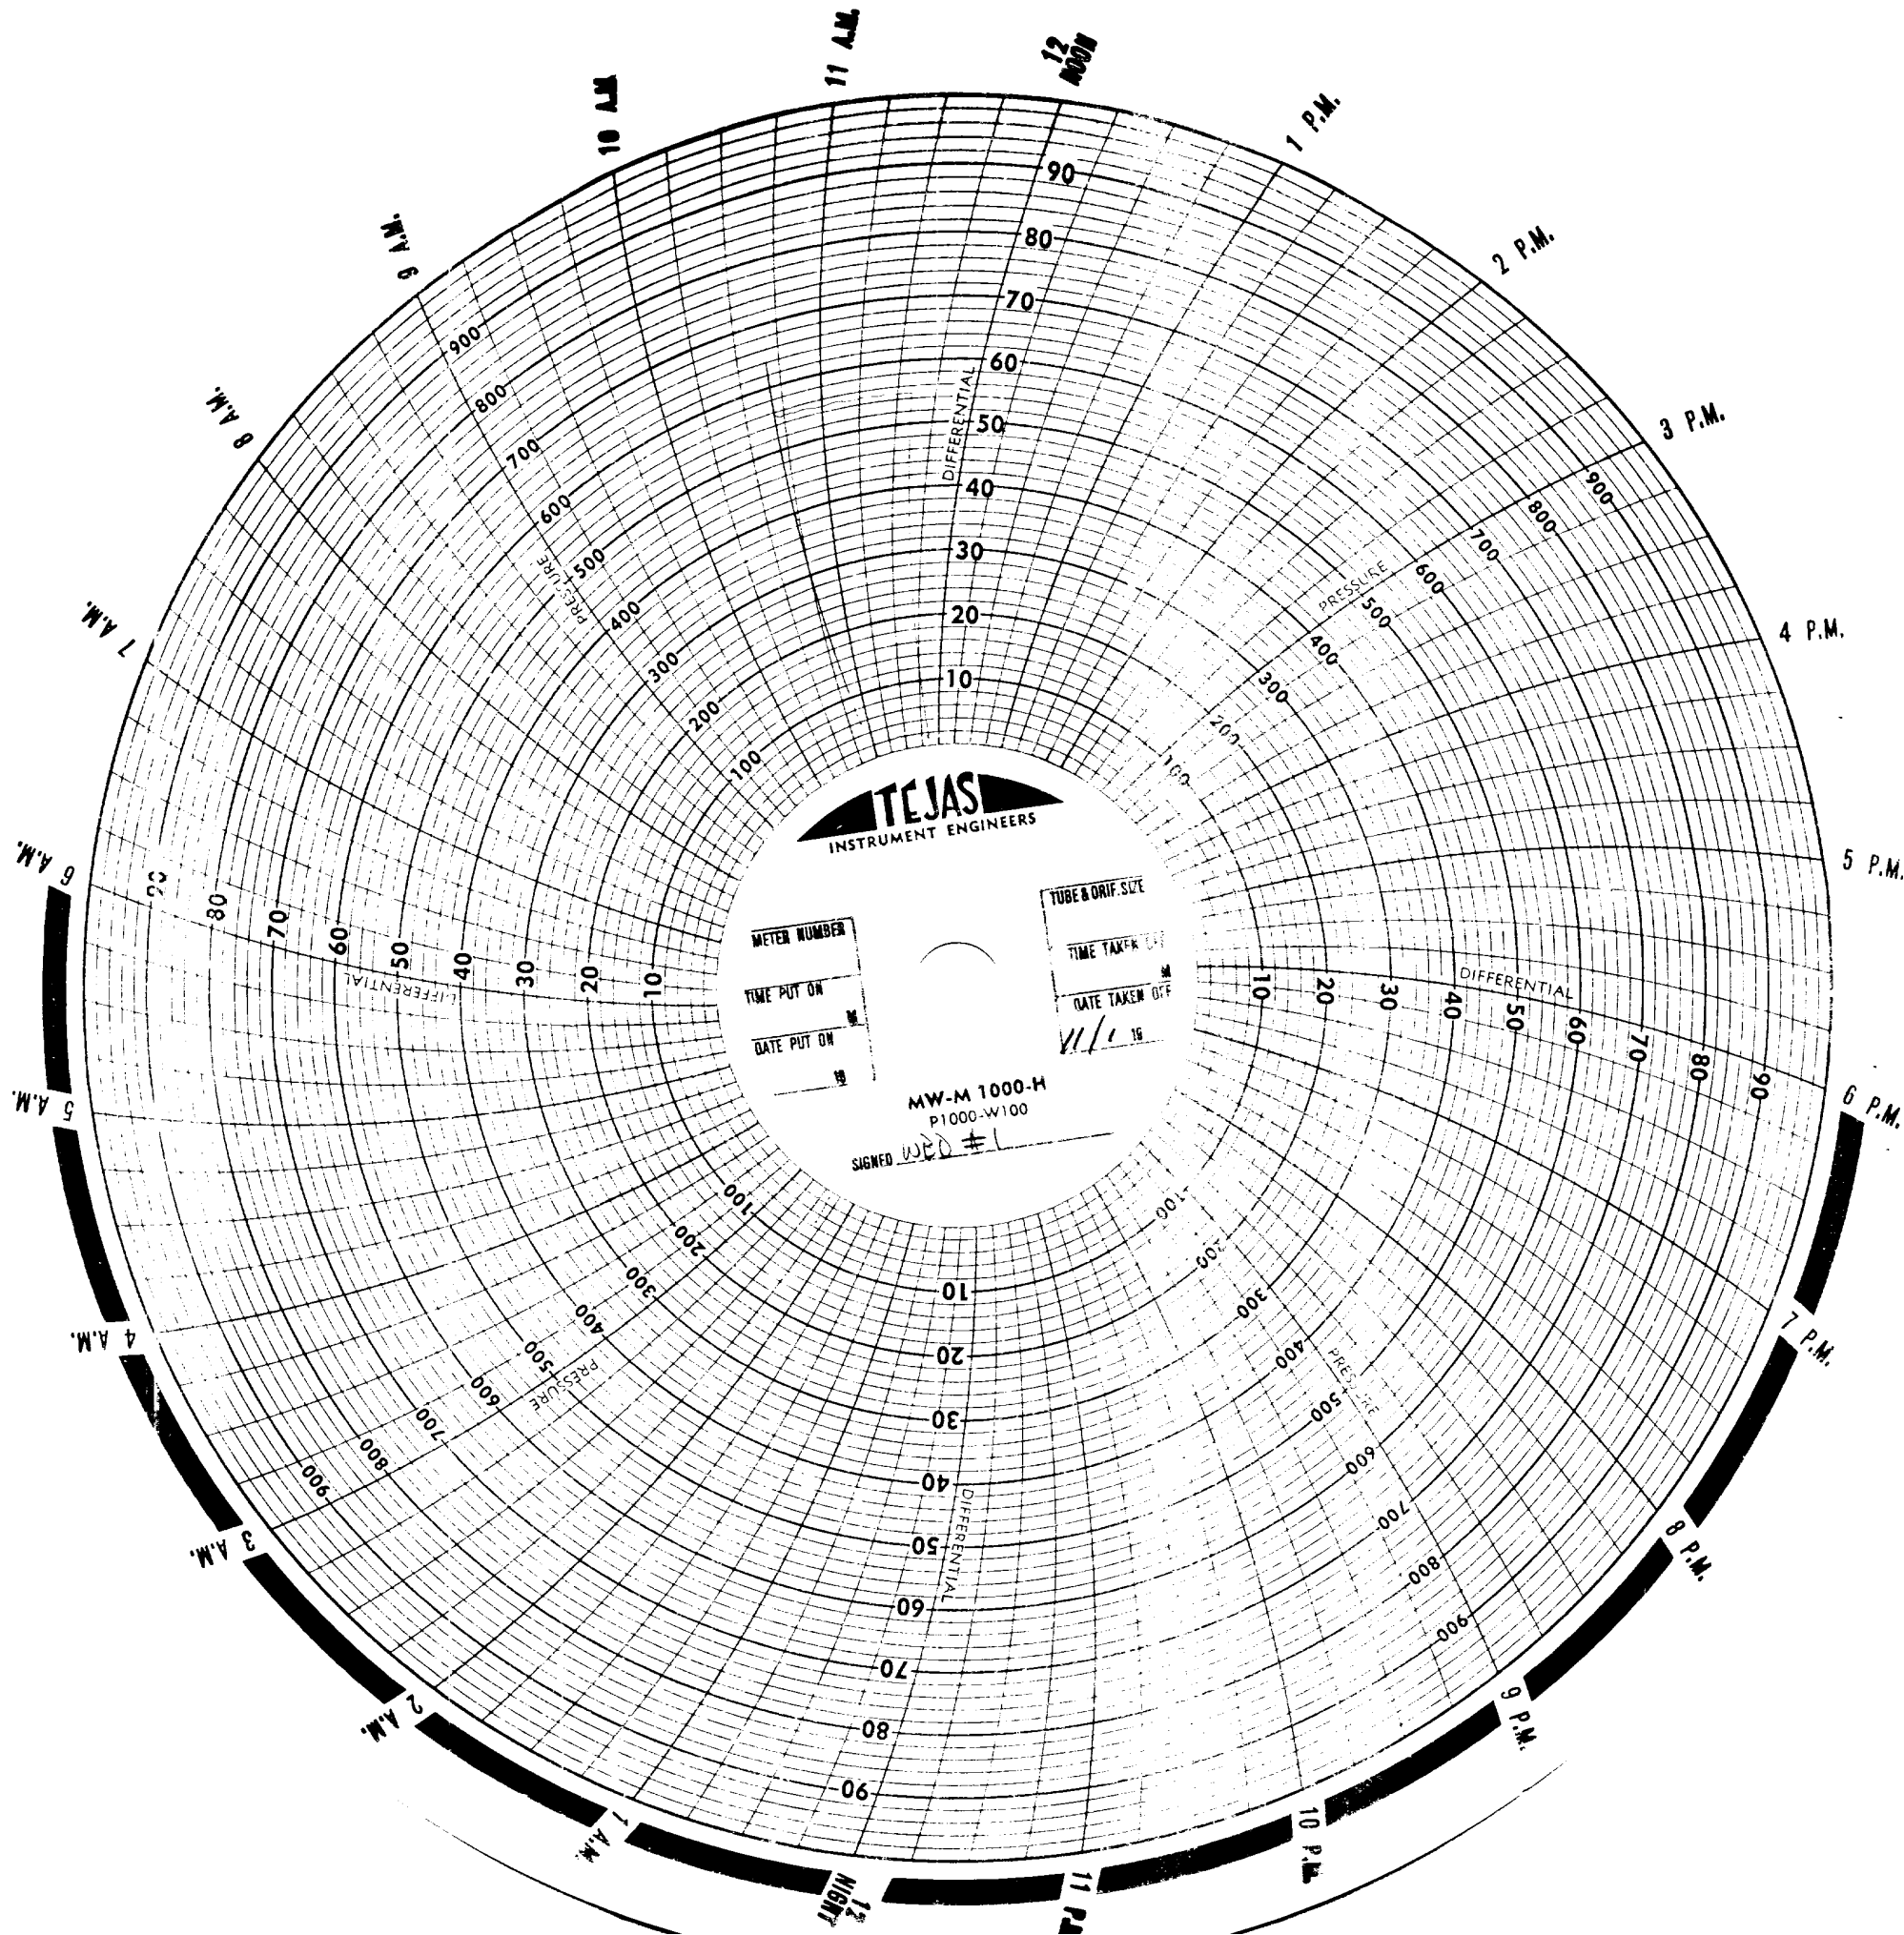

West Bravo Dome

WBDCDGU #1

SITP 620#

SICP 0

Pressured to 550# for 30min

10# drop