


PACKER LEAKAGE TEST
IDA WIMBERLEY NO 3
7/2-4/58

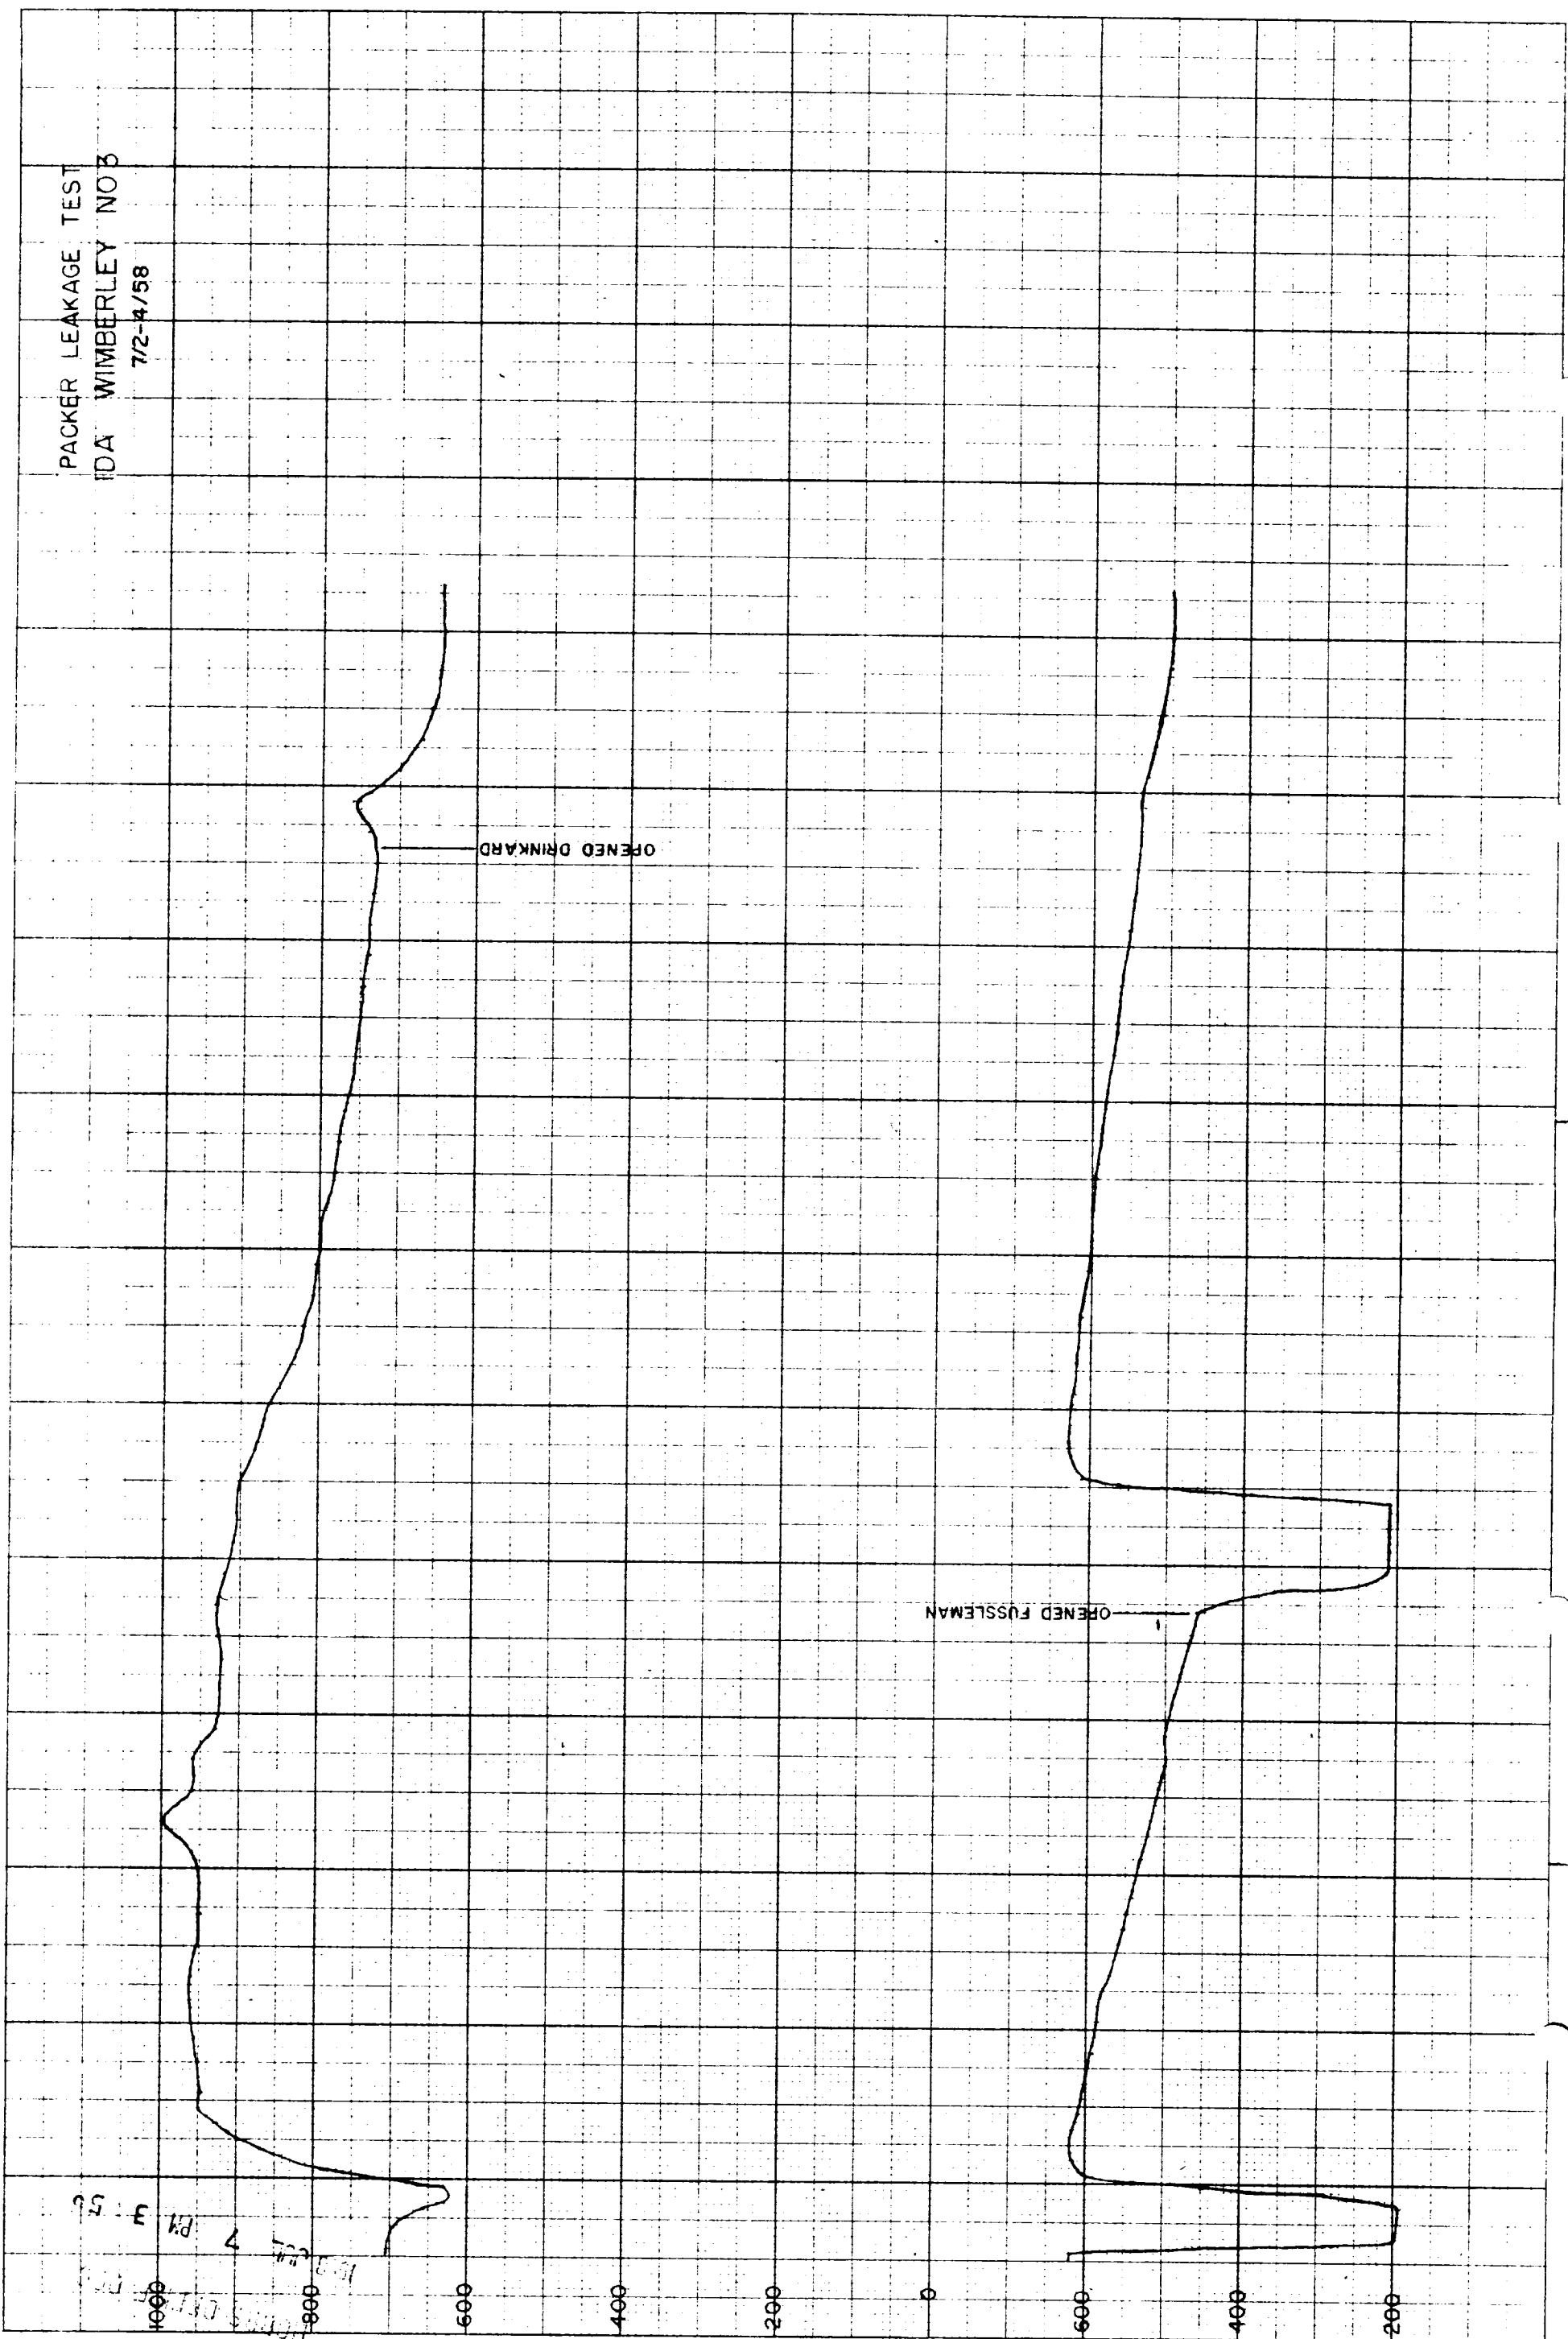

DRINKARD ZONE

PSI

FUSSELMAN ZONE

1000
800
600
400
200
0
7-2-58
7-3-58
7-4-58
7 PM
4:30

OPENED DRINKARD

OPENED FUSSELMAN

7-4-58

7-3-58

7-2-58