

*all oil will be drawn
from this heater*

*motor be tested monthly for
1st. 3 months and
thereafter
annually*


3100 psi

ILLEGIBLE

*standard
equipment*

R-1101
R-1028

- (A) 2 way motor valve
- (B) Test Header
- (C) Capacitance probe, hi level shut-in
- (D) Float switch, hi level shut-in
- (E) Metering test separator
- (F) Sampler and container
- (G) Ground level tank gauge
- (H) Electric motor & Centrifugal pump
- (I) BS & W monitor
- (J) Deaerator
- (K) Strainer
- (L) Positive displacement meter
- (M) Sampler & sample container
- (N) Prover manifold
- (P) Back pressure & Automatic shut in valve

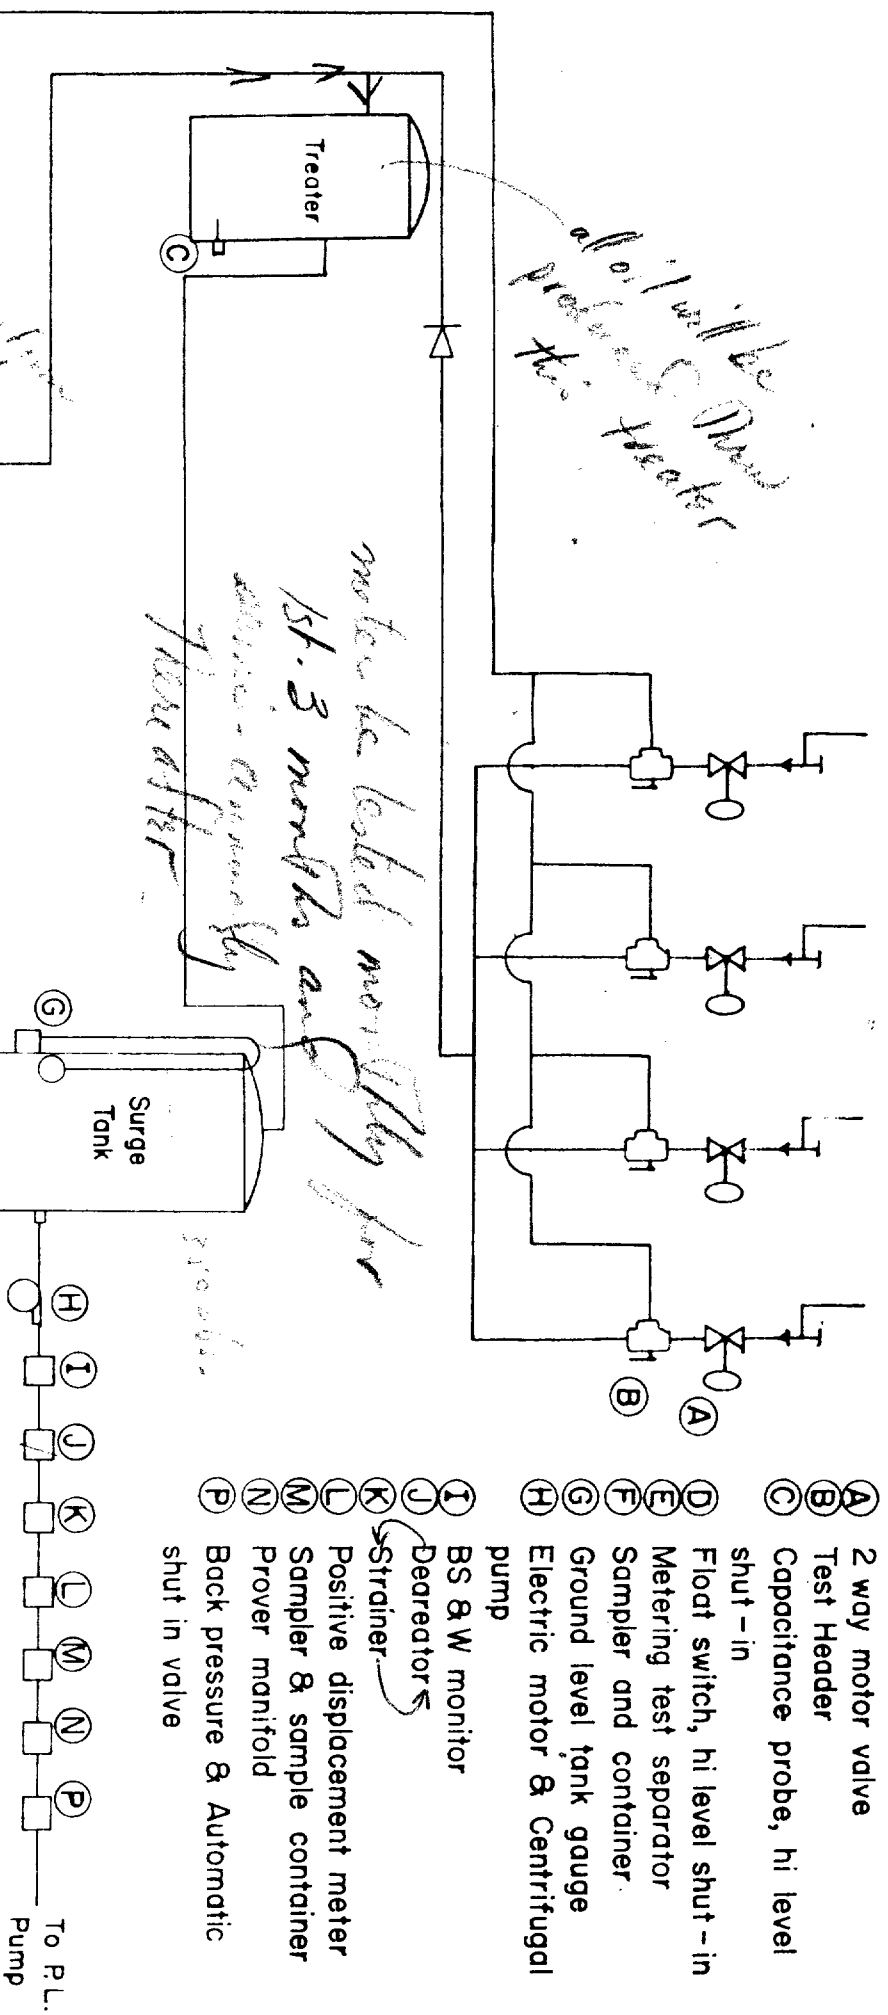

SCHEMATIC DIAGRAM
SOUTH VACUUM UNIT DEVONIAN TANK BATTERY
(AUTOMATIC CUSTODY TRANSFER SYSTEM)

Case 1577

EXHIBIT "2"