


**LARGE FORMAT  
EXHIBIT HAS  
BEEN REMOVED  
AND IS LOCATED  
IN THE NEXT FILE**

JALMAT (YATES SAND) UNIT  
TYPICAL WATER SUPPLY WELL

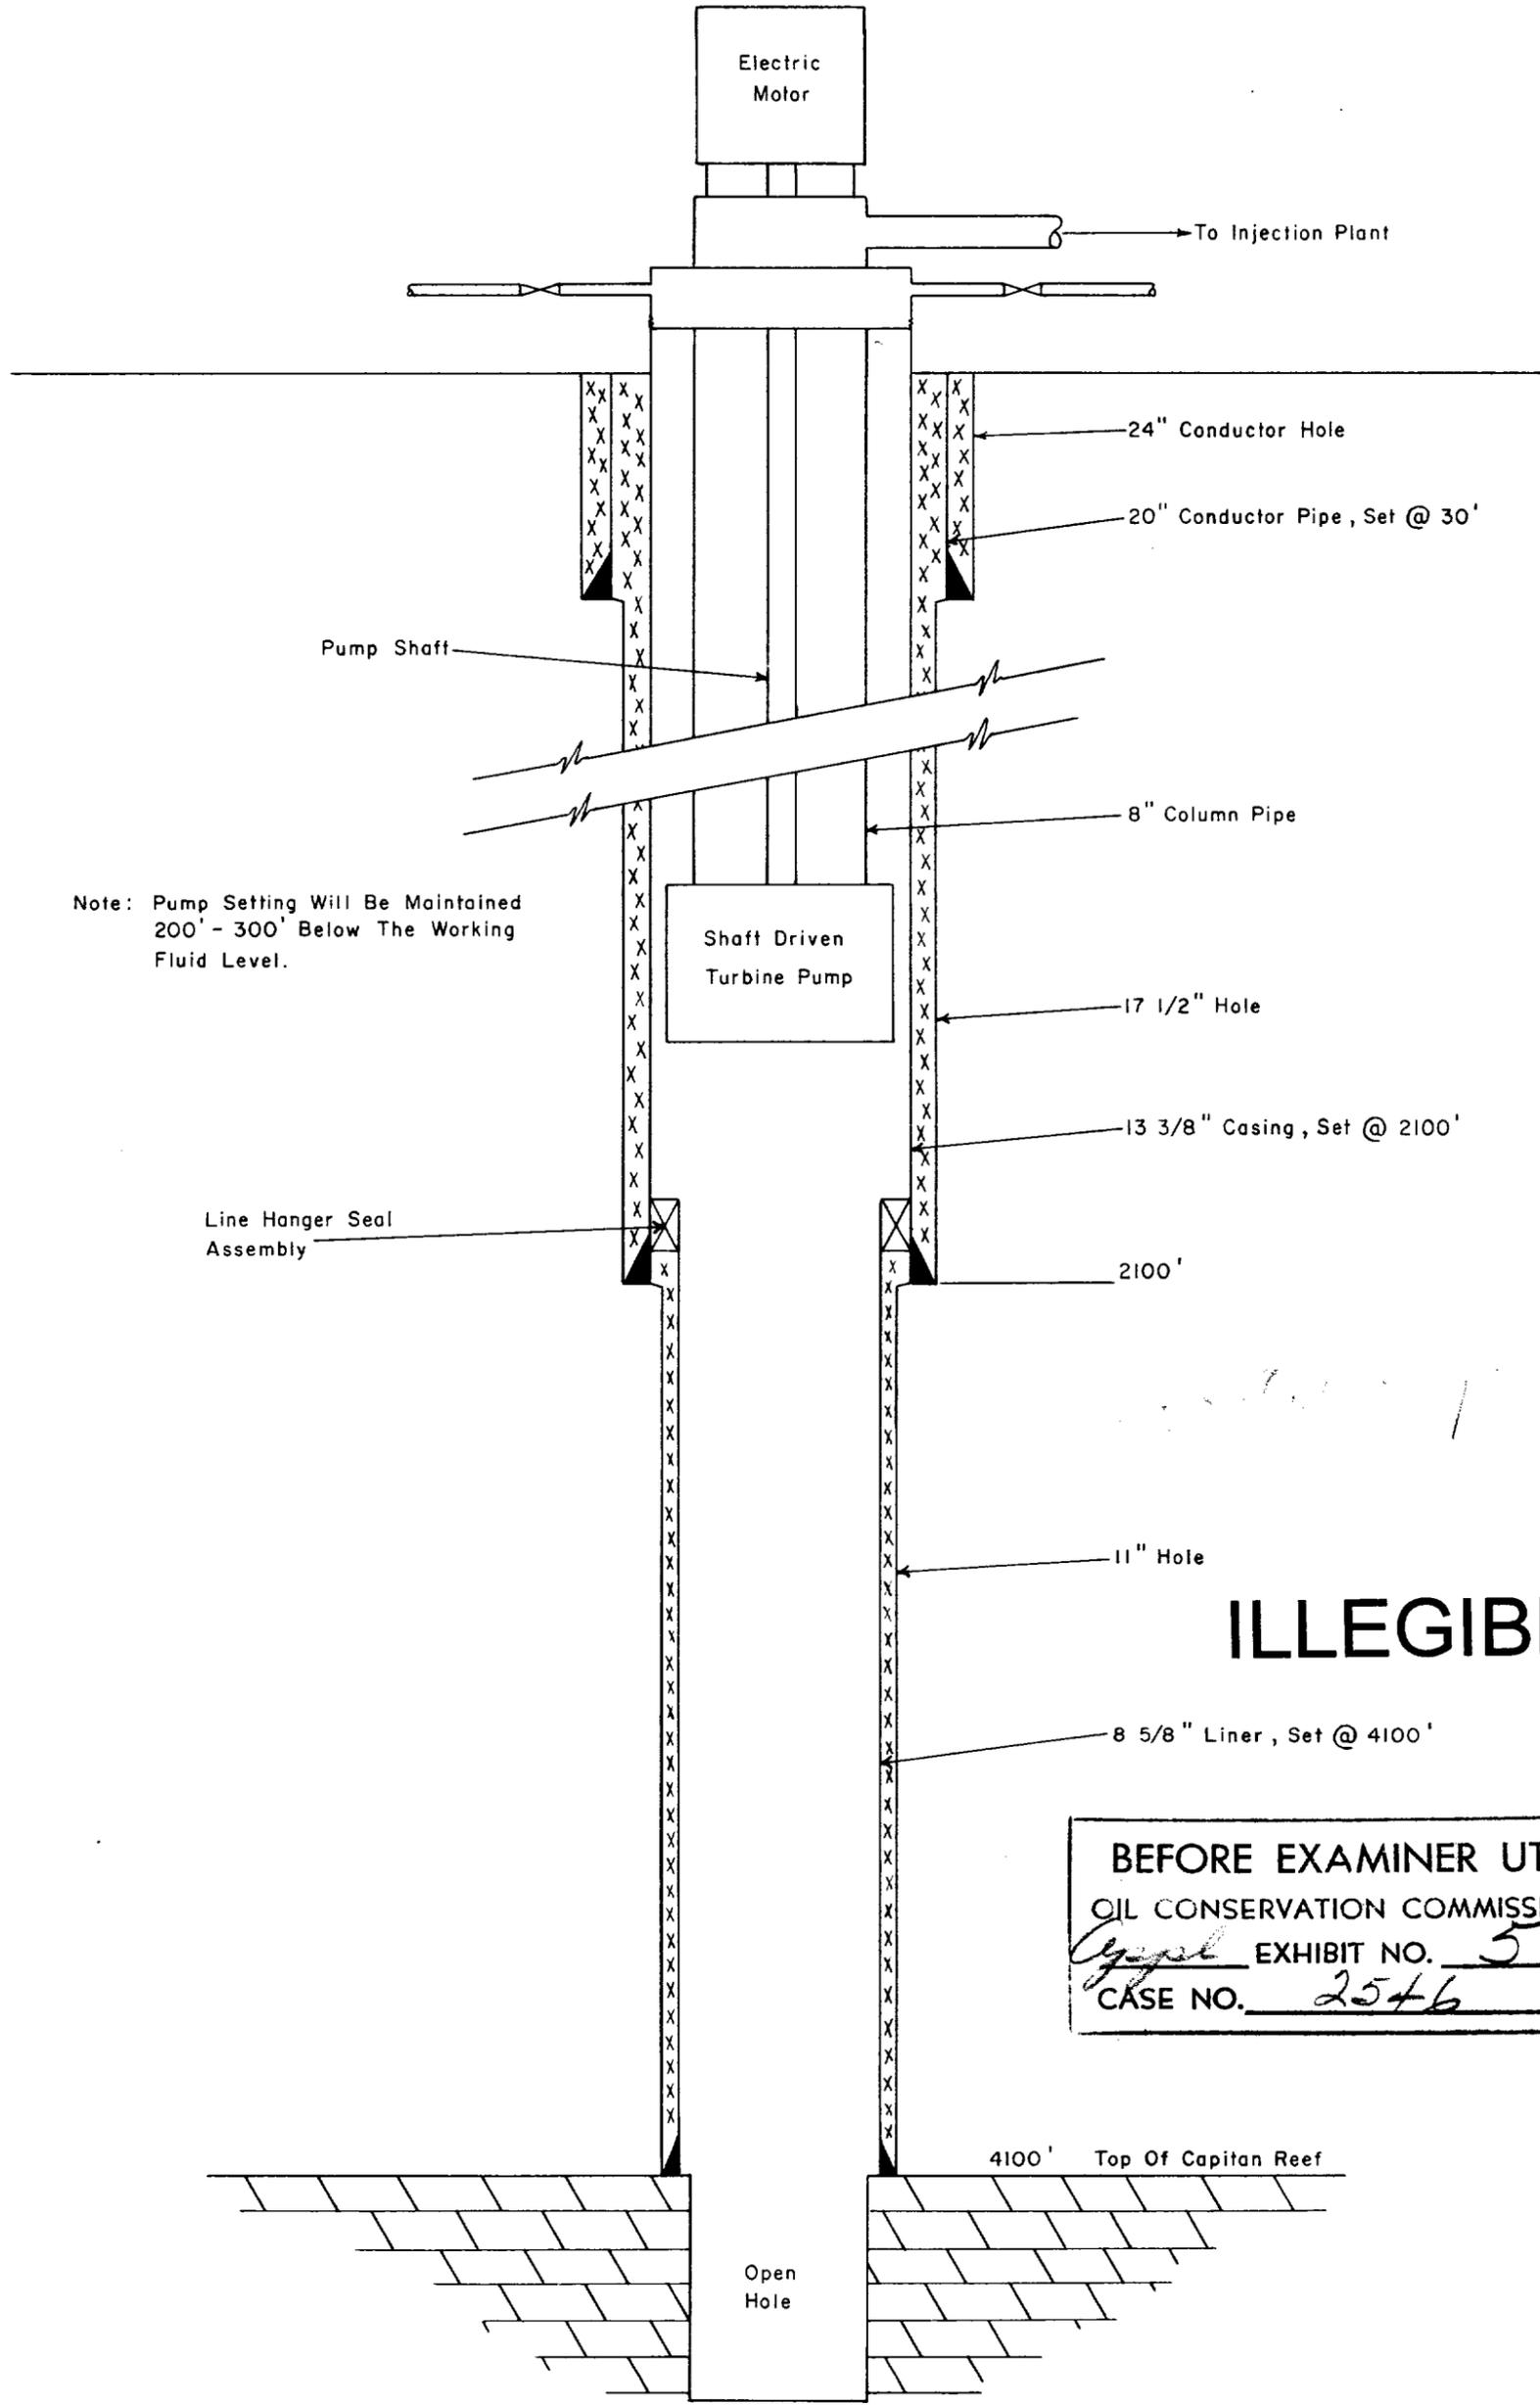


Note: Pump Setting Will Be Maintained  
200' - 300' Below The Working  
Fluid Level.

**ILLEGIBLE**

BEFORE EXAMINER UTZ  
OIL CONSERVATION COMMISSION  
*Copy* EXHIBIT NO. 5  
CASE NO. 2546

# JALMAT (YATES SAND) UNIT

## TYPICAL PRODUCING WELL

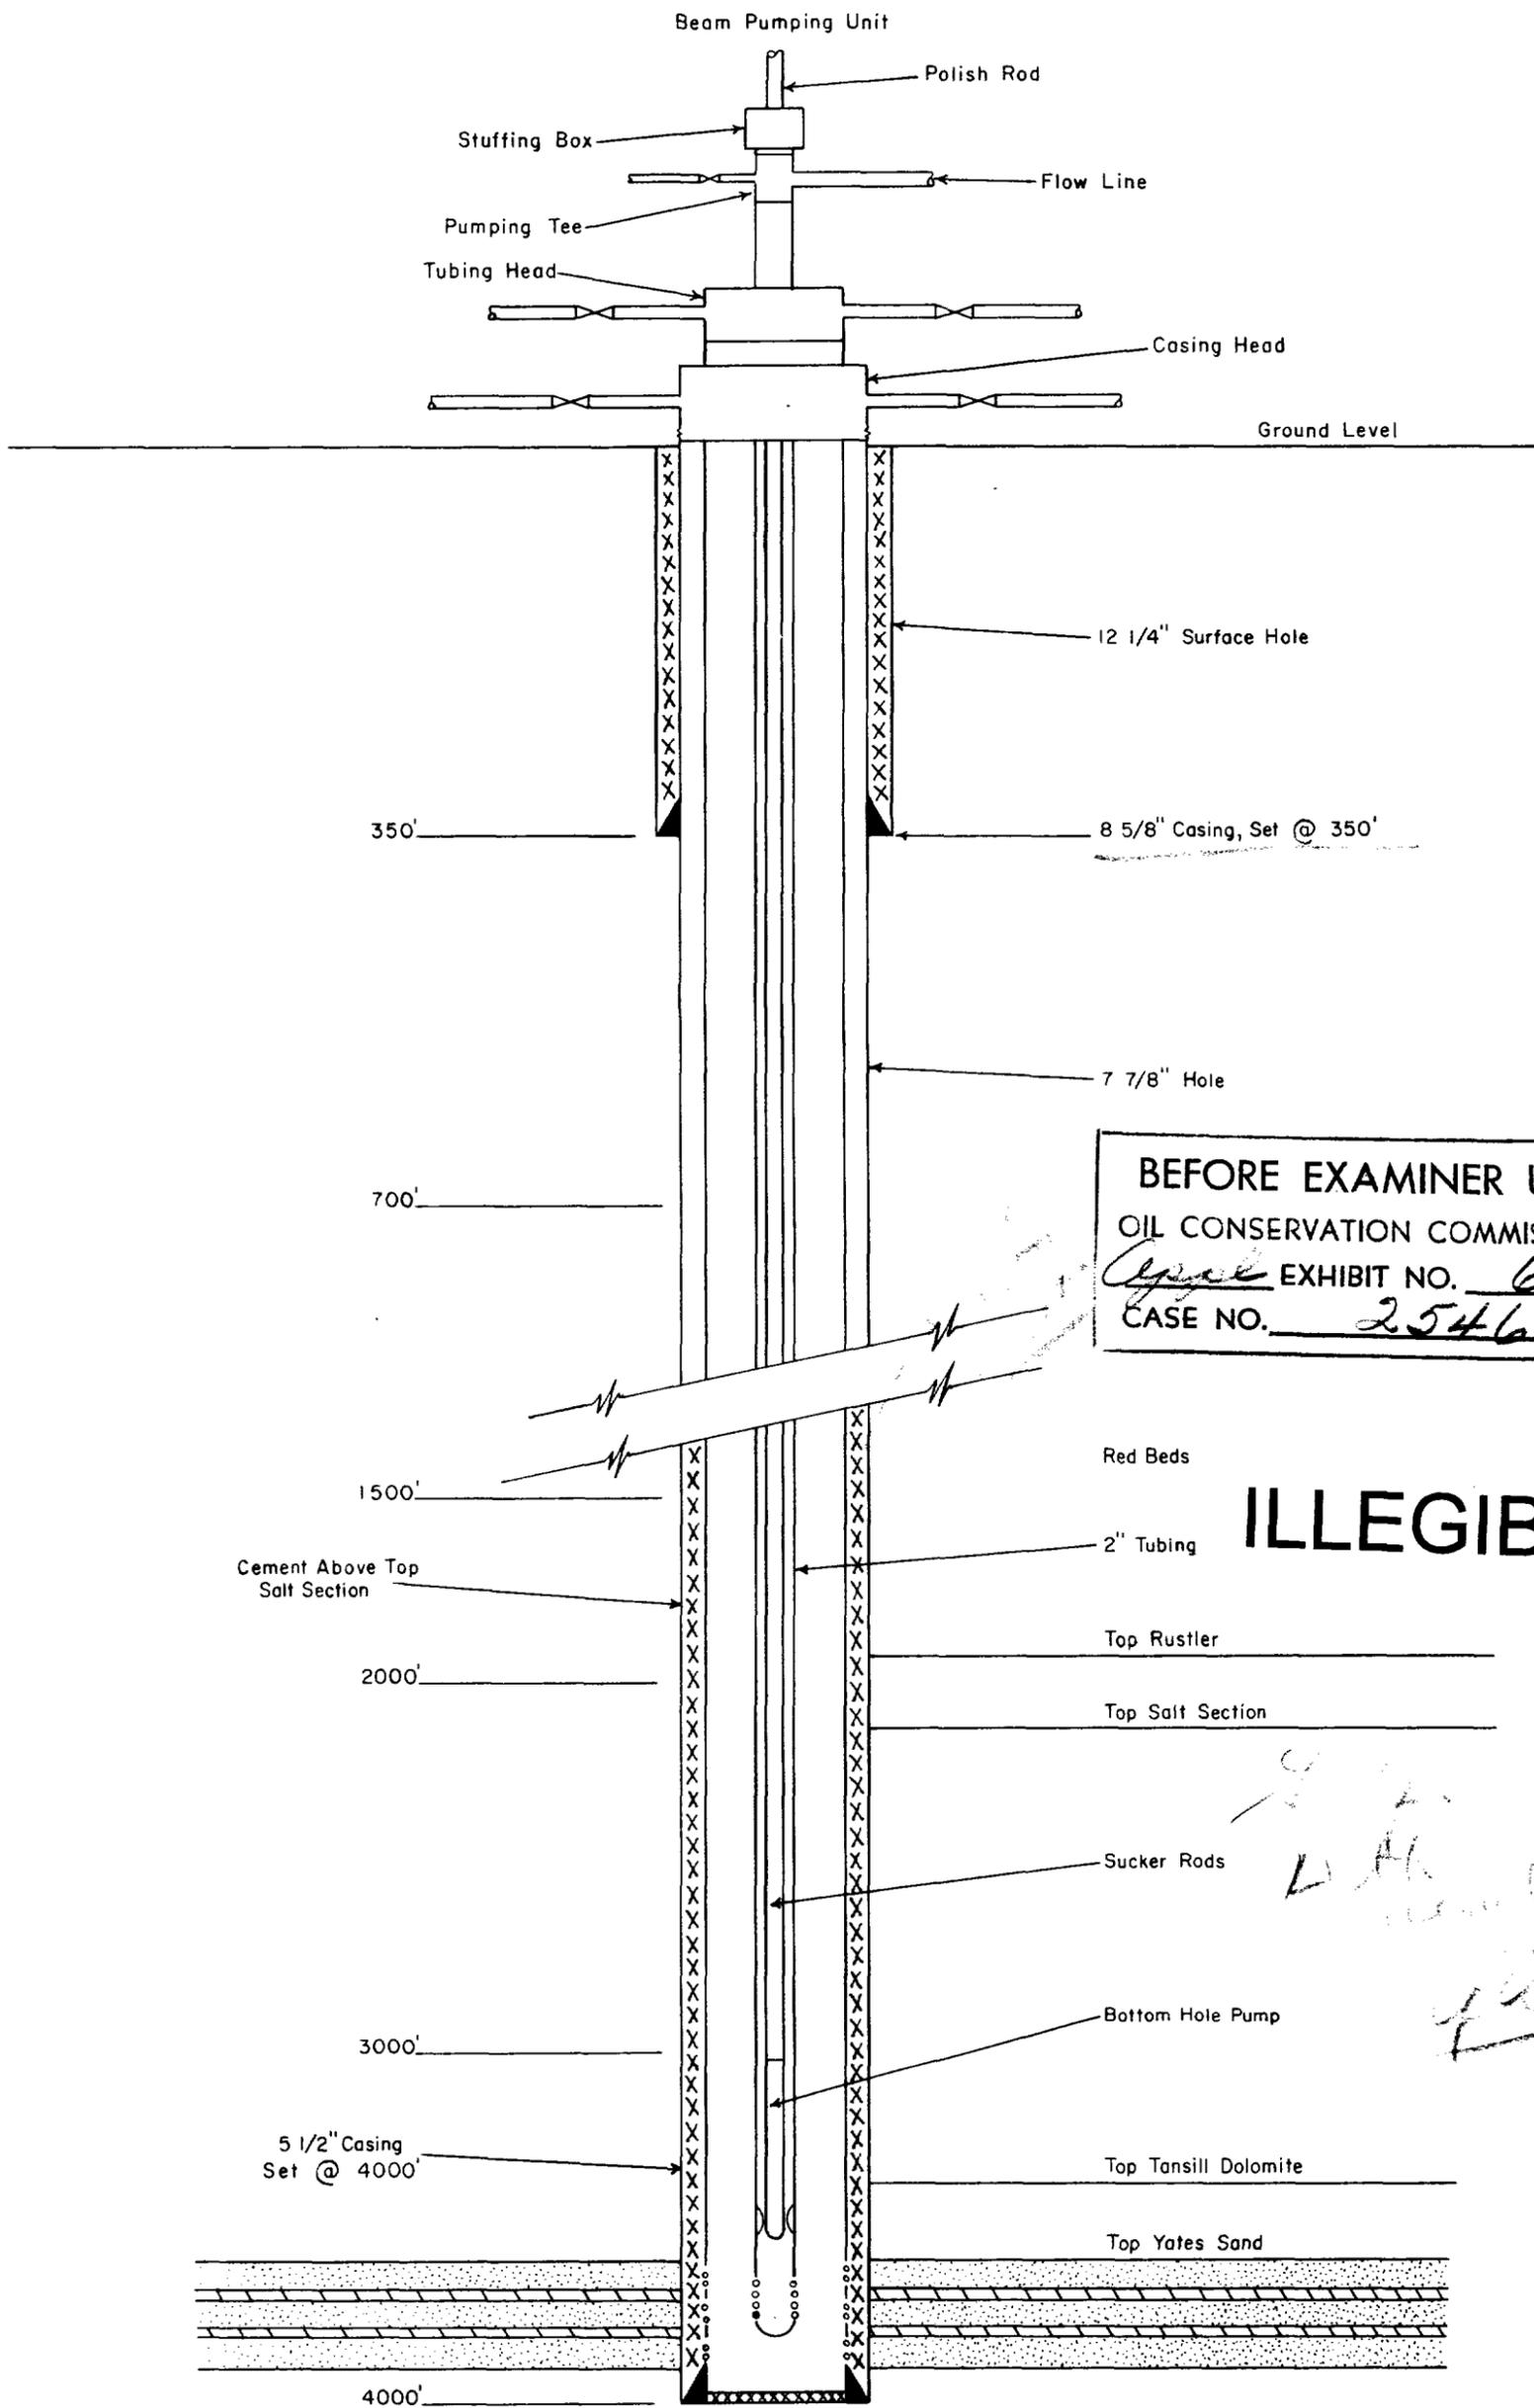

BEFORE EXAMINER UTZ  
 OIL CONSERVATION COMMISSION  
 EXHIBIT NO. 6  
 CASE NO. 2546

ILLEGIBLE

JALMAT (YATES SAND) UNIT  
SCHEMATIC OF TYPICAL INJECTION WELL

BEFORE EXAMINER UTZ  
OIL CONSERVATION COMMISSION  
*Appl* EXHIBIT NO. 7  
CASE NO. 2546

