


EXHIBIT "B"
 SCHEMATIC DIAGRAM
 OF COMMINGLING FACILITIES
 NORTH WILSON DEEP UNIT No. 1

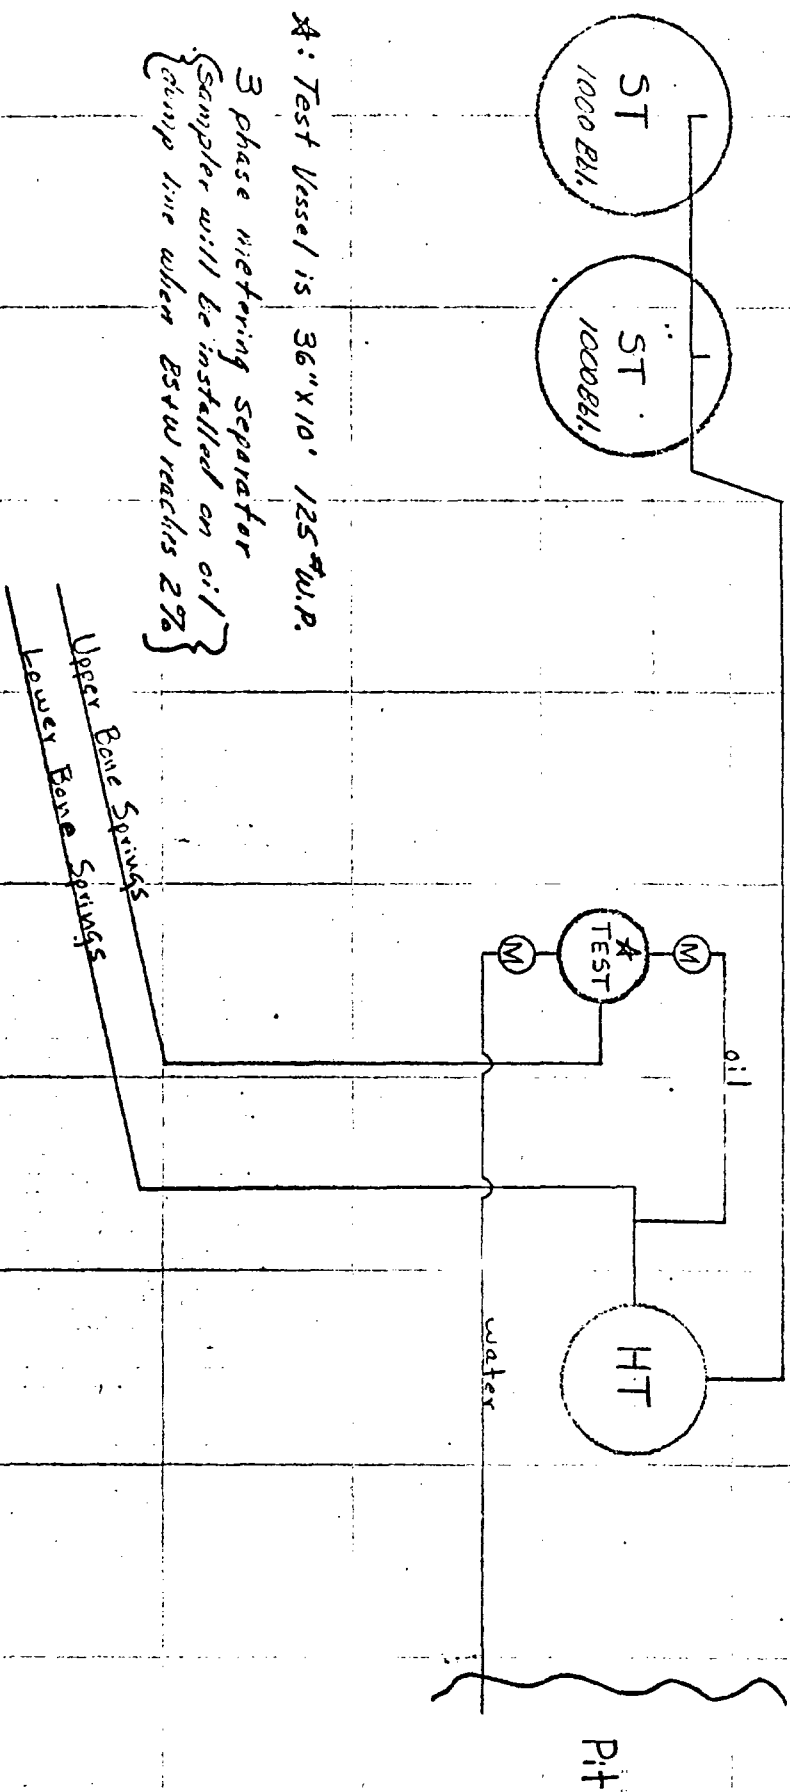

*: Test Vessel is 36" x 10' 125 W.P.
 3 phase metering separator
 { Sampler will be installed on oil }
 { Pump line when BSVU reaches 27% }

Waco 3091