


10/20/2020

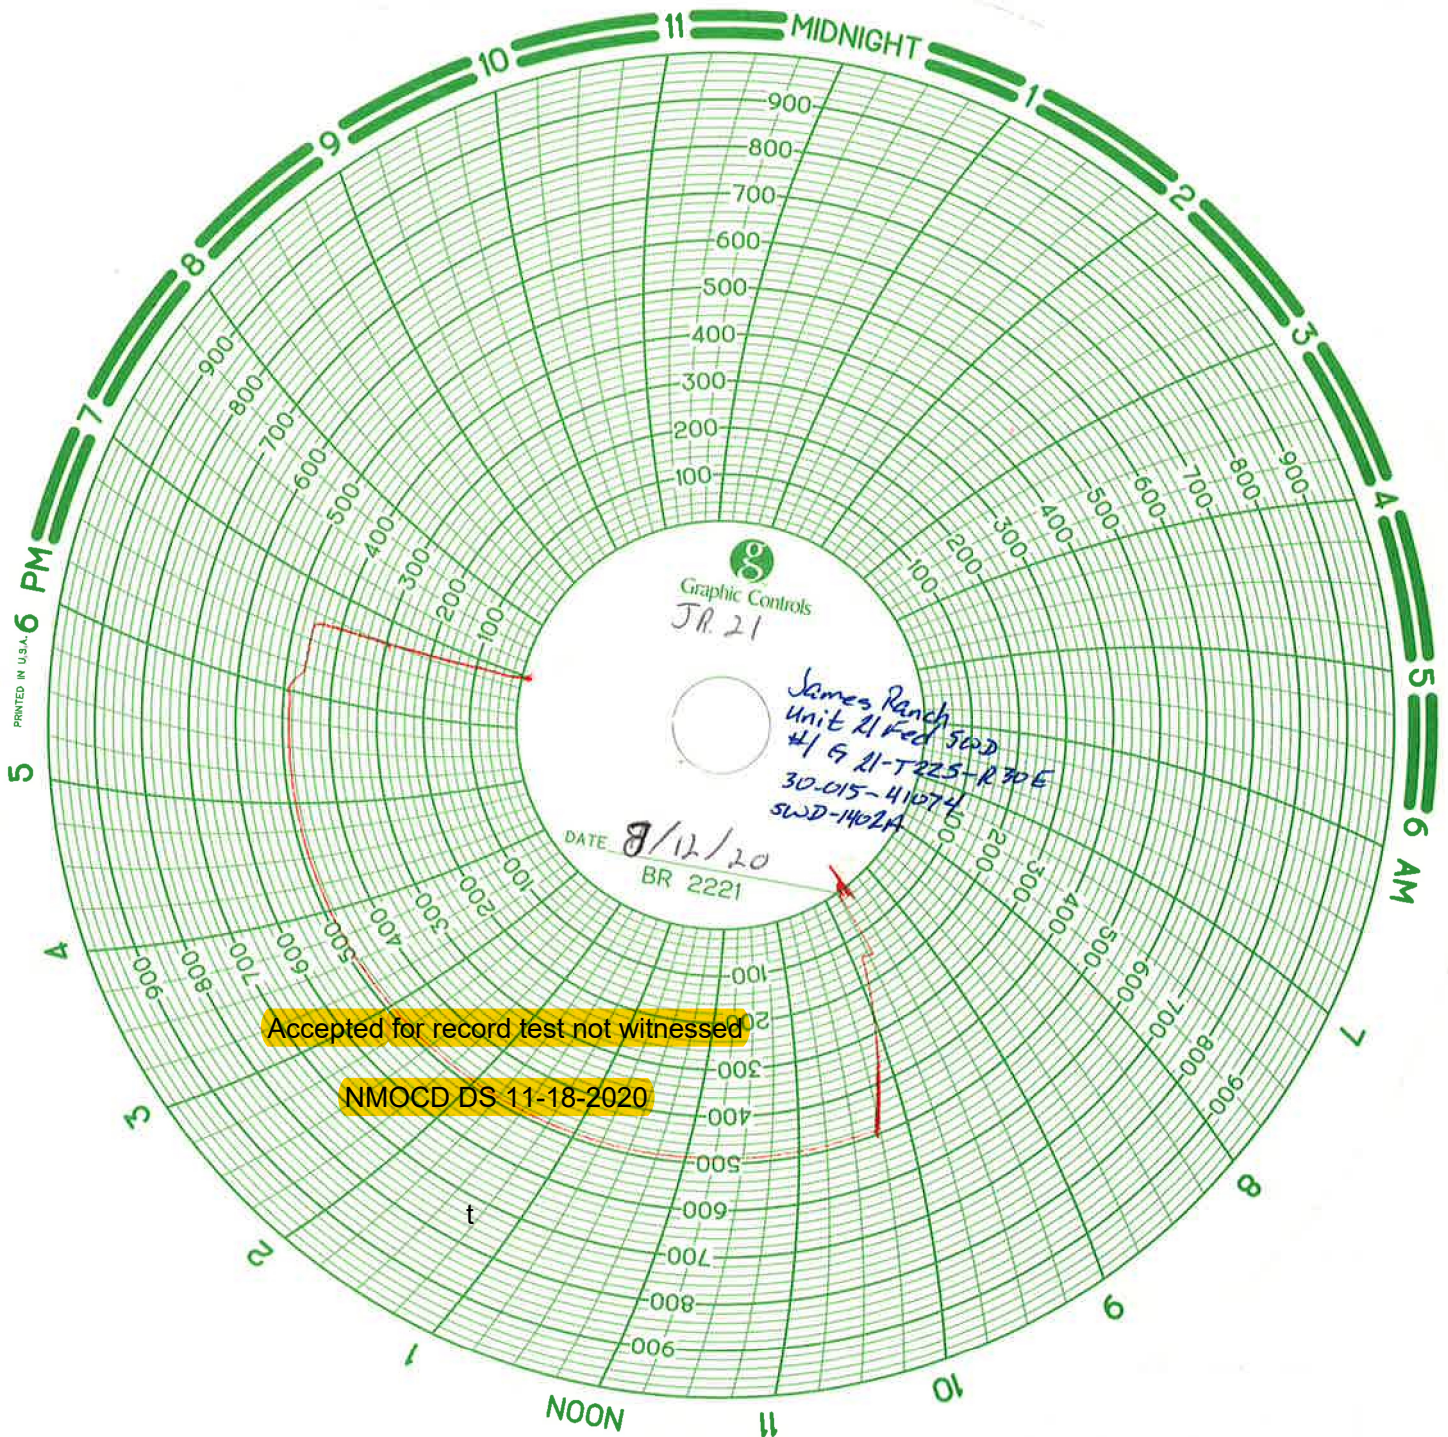

SR 21
James Ranch
unit
21

Louis Stephens

XTO operator.

XTO energy

Starting PSI 0

Ending PSI 0 (After bleed off)

Test For 30 min

Start 9:45 AM

End 10:15 AM

Wip
Henderson
8-12-20

Calibrated
Set # 0584
5/13/20