


CLIFFORD CONE D.G. CPT-
 CULWIN QUEEN UNIT- WELL #13.
 WATER INJECTION RATES & PRESSURES
 FOR "STEP-RATE" TEST.

Eddy Co. Shimpert Field.

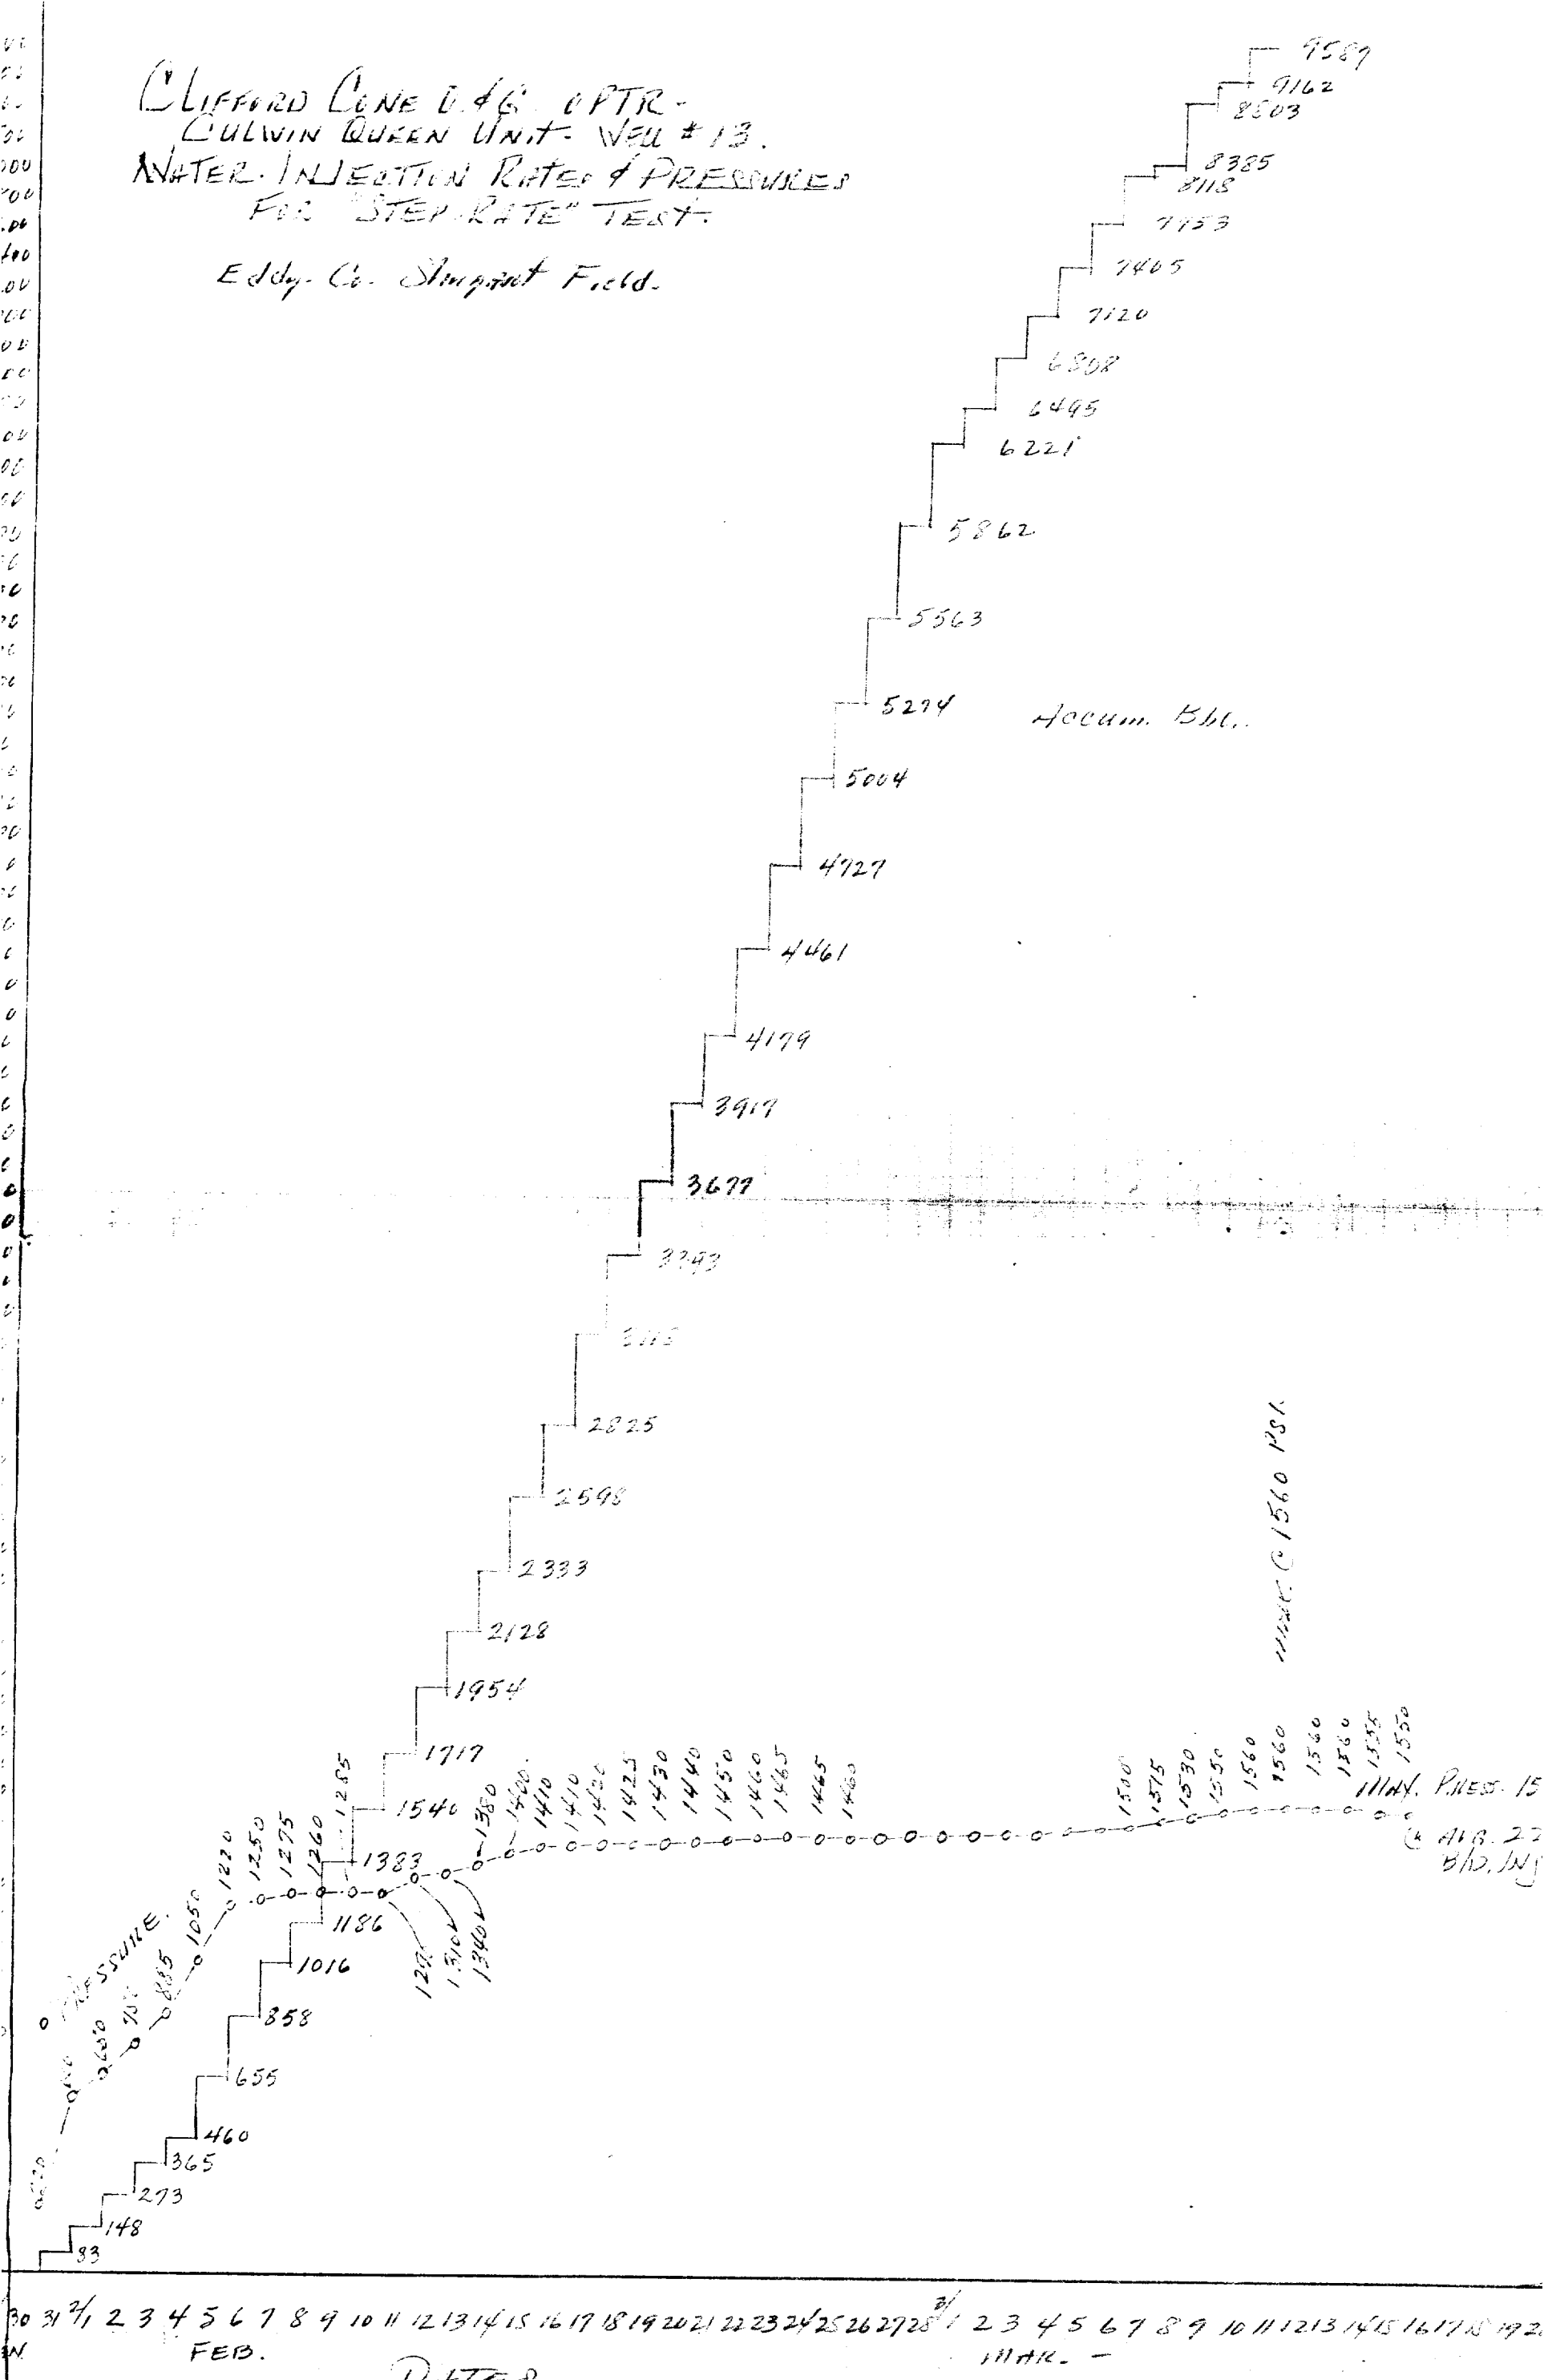

30 31 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20
 FEB. MAR. -
 DATED -