


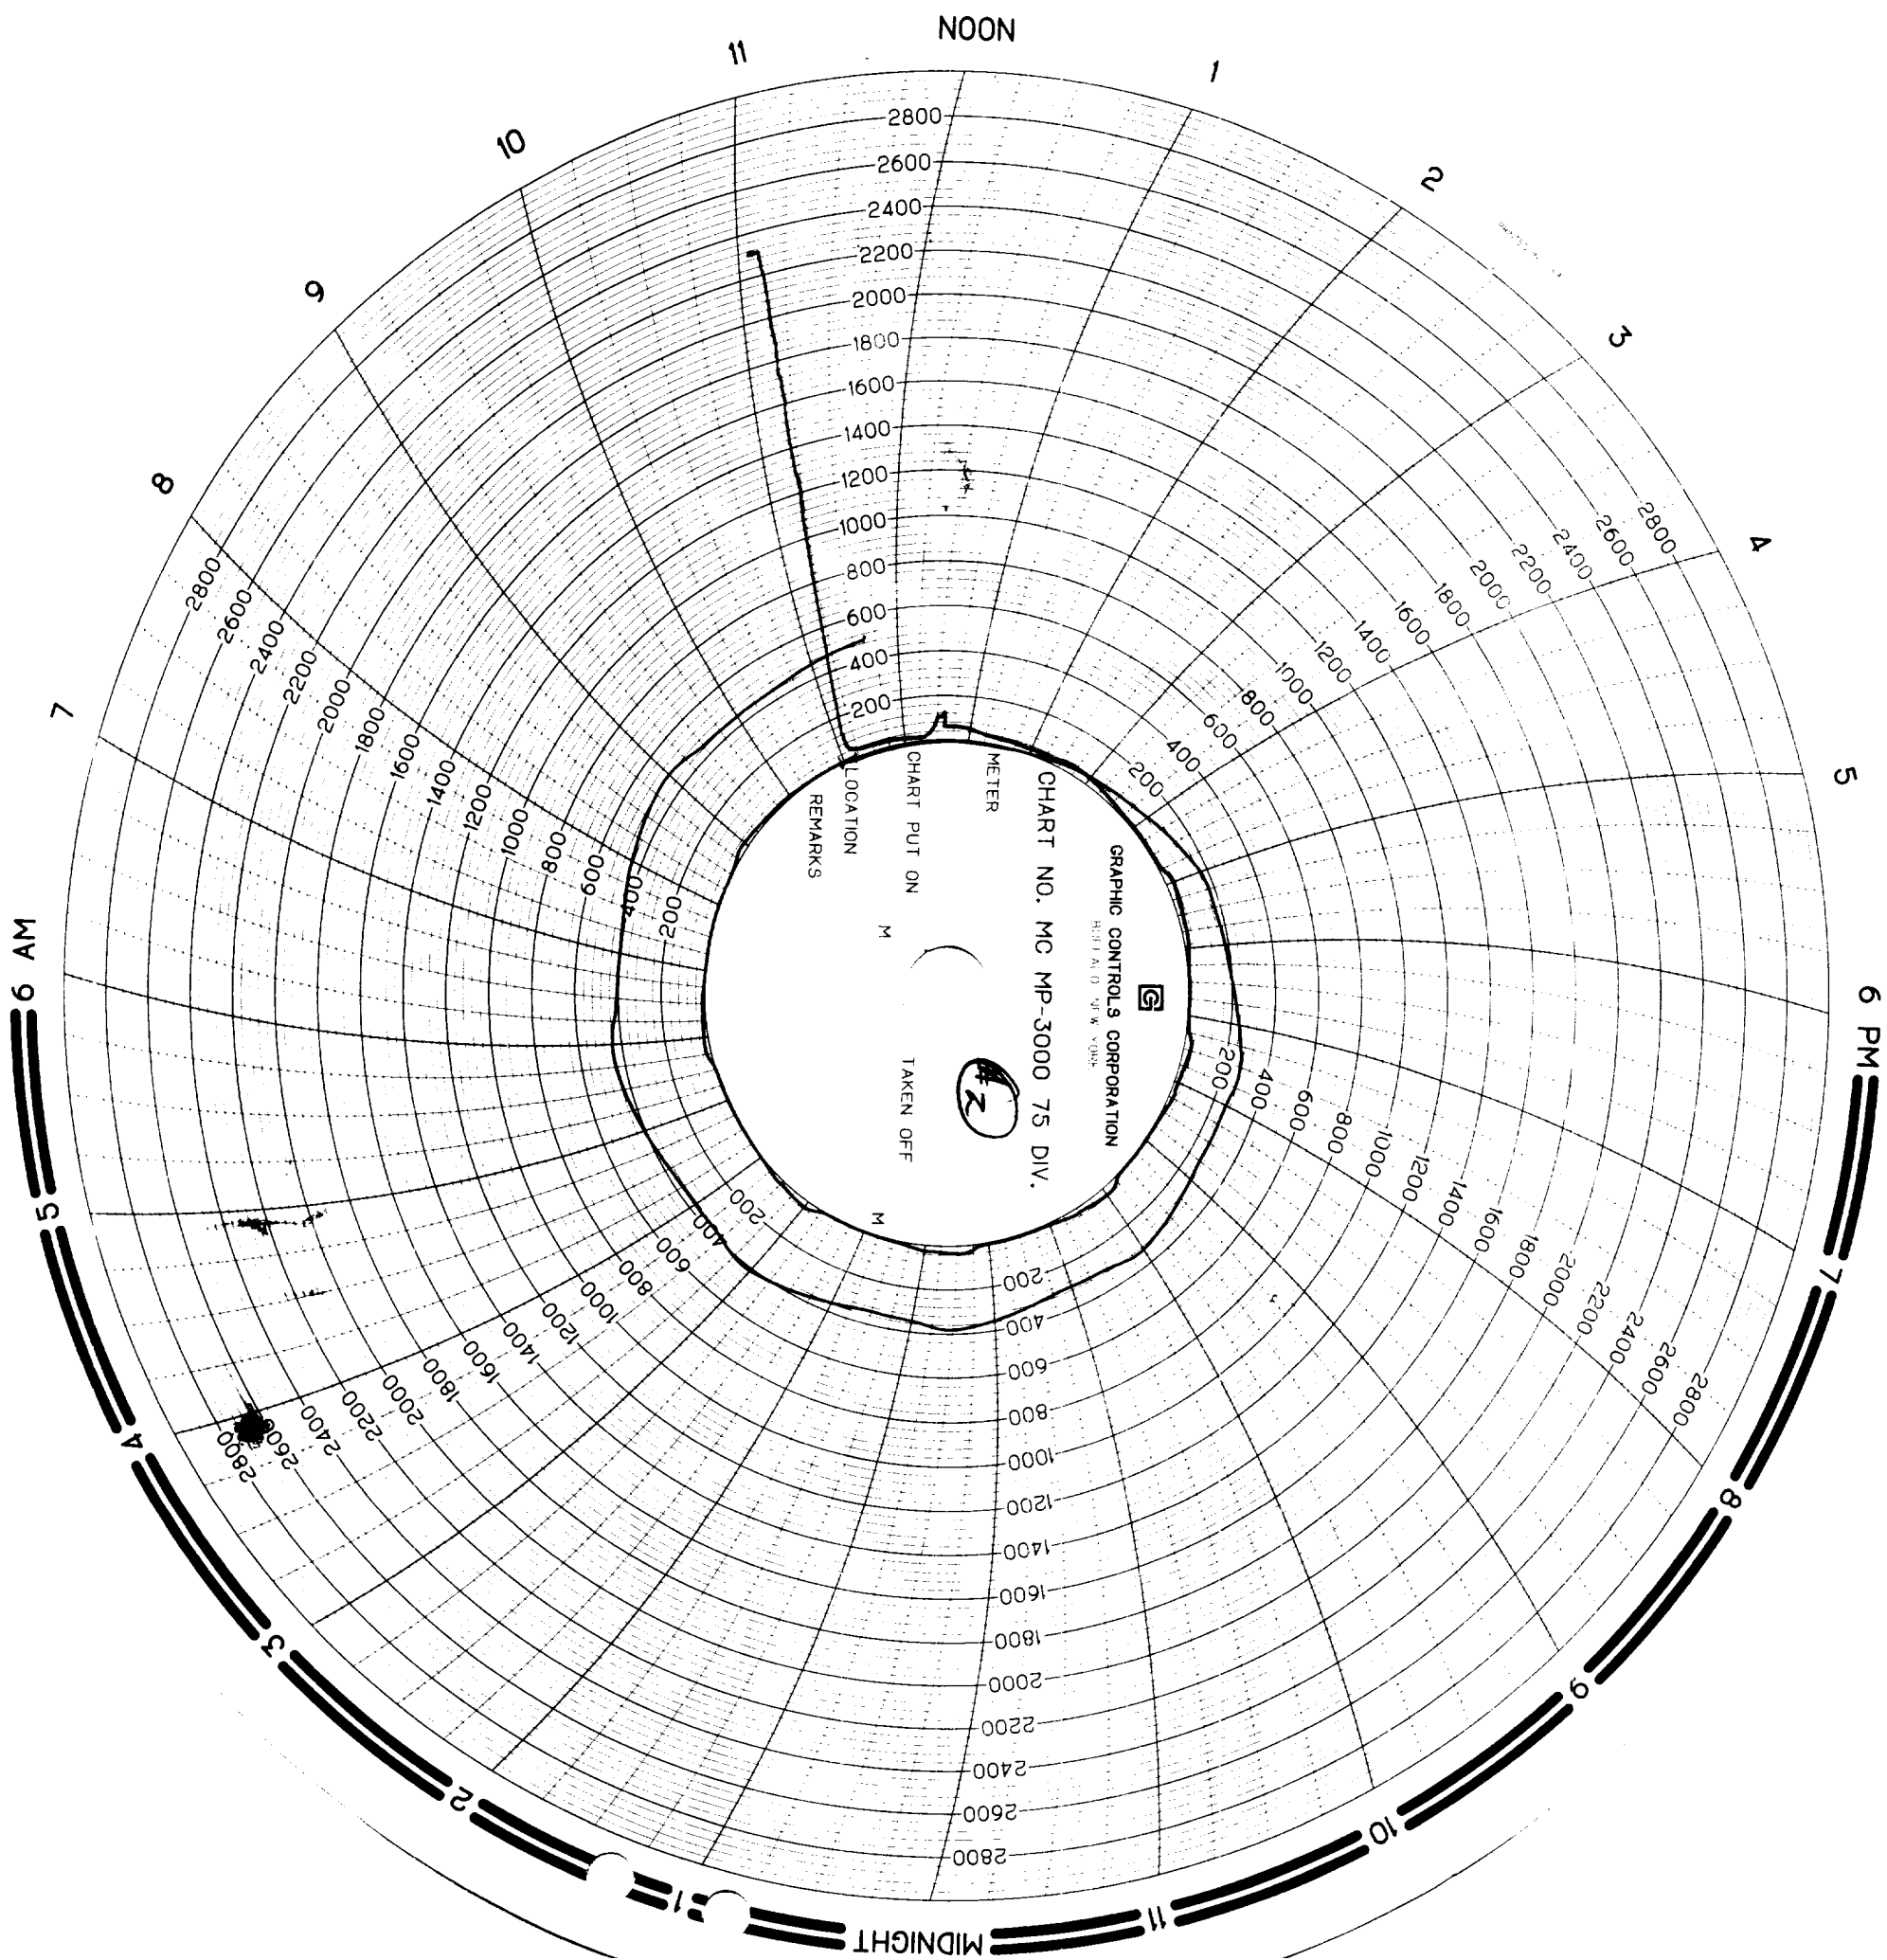

JMC PET.  
PARKWAY WEST #1  
PACKER LEAKAGE TEST  
RED: STRAWN  
BLUE: ATOKA  
CHART ON: 9/10/91 11:00A  
OFF: 9/11/91 11:30A  
FLOW STRAWN 74 hrs.  
(#2)

RECEIVED  
OCT 21 1991  
O. C. D.  
ARTESIA OFFICE