


1	1" SCH 40
2	1" ANSI 300
3	1" ANSI 150
4	1" ANSI 300
5	1" SCH 40 TE
6	2" SCH 40 TE
7	2" SCH 40 EL
8	2" Weld Neck
9	2" ANSI 300
10	2" ANSI 150
11	2" ANSI 300
12	2" ANSI 150
13	2" SCH 40 E
14	2" F-2500
15	2" METER RUN
16	3" ANSI 300
17	3" SCH 40
18	3" ANSI 150
19	3" ANSI 150
20	1/2" ANSI 150
21	2" X 1" SCH 40
22	3" X 2" SCH 40
23	2" X 3" SCH 40
24	1" X 3" SCH 40

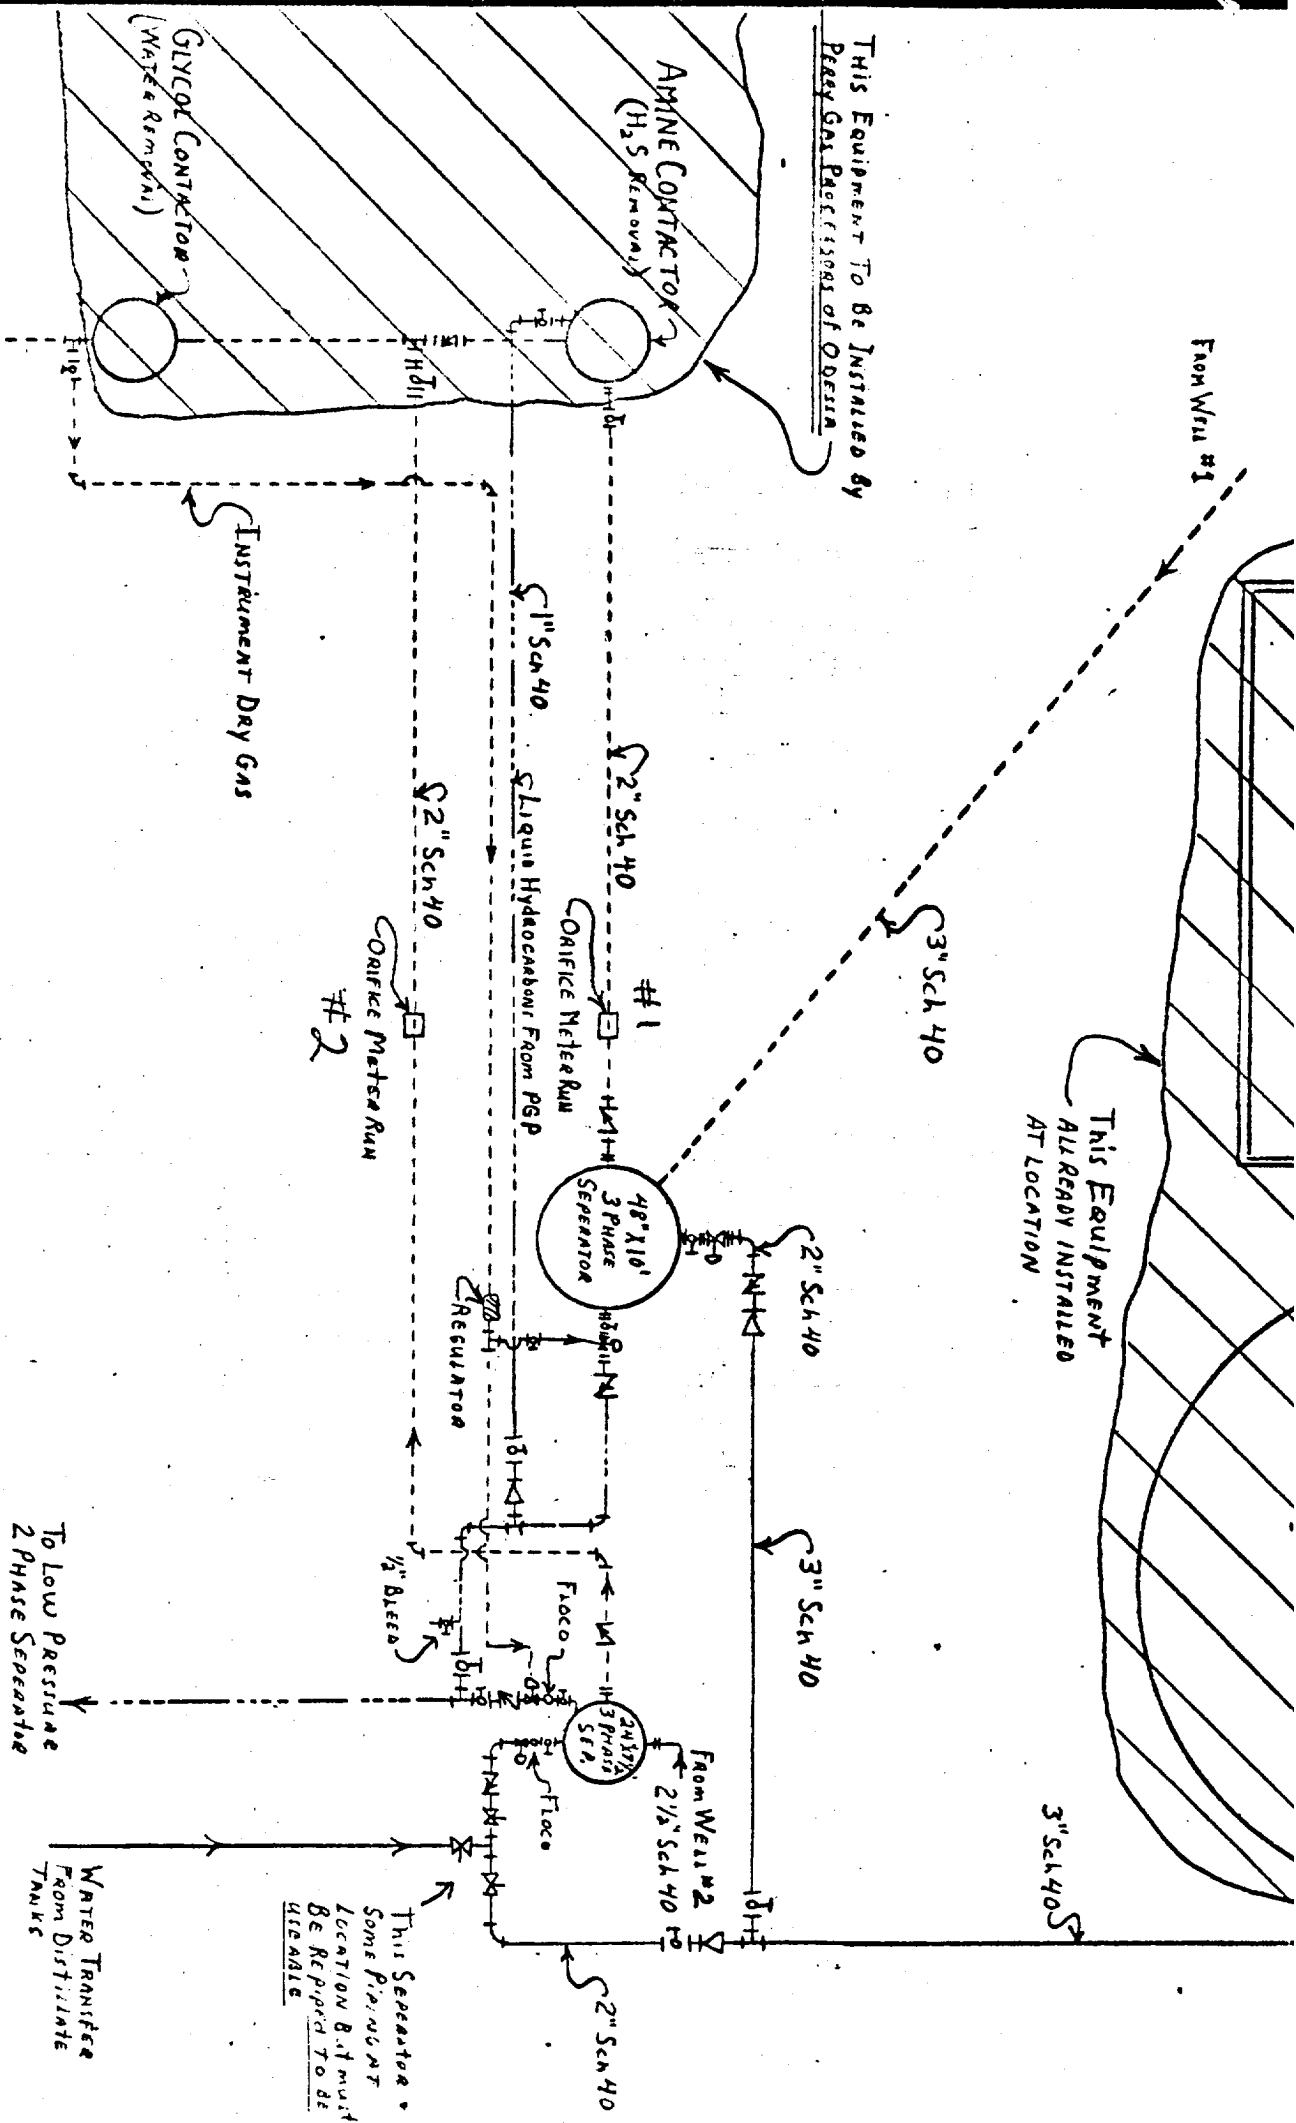

THIS EQUIPMENT TO BE INSTALLED BY
PERRY GAS PROJECTIONS OF OGDEN

THIS EQUIPMENT
ALREADY INSTALLED
AT LOCATION

THIS SEPARATOR -
SOME PERMANENT
LOCATION BUT MUST
BE REPLACED TO BE
USABLE

OIL LINES ———
GAS LINES - - - - -
WATER LINES ———

Screwed Connections — + —
FLANGED CONNECTIONS — H —

To Southern Union Gas Co.
MASTER RUN

To Low Pressure
2 PHASE Separator

WATER TRANSFER
FROM DISTILLATE
TANK

DATE: MARCH 3, 1976
DRAWN BY: R. Farnio
DESIGN BY: R. Farnio
CHECKED BY:

TITLE: LEVERS FEDERAL ADDITION OF TR
PRODUCTION DEPT.

