


2,000 PSI ANNULAR PREVENTOR MAY BE
SUBSTITUTED FOR DOUBLE GATE PREVENTOR

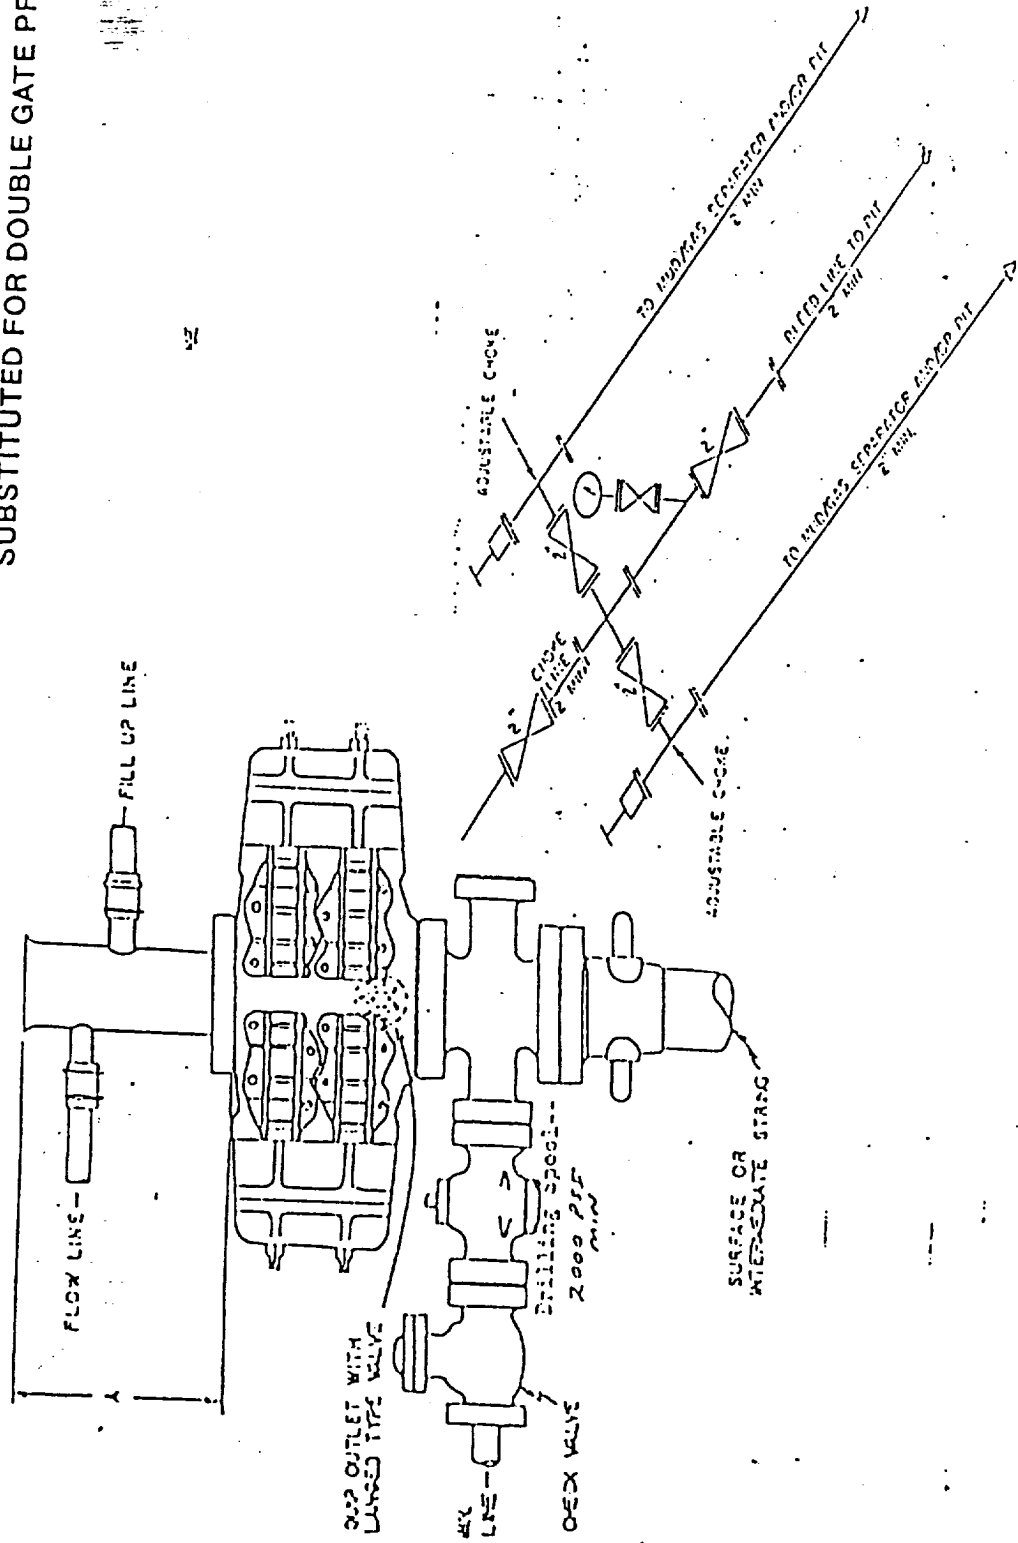

2M CHOKES MANIFOLD EQUIPMENT — CONFIGURATION MAY VARY

BLOWOUT PREVENTER

9-10 inch 2000 psi minimum