


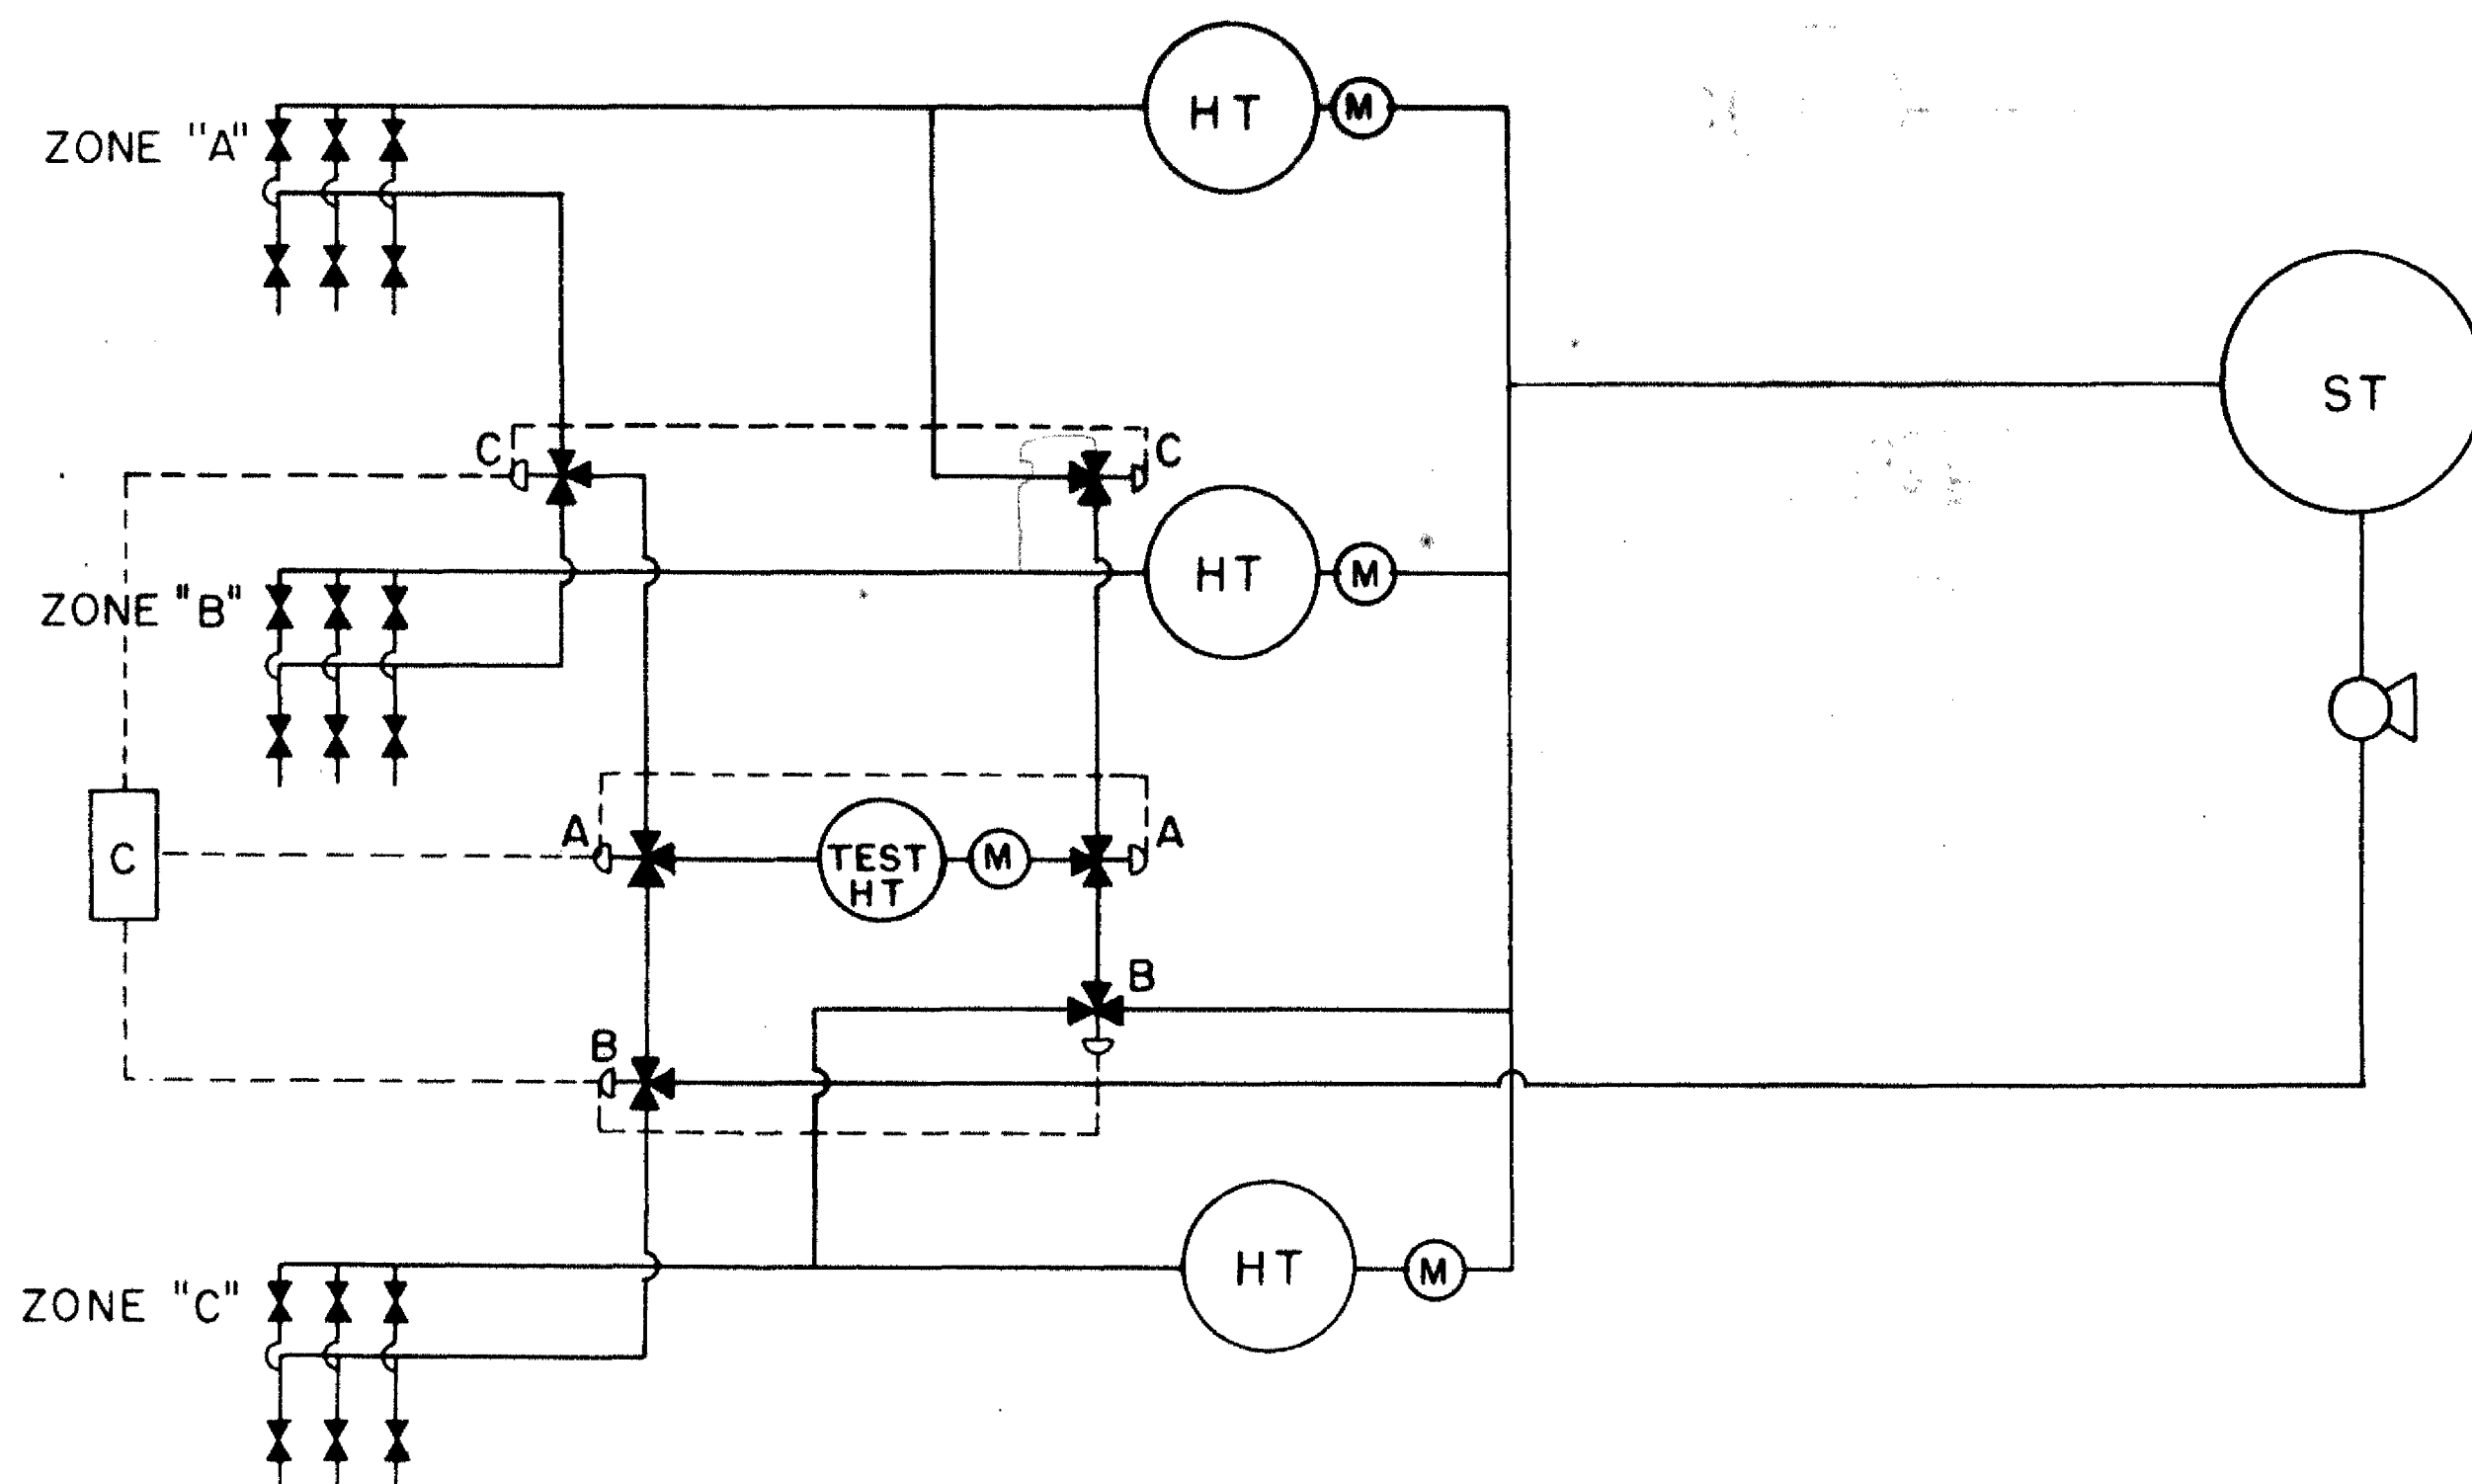

SYMBOLS

-  CHECK VALVE
-  BLOCK VALVE
-  2 WAY VALVE
-  3 WAY VALVE (PNEUMATIC OR ELECTRICALLY CONTROLLED)
-  CONTROL PANEL (PNEUMATIC OR ELECTRICAL)
-  ORIFICE METER
-  LIQUIDS METER
-  TESTING VESSEL (HEAT-TREATER OR SEPARATOR)
-  HEATER-TREATER
-  POWER OIL TANK
-  STOCK TANK
-  PUMP
-  SAMPLER
-  SEPARATOR

BAO OIL RETURN (ALTERNATE NO. 2) WHEN TEST TREATER IS INSTALLED		
NEW MEXICO OIL CONSERVATION COMMISSION COMMITTEE ON COMINGLING		
DRAWN: H M S APPROVED: _____ REVISED: _____ APPROVED: _____	DATE: 5-4-61 _____ _____ _____	DWG. NO. A-8