

State of New Mexico  
Energy, Minerals and Natural Resources Department

---

Susana Martinez  
Governor

David Martin  
Cabinet Secretary

Brett F. Woods, Ph.D.  
Deputy Cabinet Secretary

David R. Catanach, Division Director  
Oil Conservation Division



NOVEMBER 5, 2015

Julie W. Gutiérrez  
Geolex, Inc.<sup>®</sup>  
500 Marquette Avenue, NW Suite 1350  
Albuquerque, NM 87102

RE: Frontier Field Services, LLC Maljamar Gas Processing Plant and Maljamar AGI Facility (H2S-044): H2S Contingency Plan (Revised October 28, 2015) Section 21, Township 17 South, Range 32 East in Lea County, New Mexico

Dear Mrs. Gutiérrez:

The Oil Conservation Division (OCD) is in receipt of Frontier Field Services, LLC's "Maljamar Gas Processing Plant and Maljamar AGI Facility" H2S Contingency Plan".

OCD has completed its review of the revised plan and finds that it appears to meet the intent of the OCD Hydrogen Sulfide Gas Regulations (19.15.11 NMAC). Therefore, OCD hereby **accepts** the plan for record.

*Please be advised that OCD approval of this plan does not relieve Frontier Field Services, LLC of responsibility should its operations fail to adequately detect, investigate, and/or undertake corrective actions to prevent or stop a hydrogen sulfide release(s) that may pose a threat to groundwater, surface water, human health, public safety or the environment. In addition, OCD approval does not relieve Frontier Field Services, LLC of responsibility for compliance with any other federal, state, or local laws and/or regulations.*

If you have any questions, please contact Carl Chavez of my staff at (505) 476-3490, mail at the address below, or email at [CarlJ.Chavez@state.nm.us](mailto:CarlJ.Chavez@state.nm.us). Thank you.

Sincerely,

Jim Griswold  
Environmental Bureau Chief

JG/cjc

cc: OCD Hobbs District Office

## Chavez, Carl J, EMNRD

---

**From:** Julie W. Gutierrez <jwg@geolex.com>  
**Sent:** Thursday, November 05, 2015 12:42 PM  
**To:** Chavez, Carl J, EMNRD  
**Subject:** RE: Amendment to Maljamar H2S Contingency Plan  
**Attachments:** Amended Frontier Maljamar Revised Rule 11 after OCD Review.pdf

Good afternoon, Carl.

I am attaching the latest version of the plan which addresses the issues you outlined below.

Let me know if you have any additional questions/comments.

Best regards,

Julie

Julie W. Gutiérrez  
**Geolex, Inc<sup>®</sup>**  
500 Marquette Avenue, NW Suite 1350  
Albuquerque, NM 87102  
505-842-8000 Ext. 101  
505-842-7380 Fax

### PRIVILEGED & CONFIDENTIAL

This message and attachment(s) contain confidential information belonging to the sender which is intended for the sole use of the individual(s) or entity named above. If you receive this message in error, you are hereby notified that any disclosure, copying, distribution, resending, forwarding or taking of any action in reliance on the contents of this email and/or any attachment(s) is strictly prohibited. If you have received this message in error, please notify the sender via return email and permanently delete this message and any attachment(s) from any computer(s).

---

**From:** Chavez, Carl J, EMNRD [mailto:CarlJ.Chavez@state.nm.us]  
**Sent:** Thursday, October 29, 2015 11:20 AM  
**To:** jwg@geolex.com  
**Subject:** RE: Amendment to Maljamar H2S Contingency Plan

Julie:

Good morning. Looks like OCD will need to issue another letter. OCD is not sure referencing it as "Amendment No. 1" will work. Perhaps a new date on the H2S CP to reflect the most current version will work with your cover letter?

Based on the situation, and OCD recommended revisions below, OCD also recommends that HollyFrontier notify or inform operators feeding into the gas gathering line upstream of the Conoco Playa Lake Park to review the OCD Regulations, i.e., 19.15.11 NMAC (Hydrogen Sulfide Gas) to ensure they are in compliance with New Mexico Regulations.



# **H<sub>2</sub>S Contingency Plan**

**Frontier Maljamar Gas Processing Plant  
and  
Maljamar AGI Facility  
1001 Conoco Road  
PO Box 7  
Maljamar, NM 88264**

**Approved by NM OCD  
October 6, 2015**

**Revised October 28, 2015**

## **TABLE OF CONTENTS**

	<b><u>Page</u></b>
<b>I. INTRODUCTION</b>	
[API RP-55 7.1].....	1
<b>II. SCOPE</b>	
[API RP-55 7.2].....	1
<b>III. PLAN AVAILABILITY</b>	
[API RP-55 7.3].....	2
<b>IV. EMERGENCY PROCEDURES.....</b>	2
[NMAC 19.15.11.9.B(2)(a)][API RP-55 7.4 A.] [NMAC 19.15.11.12.B and D]	
Site Security [NMAC 19.15.11.12.B].....	2
Responsibilities and Duties of Personnel During an Emergency.....	2
Immediate Action Plans.....	3
Telephone Numbers, Communication Methods and Media Site.....	4
Location of Residences, Roads, Businesses, Operators and Medical Facilities.....	4
Evacuation Routes, Emergency Assembly Areas, and Road Block Locations.....	5
Monitoring Equipment, Alarm Systems, Safety Equipment, and Supplies.....	5
Signs and Markers [NMAC 19.15.11.10].....	7
<b>V. CHARACTERISTICS OF HYDROGEN SULFIDE (H<sub>2</sub>S), SULFUR DIOXIDE (SO<sub>2</sub>), AND CARBON DIOXIDE (CO<sub>2</sub>)</b>	
[NMAC 19.15.11.9.B(2)(b)] [API RP-55 7.4 b.].....	8
Hydrogen Sulfide (H <sub>2</sub> S).....	8
Sulfur Dioxide (SO <sub>2</sub> ).....	9
Carbon Dioxide (CO <sub>2</sub> ).....	10
<b>VI. RADII OF EXPOSURE [NMAC 19.15.11.7K].....</b>	11
<b>VII. FACILITY DESCRIPTION, MAPS AND DRAWINGS [NMAC 19.15.11.9.B(2)(c)]</b>	
[API RP-55 7.4 c.].....	11
Description of Plant Operation.....	11
Description of AGI Facility Operation.....	11
Maps of Plant and AGI Facility.....	12
<b>VIII. TRAINING AND DRILLS</b>	
[NMAC 19.15.11.9.B(2)(d)][API RP-55 7.4 d.].....	12
Responsibilities and Duties of Essential Personnel.....	12
On-Site or Classroom Emergency Response Drills.....	12
Notification and Training of Others on Protective Measures in Emergency Situations.....	13
Training and Attendance Documentation.....	13
Briefing of Public Officials on Evacuation and Shelter in Place Plans.....	13

<b>IX. COORDINATION WITH STATE EMERGENCY PLANS</b>	
[NMAC 19.15.11.9.B(2)(e) NOTIFICATIONS AND REPORTS].....	14
National Response Center (NRC).....	14
New Mexico Oil Conservation Division (OCD).....	14
New Mexico State Police/Hazardous Materials Emergency Response Plan.....	14
Bureau of Land Management (BLM).....	14
Local Emergency Planning Committee (LEPC).....	14
<b>X. PLAN ACTIVATION AND EVENTS THAT COULD LEAD TO A RELEASE</b>	
[NMAC 19.15.11.9.C][API RP-55 7.4 d.].....	14
Activation Levels.....	14
Level 1.....	14
Level 2.....	15
Events that Could Lead to an H <sub>2</sub> S Release.....	15
<b>XI. SUBMISSION AND RETENTION OF CONTINGENCY PLAN</b>	
[NMAC 19.15.11.9.D].....	15
Submission.....	15
Retention.....	15
Revisions.....	15
Annual Inventory .....	15

## FIGURES

- Figure 1: Location of Maljamar Plant and AGI Facility**
- Figure 2a: Locations of Maljamar AGI #1 and Maljamar AGI #2**
- Figure 2b: Location of Maljamar AGI #1 and Maljamar AGI #2 (7.5 Min Topo)**
- Figure 3: Alarm, Monitor and Safety Equipment Locations**
- Figure 4a: 500 and 100 PPM H<sub>2</sub>S ROE Map, Roadblocks, Evacuation Routes and Emergency Assembly Area Locations**
- Figure 4b: Detail of 100 PPM H<sub>2</sub>S ROE Map, Roadblocks, Evacuation Routes and Emergency Assembly Area Locations**
- Figure 5a: Schematic of AGI #1 Design**
- Figure 5b: Schematic of AGI #2 Design**
- Figure 6: Schematic of Maljamar AGI Well Facility**
- Figure 7a: Gathering System for Maljamar Plant**
- Figure 7b: Gathering System for Maljamar Plant**
- Figure 8: Photograph of Poisonous Gas Warning Sign**
- Figure 9a: Conoco Playa Lake Project**
- Figure 9b: Conoco Playa Lake Project**

## APPENDICES

- Appendix A – Immediate Action Plan**
- Appendix B – Response Flow Diagrams**
- Appendix C – Telephone Numbers / Emergency Call List**
- Appendix D – ROE Calculations**
- Appendix E – Distribution List**
- Appendix F – Chronologic Record of Events Log**
- Appendix G – NMOCD Form C-141**

## LOCATION OF FACILITY

### **Frontier Field Services, LLC, Maljamar Gas Processing Plant, Maljamar Acid Gas Injection (AGI) Facility**

The physical location of the Plant and existing AGI Well (AGI #1) and associated AGI Facility is in Section 21, Township 17S, Range 32E, Lea County, NM. The Plant and associated facilities are located approximately three miles south of the town of Maljamar, NM in a very isolated area. Driving directions to the plant from the north are as follows: At the Junction of Highway 82 and County Road 126 (State Road 33) go south 2.6 miles and turn right onto Conoco Road and take first paved road south to the office. Driving directions to the Plant from the south are: at the Junction of Highway 529 and County Road 126 go north 1.9 miles and turn left onto Conoco Road and take first paved road south to the office (see Figure 1).

The mailing address of the plant is:  
1001 Conoco Road  
P.O. Box 7  
Maljamar, NM 88264

#### **Maljamar AGI #1, API # 30-025-40420**

The existing AGI well is named the **Maljamar AGI #1** and it is located 130 FSL, 1,813 FEL in Section 21, Township 17 South, Range 32 East in Lea County, NM (see Figures 2 and 2a).

#### **Maljamar AGI #2, API # 30-025-42628**

Frontier has received authorization from the NMOCC to drill and complete an alternate/backup AGI well (**Maljamar AGI #2**) just adjacent to AGI #1 (see Figures 2 and 3). This new well has not yet been drilled, but Frontier anticipates that the well will be drilled and completed sometime during the fall/winter of 2015/2016. The surface location of this well will be 400' FSL, 2100' FEL, Section 21, Township 17 South, Range 32 East in Lea County NM (see Figure 2 and 2a).

## GLOSSARY OF ACRONYMS UTILIZED IN THE PLAN

<b>ACGIH</b>	American Conference of Governmental Industrial Hygienists
<b>AGI</b>	Acid Gas Injection
<b>ANSI</b>	American National Standards Institute
<b>APD</b>	Application for Permit to Drill (BLM Document)
<b>API</b>	American Petroleum Institute
<b>CO<sub>2</sub></b>	Carbon Dioxide
<b>DCS</b>	Distributed Control System
<b>DOT</b>	Department of Transportation
<b>ERO</b>	Emergency Response Officer
<b>ESD</b>	Emergency Shut-Down
<b>H<sub>2</sub>S</b>	Hydrogen Sulfide
<b>IDLH</b>	Immediately Dangerous to Life or Health
<b>LEL</b>	Lower Explosive Limit
<b>LEPC</b>	Local Emergency Planning Committee
<b>MSDS</b>	Materials Safety Data Sheets
<b>NACE</b>	National Association of Corrosion Engineers
<b>NCP</b>	National Contingency Plan
<b>NIIMS</b>	National Interagency Incident Management System
<b>NIOSH</b>	National Institute for Occupational Safety and Health
<b>NGL</b>	Natural Gas Liquid
<b>NMAC</b>	New Mexico Administrative Code
<b>NMED</b>	New Mexico Environment Department
<b>NMOCC</b>	New Mexico Oil Conservation Commission
<b>OCD</b>	Oil Conservation Division
<b>OSHA</b>	Occupational Safety and Health Administration
<b>PLC</b>	Programmable Logic Controller
<b>PPE</b>	Personal Protective Equipment
<b>PPM</b>	Parts Per Million
<b>ROE</b>	Radius of Exposure
<b>SCBA</b>	Self-Contained Breathing Apparatus
<b>SERC</b>	State Emergency Response Commission
<b>SO<sub>2</sub></b>	Sulfur Dioxide
<b>SSSV</b>	Subsurface Safety Valve
<b>STEL</b>	Short Term Exposure Limit
<b>TLV</b>	Threshold Limit Value
<b>TWA</b>	Time Weighted Average

## **I. INTRODUCTION [NMAC 19.15.11 ET.SEQ] [API RP-55 7.1]**

The Frontier Field Services Maljamar Processing Plant is a natural gas processing plant which process field gas containing hydrogen sulfide (H<sub>2</sub>S) and handles and/or generates sulfur dioxide (SO<sub>2</sub>). Frontier has an existing Acid Gas Injection (AGI) well and associated compression facilities which were completed in 2012. Frontier is currently in the process of installing a new AGI well (Maljamar AGI #2) which will serve as a back-up well to AGI #1 and will be utilized when AGI #1 is out of service for maintenance or is closed down for any other reason.

This revised safety plan is being submitted to include that new AGI well and also because irrespective of whether they have one well or two at the Maljamar Plant, Frontier is increasing the amount of acid gas processed at the Plant, and that acid gas has a higher concentration of H<sub>2</sub>S than was described in the Plan that was submitted in 2012. This revised H<sub>2</sub>S Contingency Plan (the “H<sub>2</sub>S Plan” or the “Plan”) is created to document procedures that are to be followed in the event of an H<sub>2</sub>S release that occurs at any location on the Plant or the AGI Facility. The Plan and operation of the Maljamar Plant also conform to standards set forth in API RP-55 “Recommended Practices for Oil and Gas Producing and Gas Processing Plant Operations Involving Hydrogen Sulfide” as well as API RP 49 “Recommended Practice for Drilling and Well Servicing Operations Involving Hydrogen Sulfide”, API RP 68 “Oil and Gas Well Servicing and Workover Operations Involving Hydrogen Sulfide”, applicable National Association of Corrosion Engineers (NACE) standards for sour gas service and current best management practices. The Maljamar Plant does not have any storage tanks in which hydrogen sulfide or other gas or gas products are stored, and thus, API regulations and OCD regulations (specifically 19.15.11.12.E NMAC) relative to those types of storage are not applicable for this Plant or the AGI Facility. Drilling and completion of the Maljamar AGI #2 will be accomplished in compliance with NMAC 19.15.11.11, 19.15.11.7 K.(3) and in compliance with the approved BLM Application for Permit to Drill (APD) which includes an H<sub>2</sub>S contingency plan for drilling and completion operations.

The terms used in this Plan are used as defined in Title 19 Chapter 15 Part 11 of the New Mexico Administrative Code (19.15.11.7 – Definitions), unless otherwise defined herein. For the purposes of this Plan the term “shelter-in-place” means that individuals should go inside, turn off heating and air conditioning systems, close windows and put towels or tape around doors and/or windows that are not sealed and wait for further instruction.

## **II. SCOPE [API RP-55 7.2]**

This contingency plan is specific to the Frontier Maljamar Gas Processing Plant and Maljamar AGI Facility. It contains procedures to provide an organized response to an unplanned release of H<sub>2</sub>S from the Plant or the AGI Facility and documents procedures that would be followed to alert and protect any members of the public and/or contractors working on or around the plant in the event of an unplanned release. This H<sub>2</sub>S Contingency Plan has been prepared to minimize the hazard resulting from an H<sub>2</sub>S release. It will be used to inform company personnel, local emergency responders and the public of actions to be taken before, during and after an H<sub>2</sub>S release. All operations shall be performed with safety as the primary goal. The primary concern of Frontier Field Services Maljamar Gas Plant, during an H<sub>2</sub>S release, is to protect company employees, contractors and the public; the secondary concern is to minimize the damage and other adverse effects of the emergency. At any time during such an emergency, any part of the operation that might compromise the safety of individuals will cease until the operation can be reevaluated and the proper engineering controls to assure safety can be implemented. No individual should place the protection of the Plant property above his or her own personal safety.



In a serious situation involving an H<sub>2</sub>S release, not only Frontier Field Services personnel are involved, but local fire departments, law enforcement, county and even State of New Mexico agencies may be interested parties. Cooperation will expedite all decisions. In any emergency situation involving a H<sub>2</sub>S release, delegation of duties will be made to appropriate employees and groups. These duties will be reviewed on an annual basis to ensure complete understanding and facilitate a well-coordinated response by all involved personnel to the emergency situation.

### **III. PLAN AVAILABILITY [API RP-55 7.3]**

This H<sub>2</sub>S Plan shall be available to all personnel responsible for implementing any portion of the Plan (see Appendix E for distribution list). Frontier Field Services or their designee will distribute copies of the approved plan to the following agencies: OCD; New Mexico Department of Public Safety (DPS); Local Emergency Planning Committees (LEPCs) for both Lea and Eddy County; Maljamar, Lovington, Artesia, Hobbs and Loco Hills, Fire Departments; New Mexico State Police District 3 Office, Roswell, NM; Lea County Sheriff's Department and the Bureau of Land Management (BLM) Carlsbad Field Office. The Plan will be available at the following Frontier Field Services, LLC locations: Maljamar Processing Plant, Maljamar, NM; Frontier Field Services Main Office, 4200 Skelly Drive, Suite 700, Tulsa, OK 74135; AKA Energy Corporate Headquarters, 65 Mercado Street, Suite 250, Durango, CO 81301.

### **IV. EMERGENCY PROCEDURES [NMAC 19.15.11.9.B(2)(a)] [API RP-55 7.4 a] [29CFR1910.1200]**

#### **SITE SECURITY [NMAC 19.15.11.12.B]**

This facility requires that all visitors check-in before entering the Plant or AGI Facility, and thus the check-in sheet will be used at the Emergency Assembly Areas to make a full accounting of all personnel, contractors and visitors. In compliance with 19.15.11.12.B NMAC the Plant and AGI Wells are contained within a secure fenced areas with locking gates.

### **RESPONSIBILITIES AND DUTIES OF PERSONNEL DURING AN EMERGENCY**

If the event that a 10 ppm H<sub>2</sub>S intermittent alarm and/or flashing blue beacon is activated, all company personnel working in the area of the alarm will proceed to the Plant Control Room. All visitors and contractors will proceed to the Plant Muster Area (see Figures 4a and 4b). Any person in distress will be assisted from the area, as long as doing so does not pose a danger to others. The Plant operator(s) will verify that the alarm is not false and will make initial determinations of the cause of the alarm. If the alarm is not immediately resolved, then Level 1 H<sub>2</sub>S Contingency Plan will be activated. The following is a description of key personnel responsibilities during an incident response. Depending on the specific circumstances surrounding the release, a single individual may serve in multiple roles for key personnel outlined below.

#### **Plant Supervisor or Lead Operator**

The Plant Supervisor will be responsible for insuring that the objectives of the Plan are met. If the Plant Supervisor is not on-site at the Plant when an incident necessitating the activation of the H<sub>2</sub>S Plan occurs, then the Lead Operator will be in charge until the Plant Supervisor arrives on-scene. This individual will bear the overall responsibility to see that objectives of the Plan are met and to insure the safety of the public and all personnel involved in the response and will monitor all activities being carried out. This individual will notify or delegate responsibility for notification of all Frontier or contract personnel and any civil authorities needed to respond to the incident and will assign any additional personnel to support

roles as needed. Upon notification or discovery of an H<sub>2</sub>S release, the following steps will be initiated by the Plant Supervisor or Lead Operator.

- Establish response priorities.
- Insure the safety of all personnel involved in the response.
- Assess the incident/situation and develop appropriate strategies. Conduct site investigations as needed.
- Alert other emergency response personnel of the potential hazard.
- Arrange for support personnel to be sent to the location of the release.
- Proceed to the site to assess emergency response actions needed.
- Keep Frontier Field Services line and senior management informed of response situation.
- Remain on site until relieved or the incident is under control.

#### **Field Office Administrator**

The Field Office Administrator (FOA) works only during normal business hours (Monday – Friday, 7:30 AM to 3:30 PM). The FOA is responsible for management of the Plant Muster Area where visitors and contractors will assemble during a Level 1 response. (The number of visitors/contractors who would be at the Plant after normal working hours is so few, that those individuals would be instructed to report to the Plant Control Room in the event of Level 1 response that occurs outside normal business hours.)

During a Level 1 response, the FOA will:

- Proceed to the Plant Muster Area (see Figures 4a and 4b) with a radio, cell phone and H<sub>2</sub>S monitor and conduct roll call for visitors/contractors.
- Monitor air quality at the Plant Muster Area for H<sub>2</sub>S concentrations.
- If the muster area becomes untenable (H<sub>2</sub>S >10 ppm) the FOA will communicate to personnel at the Plant Muster Area that they need to move to the NE Assembly Area (see Figures 4a and 4b).
- Maintain the Chronologic Record of Events Log (see Appendix F).

#### **Other Employees and Contractors**

All employees on duty should be on standby awaiting instructions from Plant Supervisor or Lead Operator. They may be called on to provide support contacting vendors for supplies, contacting local support groups for assistance, provide onsite logistical support to the responders, blocking roads, assisting with evacuations, etc.

***No employee or contractor will be asked to provide incident scene support that they are not comfortable in their ability to perform or have not been specifically trained to perform.***

### **IMMEDIATE ACTION PLANS**

Appendix A contains the Immediate Action Plans which details the procedures to be used when responding to an unanticipated release of H<sub>2</sub>S at the Plant or AGI Facility. The Immediate Action Plans are divided into two levels which are activated in response to increased severity of an unanticipated release. See Appendix B for Response Flow Diagrams that correspond to the two levels of response detailed in Appendix A.

In the event of activation of an H<sub>2</sub>S alarm the Plant Supervisor or Lead Operator will assess the situation and determine the appropriate level of response consistent with the Immediate Action Plan. Additional or long-term response actions will be determined on a case-by-case basis, if needed.

## **TELEPHONE NUMBERS, COMMUNICATION METHODS AND MEDIA SITE**

### **Telephone Numbers and Communication Methods**

In the event of activation of the Plan, emergency responders, public agencies, local government and other appropriate public authorities must be contacted per the Immediate Action Plan (see Appendix A). Telephone contact information for those entities is included in Appendix C.

### **Communication Method/Internal Communications**

Frontier Field Services, LLC will use 2-way radios and telephones to communicate internally. Telephones will be used for external communication. Land lines and high speed internet access are available at the Plant office.

### **Media Site**

If a Level 2 Response occurs, Frontier will designate a Media Site at or adjacent to the Emergency Staging Area (see Figures 4a and 4b). Frontier will also designate a Media Liaison Officer. Under no circumstances will media personnel be allowed inside the warm or hot zone (road blocked area). Media personnel will only be allowed inside the road blocked area once the area has been monitored and restored to a cold zone (less than 10 ppm H<sub>2</sub>S) and Frontier has approved their entry. Media personnel shall be escorted by Frontier personnel at all times.

## **LOCATION OF NEARBY RESIDENCES, ROADS, BUSINESS, OPERATORS AND MEDICAL FACILITIES**

### **Residences**

There are no residences located within the ROE of the Plant.

### **Roads**

Roads located within the ROE include:

- Various lease roads.
- Conoco Phillips Field Warehouse service roads
- Mid America Pipeline Meter Station service roads
- Chaparral Pipeline Company Meter Station service roads

### **Businesses**

Businesses located within the ROE include:

- Mid America Pipeline Meter Station
- Conoco Phillips Field Warehouse
- Chaparral Pipeline Company Meter Station

Note: The Mid America Meter Station is an unmanned facility. The Conoco Phillips Field Warehouse has no employees who regularly work at that facility, and the Chaparral Pipeline Company has an unmanned meter station in the area. In the event of an H<sub>2</sub>S release, these businesses will be contacted by Frontier personnel, and if any of their personnel are working in the area, they will be advised to evacuate or shelter in place as deemed appropriate as described in Appendix A. They will also be told to advise any of their contractors working or planning to work in the area that they should leave and not enter the area until further notice.

### **Conoco Playa Lake Project**

The Playa Lake Wetlands Habitat Project (a joint venture between the US Department of Interior Bureau of Land Management and ConocoPhillips) is located approximately 1.2 miles southeast of the plant, (see

Figures 4, 9a and 9b) and is within the calculated 100 ppm H<sub>2</sub>S gas Radius of Exposure (ROE) of the Frontier Maljamar Gas Processing Plant and Acid Gas Injection Facility. In the event of an emergency which requires Contingency Plan activation at Level 2, Frontier response personnel will complete a physical inspection of the area and instruct anyone present to evacuate the area.

#### **Operators:**

There are numerous active wells and other wells that are currently being drilled but have not yet been completed within 100 ppm ROE of the Plant. In the event of an emergency, the operators of those wells will be contacted and advised of the status of the release and, depending on wind conditions, magnitude of the release, etc., any personnel working in the area will be advised to evacuate the area and not return until further notice. A list of these operators is contained in Appendix C.

#### **Medical Facilities**

There are no medical facilities located within the ROE.

#### **Other**

In addition to notifying the facilities listed above, Frontier personnel will make a visual inspection of the ROE area to insure that no individuals are seen inside the ROE, and if any are observed, they will be advised to immediately evacuate to one of the designated Emergency Evacuation Area described below.

### **EVACUATION ROUTES, EMERGENCY ASSEMBLY AREAS AND ROAD BLOCK LOCATIONS**

#### **Evacuation Routes and Emergency Assembly Areas**

Evacuation Routes and Emergency Assembly Areas are shown on Figures 4a and 4b. The plant Muster Area is located in the parking area near the front doors of the Plant Measurement Office. Two Emergency Assembly Areas have been designated, one in the road at the Southwest corner of the Plant (hereafter named "SW Assembly Area") and one near the pump jack located northeast of the Plant (hereafter named "NE Assembly Area"). In the event of a catastrophic release, one alternate Emergency Assembly Area (hereafter named "Emergency Staging Area") will be located farther from the Plant, just outside the 100 ppm ROE at the intersection of Maljamar Road and SR 126A (see Figures 4a and 4b). Depending on wind direction, magnitude of release, etc. the "Secondary Staging Area" (see Figures 4a and 4b) may be utilized.

#### **Road Block Locations**

Road blocks (as shown in Figures 4a and 4b) will be established as specified in Appendix A utilizing portable barriers and flashing lights. Frontier will designate representatives to staff each of the roadblocks, as deemed necessary. State or Local Police may be asked to assist with maintaining the roadblocks.

### **MONITORING EQUIPMENT, ALARM SYSTEMS, SAFETY EQUIPMENT AND SUPPLIES**

#### **Emergency Shutdown System (ESD)**

There are 16 ESD manual stations in various locations: 14 are located in the Plant and 2 in the AGI Facility. Figure 3 shows the location of the ESD stations. The Plant Amine Unit and AGI Facility ESD can be activated at any time by any employee or at the direction of the Plant Supervisor or Lead Operator. If a Level 2 Response is initiated the Plant ESD will immediately be activated.

When any one of the Plant or AGI Facility manual stations is activated, the system will be shut-down and the natural gas inlets and outlets will be blocked. The operators are also able to auto-close the one main isolation/block valve on the incoming gas line to the Plant and the treated acid gas (TAG) block valves or

automatic safety valves upstream and downstream of the compression facility (see Figures 3 and 6). Activating these should allow the plant to avoid a Level 2 response. If deemed necessary, Frontier can also send trained personnel to activate designated off-site manual block valves. There are also various methods to shut down gas flow at the various wellheads and incoming gathering lines. These can and would be evaluated on a case by case basis. Designated employees will have remote access to the plant controls including ESD capabilities.

### **Plant Alarms, Visible Beacons and Wind Indicators**

An audible alarm system along with a visual alarm system provides warning for H<sub>2</sub>S releases. These systems exist for specific areas of the Plant. The audible and visual alarms are redundant systems which function independently of one another so that should one system fail, the other would remain active. These systems incorporate back-up battery capabilities as recommended in API RP 55 which insure their operation in the event of a power failure. A computer in the control room and in the Plant Operator's Office establishes which H<sub>2</sub>S monitor has activated the alarm and/or flashing blue beacon. Colored beacons, horns, and wind direction indicators are situated in various locations throughout the Plant and are shown in Figure 3. At least one wind direction indicator can be seen day and night at any location within the Plant and AGI Facility complexes, as well as from any point on the perimeter of the plant and AGI Facility.

### **Gas Detection Equipment**

The Plant and AGI Facility use RAE Guard EC, FGM-1300 fixed H<sub>2</sub>S sensors. These sensors are part of a fixed point monitoring system used to detect the presence of H<sub>2</sub>S in ambient air. The blue flashing beacon is activated at H<sub>2</sub>S concentrations of 10 ppm or greater. The horn is also activated with a continuous alarm at H<sub>2</sub>S concentrations of 10 ppm or greater. The fixed H<sub>2</sub>S monitors are strategically located throughout the Plant to detect an uncontrolled release of H<sub>2</sub>S. Four continuous read H<sub>2</sub>S monitors are located immediately around the wellhead and are monitored continuously, connected and linked electronically through the Programmable Logic Controller (PLC) to the ESD system of the plant. These monitors will immediately ESD the AGI Facility in the event that H<sub>2</sub>S at 20 ppm is detected. The Automatic Subsurface Safety Valve (SSV) which is also linked to the PLC is designed to prevent any backflow from the level of the SSV (295 ft.), and it allows access for servicing the well or taking corrective actions as needed.

The Plant operators are able to monitor the H<sub>2</sub>S levels of all the Plant sensors on the control monitor located in the control room. In addition, select employees can access this information remotely. These sensors are shown on Figure 3. These sensors all have to be acknowledged and will not clear themselves. This requires immediate action for any occurrence or malfunction. The sensors have battery backup systems and are calibrated monthly. Audible alarm systems are also calibrated monthly. Handheld gas detection monitors are available to plant personnel to check specific areas and equipment prior to initiating maintenance or working on equipment. There are 4 handheld monitors, and each individual is assigned a personal H<sub>2</sub>S monitor. The handheld gas detection devices are RKI GSX-2900 4-way monitors. The detectors have sensors for oxygen, LEL (lower explosive limit hydrocarbon atmospheres), H<sub>2</sub>S, and carbon monoxide. They indicate the presence of H<sub>2</sub>S with a beeping sound at 10 ppm. The beeps change in tone as H<sub>2</sub>S increases to 20 ppm. The personal monitors are set to alarm (beep) at 10 ppm with the beeps becoming closer together as the H<sub>2</sub>S concentration increases to 20 ppm. Both the handheld and personal monitors have digital readouts of H<sub>2</sub>S ppm concentration. The Plant compressor building has two methane sensors; one sends a call out at the 30% lower explosive limit (LEL); the second shuts the compressors down at 50% LEL. The methane sensors are visual and audible alarms. The compressor building also is equipped with fire eyes that will also shut the units down. The four product pumps also have LEL sensors.

### **Respirators**

The facility has 14 Drager 30-minute self-contained breathing apparatus (SCBA) respirators and 8 Scott 5-minute escape packs strategically located throughout the Plant and AGI Facility. There are also 5 work packs with supplied air lines distributed throughout the plant. Plant personnel medically cleared for inclusion in the company Respiratory Protection Program are certified to use the SCBAs respirators and work packs.

### **Fire Fighting Equipment**

The Plant personnel are trained only for insipient stage fire-fighting. The fire extinguishers located in the Plant and AGI Facility process areas, compressor buildings, process buildings, and company vehicles are typically an Ansul 30# ABC dry chemical fire extinguisher. The Plant does not have a fire water system, only a utility water system that is not designed for fire-fighting.

### **Traffic Control Kit**

The Plant has a Traffic Control Kit located in the Plant Office which contains the necessary equipment to initiate and maintain traffic control.

### **First Aid Equipment Locations**

First Aid Kits are located in the following areas: Control Room and Plant Office. Eye Wash stations are located in the Lab, Plant Office, Engine Buildings, Maintenance Shop and Welding Shop.

### **Personal H<sub>2</sub>S Monitors**

All Frontier personnel assigned to the Plant and associated field personnel are issued and required to use personal H<sub>2</sub>S monitors while on duty.

### **SIGNS AND MARKERS [NMAC 19.15.11.10]**

Pursuant to NMSA 19.15.11.10, the Plant and AGI Facility have readily readable warning, caution and notice signs which conform with the current ANSI standard Z535.1-2002 (Safety Color Code) indicating the presence of “H<sub>2</sub>S/Poisonous Gas” and “High Pressure Gas” at the entrance to the Plant and at the AGI Wellhead, in order to warn the public that a potential danger exists. Emergency response phone numbers are posted at the entrance to the Plant, and signs are located at the Plant gate entrance indicating that all visitors must sign in. Signs to warn the public of potential danger have also been placed where the Plant access road intersects Conoco Road and where Conoco and Maljamar Roads intersect with the 500 ppm ROE of the Plant (see Figures 4a and 4b). These signs are easily readable from the road and contain the language “Caution Poisonous Gas May Be Present”. Please see Figure 8 for a representative photograph of one of these signs.

The Conoco Playa Lake Project Wetlands Habitat Area is located approximately 1.2 miles southeast of the Plant, and is included in the 100 ppm ROE of the Plant (see Figures 9a and 9b). The following sign will be placed at the entrance to the public parking area for the Playa Lake Project to warn the public of potential danger:

CAUTION H<sub>2</sub>S “POISON GAS” IS HANDLED  
AT NUMEROUS FACILITIES IN THIS AREA.  
IN THE EVENT OF AN EMERGENCY THIS  
AREA MAY BE EVACUATED

This sign will be readily readable from the road at the entrance to the wetlands area, and it will be compliant current ANSI standards, as cited above.

## V. CHARACTERISTICS OF HYDROGEN SULFIDE (H<sub>2</sub>S), SULFUR DIOXIDE (SO<sub>2</sub>) AND CARBON DIOXIDE (CO<sub>2</sub>) [NMAC 19.15.11.9.B(2)(b)] [API RP-55 7.4 b.]

### HYDROGEN SULFIDE

The Inlet Gas stream to the Plant will contain an average of 0.85 mole percent of H<sub>2</sub>S based on data generated from the sampling of the inlet stream at least daily. The TAG stream will contain approximately 37 mole percent of H<sub>2</sub>S. H<sub>2</sub>S is a colorless, toxic and flammable gas, and has the odor of rotten eggs. H<sub>2</sub>S gas is heavier than air and presents a significant health hazard by paralyzing the respiratory system resulting in serious injury or death.

Hydrogen Sulfide Properties and Characteristics		
CAS No.		7783-06-4
Molecular Formula		H <sub>2</sub> S
Molecular Weight		34.082 g/mol
Ceiling Concentration		20 ppm (OSHA)
Ceiling Peak Concentration		50 ppm (OSHA)
Threshold Limit Value (TLV)		15 ppm (ACGIH)
Time Weighted Average (TWA)		10 ppm (NIOSH)
Short Term Exposure Level (STEL)		15 ppm (ACGIH)
Immediately Dangerous to Life or Health (IDLH)		100 ppm
Specific Gravity Relative to Air (Air=1.0)		1.189
Boiling Point		-76.5F
Freezing Point		-121.8F
Vapor Pressure		396 psia
Autoignition Temperature		518F
Lower Flammability Limit		4.3%
Upper Flammability Limit		46.0%
Stability		Stable
pH in water		3
Corrosivity		Reacts with metals, plastics, tissues and nerves
Physical Effects of Hydrogen Sulfide		
Concentration		
Ppm	%	Physical Effects
1	0.00010	Can be smelled (rotten egg odor)
10	0.0010	Obvious & unpleasant odor; Permissible exposure level; safe for 8 hour exposure
20	0.0020	Acceptable ceiling concentration
50	0.0050	Loss of sense of smell in 15 minutes
100	0.0100	Immediately dangerous to life and health(IDLH) loss of sense of smell in 3-15 minutes; stinging in eyes & throat; Altered breathing
200	0.0200	Kills smell rapidly; stinging in eyes & throat
500	0.0500	Dizziness; Unconscious after short exposure; Need artificial respiration
700	0.0700	Unconscious quickly; death will result if not rescued promptly
1000	0.1000	Instant unconsciousness; followed by death within minutes

### SULFUR DIOXIDE (SO<sub>2</sub>)

Sulfur dioxide is produced as a by-product of H<sub>2</sub>S combustion at the flare. The compression facility and the well will be connected to the acid gas flare in order to allow for purging of any acid gas trapped between the Plant and the SSV or for temporary flaring of TAG at the AGI Facility in the event of an emergency. SO<sub>2</sub> is colorless, transparent, and is non-flammable, with a pungent odor associated with burning sulfur. It is heavier than air, but will be picked up by a breeze and carried down-wind at elevated temperatures and can be extremely irritating to the eyes and mucous membranes of the upper respiratory tract.

Sulfur Dioxide Properties & Characteristics	
CAS No.	7446-09-5
Molecular Formula	SO <sub>2</sub>
Molecular Weight	64.07 g/mol
Permissible Exposure Limit (PEL)	5 ppm(OSHA)
Time Weighted Average (TWA)	2 ppm(ACGIH)
Short Term Exposure Level (STEL)	5 ppm(ACGIH)
Immediately Dangerous to Life and Health (IDLH)	100 ppm
Specific Gravity Relative to Air (Air = 1.0)	2.26
Boiling Point	14°F
Freezing Point	-103.9°F
Vapor Pressure	49.1 psia
Autoignition Temperature	N/A
Lower Flammability Limit	N/A
Upper Flammability Limit	N/A
Stability	Stable
Corrosivity	Could form an acid rain in aqueous solutions
Physical Effects of Sulfur Dioxide	
Concentration	Effect
1 ppm	Pungent odor, may cause respiratory changes
2 ppm	Permissible exposure limit; Safe for an 8 hour exposure
3-5 ppm	Pungent odor; normally a person can detect sulfur dioxide in this range
5 ppm	Short Term Exposure Limit (STEL); Safe for 15 minutes of exposure
12 ppm	Throat irritation, coughing, chest constriction, eyes tear and burn
100 ppm	Immediately Dangerous To Life & Health (IDLH)
150 ppm	So irritating that it can only be endured for a few minutes
500 ppm	Causes a sense of suffocation, even with first breath
1,000 ppm	Death may result unless rescued promptly.



**CARBON DIOXIDE (CO<sub>2</sub>)**

The inlet stream to the plant contains approximately 1.48 mole percent of CO<sub>2</sub> based on data generated from the daily sampling of inlet gas and the CO<sub>2</sub> concentration in the proposed TAG stream to the AGI Facility will be about 63%. CO<sub>2</sub> is colorless, odorless, non-flammable and heavier than air.

<b>Carbon Dioxide Properties &amp; Characteristics</b>	
CAS No.	124-38-9
Molecular Formula	CO <sub>2</sub>
Molecular Weight	44.010 g/mol
Time Weighted Average (TWA)	5,000 ppm
Short Term Exposure Level (STEL)	30,000 ppm
Immediately Dangerous to Life and Health (IDLH)	40,000 ppm
Specific Gravity Relative to Air (Air = 1.0)	1.5197
Boiling Point	-109.12°F
Freezing Point	-69.81°F
Vapor Pressure	830 psia
Autoignition Temperature	N/A
Lower Flammability Limit	N/A
Upper Flammability Limit	N/A
Stability	Stable
pH in Saturated Solution	3.7
Corrosivity	dry gas is relatively inert & not corrosive; can be corrosive to mild steels in aqueous solutions
<b>Physical Effects of Carbon Dioxide</b>	
<b>Concentration</b>	<b>Effect</b>
1.0 %	Breathing rate increases slightly
2.0 %	Breathing rate increases to 50% above normal level. Prolonged exposure can cause headache, tiredness
3.0 %	Breathing rate increases to twice normal rate and becomes labored. Weak narcotic effect. Impaired hearing, headache, increased blood pressure and pulse rate
4 – 5 %	Breathing increases to approximately four times normal rate, symptoms of intoxication become evident, and slight choking may be felt
5 – 10 %	Characteristic sharp odor noticeable. Very labored breathing, headache, visual impairment, and ringing in the ears. Judgment may be impaired, followed within minutes by loss of consciousness
10 – 100 %	Unconsciousness occurs more rapidly above 10% level. Prolonged exposure to high concentrations may eventually result in death from asphyxiation

## **VI. RADII OF EXPOSURE [NMAC 19.15.11.7.K]**

- See Appendix D for Worst Case Scenario and ROE calculations.
- See Figures 4a and 4b for Map showing 500 ppm and 100 ppm ROE areas.

## **VII. FACILITY DESCRIPTIONS, MAPS AND DRAWINGS [NMAC 19.15.11.9.B(2)(c)] [API RP-55 7.4 c.]**

### **DESCRIPTION OF PLANT AND OPERATION**

The primary function of the Plant is to remove acid gas (H<sub>2</sub>S and CO<sub>2</sub>) from sour field gas so that the gas can meet pipeline specifications. The gas is treated to remove acid gas components, dehydrated to remove water and processed to remove heavy (liquid) hydrocarbons from the gas stream. Several Plant systems are involved in performing these functions. The amine unit is designed to remove acid gas components from the natural gas stream. These components are removed from the natural gas because they are corrosive, hazardous to health, and reduce the heating value of the natural gas stream. This process is known as the gas sweetening process. Prior to the installation of the Maljamar AGI Facility, the H<sub>2</sub>S gas removed by the amine unit was routed to the flare for incineration, and the CO<sub>2</sub> was released to the atmosphere. With the installation of the Maljamar AGI Facility the H<sub>2</sub>S and CO<sub>2</sub> removed during the sweetening process are compressed at the AGI Facility and then injected into one of the AGI wells.

### **DESCRIPTION OF AGI FACILITY AND OPERATION**

The lines that convey the TAG to the wells from the compression facilities are three-inch, stainless-steel, corrosion-resistant pipes (compliant with NACE standards). The pipes between the compressors and the AGI Wells are contained totally within the boundaries of the Plant and AGI Facility and do not cross any public road. H<sub>2</sub>S sensors are located at critical junctions along the pipes which are run on overhead pipe racks. The pressure in the pipes is monitored continuously so the acid gas injection process could be stopped should there be any unusual variations in pressure. The designs for the injection wells are shown in Figures 5a and 5b, and the schematic of the AGI facility and tie-in to the Frontier Plant are shown in Figure 6.

The Maljamar AGI #1 is located 130' FSL, 1,813' FEL in Section 21, Township 17 South, Range 32 East and has been assigned API # 30-025-40420. It is a vertical well, completed on property leased by Frontier from the BLM and will provide access to the primary injection zone (Wolfcamp Formation). The well was drilled to a final total depth of approximately 10,183 feet.

The Maljamar AGI #2 will be located 400' FSL and 2,100' FEL in Section 21, Township 17 South, Range 32 East and has been assigned API # 30-025-42628. This is a deviated well, which will be completed on property leased by Frontier from the BLM and will provide access to the primary injection zone (Wolfcamp Formation).

Each well has a string of telescoping casing cemented to the surface and includes a "downhole" SSV on the production tubing to assure that fluid cannot flow back out of the well during an injection equipment failure event. This valve is designed to isolate and automatically shut in the injection well if a leak occurs. The injection string within the well is also constructed with multiple safety features which include L80 ULTRA FJ 2-7/8" corrosion resistant tubing stabbed into a Halliburton BWD Perma-Series permanent packer, made of Incoloy<sup>®</sup> 925 with fluorel elements and an automated Halliburton SSV also made of Incoloy<sup>®</sup> 925. Incoloy<sup>®</sup> 925 is a nickel-iron chromium alloy that is resistant to corrosion and pitting and conforms to NACE specifications for sour gas service. In addition, the annular space between the projection tubing and the wellbore is filled with corrosion-inhibited diesel as a further safety measure and is designed to allow the pressure in the annular space to be monitored and recorded continuously. If a pressure excursion outside the narrow predetermined operating range occurs, the acid gas compressor is

shut down and the automatic safety valves at the wellhead are automatically closed to prevent any escape of acid gas. The acid gas stream would then be routed to the flare until the problem with the well could be corrected and the system safely re-started. These redundant systems are compliant with API RP 55 and API RP 49, various applicable NACE standards for sour gas service and current best management practices. All downhole equipment includes necessary features which will allow for safe workover of a well in the event of a major equipment failure.

The Christmas tree of each well is made of standard carbon steel components and outfitted with annular pressure gauges that remotely report operating pressure conditions in real time to a gas control center. Pursuant to NMAC 19.15.11.12.D(2), in the case of abnormal pressures or any other situation requiring immediate action, the acid gas injection process can be stopped at the compressor, and the wellhead can be shut in using a hydraulically operated wing valve on the Christmas tree. The Plant operator may also shut the SSV. In addition, the well has profile nipples which provide the ability to insert a blanking plug into the base of the well below the packer which would allow for the safe reentry of the well. These safety devices provide for downhole accessibility and reentry under pressure for permanent well control. The SSV provides a redundant safety feature to shut in the wells in case the wing valves do not close properly. (See Figures 5a, 5b and 6 for location of these downhole safety features).

#### **MAPS OF PLANT AND AGI FACILITY**

Figure 1 shows the location of the Maljamar Plant and associated AGI Facility; Figure 2 shows the locations of Maljamar AGI #1 and Maljamar AGI #2; Figure 2a is a 7.5 min USGS topo map showing the location, name, and API number for of Maljamar AGI #1 and Maljamar AGI #2. Figure 3 shows the location of alarms, monitors and safety equipment; Figures 4a and 4b show the 500 and 100 ppm ROE of the Plant and the location of roadblocks, evacuation routes and emergency assembly areas that would be utilized in the event a H<sub>2</sub>S release that requires activation of this Plan. Figures 5a and 5b show the schematics of the design of AGI #1 and #2, respectively; Figure 6 is a schematic of the Maljamar AGI Facility, and Figures 7a and 7b show the gathering systems that supply the Maljamar Plant.

### **VIII. TRAINING AND DRILLS [NMAC 19.15.11.9.B(2)(d)] [API RP-55 7.4 d]**

#### **RESPONSIBILITIES AND DUTIES OF ESSENTIAL PERSONNEL**

Please see Section IV “Emergency Procedures” for a detailed listing of responsibilities of essential personnel during a response. Personnel responsible for implementing this plan shall be trained on their duties and responsibilities related to this plan during the annual on-site or table top training exercises. All Plant and AGI Facility personnel, visitors, and contractors must attend an overview orientation prior to obtaining permission to enter the Plant or AGI Facility. A refresher course on this training is required annually for all persons. This training also complies with the requirements of the Aka Energy Group, LLC Corporate Safety Program. (Aka is the parent company of Frontier Field Services, LLC.)

#### **ON-SITE OR CLASSROOM DRILLS**

Frontier Field Services, LLC may use table top exercises as well as hands-on emergency response training methods. Training and drills in emergency response procedures help ensure personnel are adequately prepared to handle most emergency situations. Frontier personnel will be trained on the H<sub>2</sub>S Contingency Plan and procedures annually. Everyone’s role and responsibilities will be covered. The need for emergency preparedness will be emphasized through the use of drills and other exercises that simulate an emergency in which personnel perform or demonstrate their roles in the emergency. These drills can be either “table-top” discussions or realistic drills in which equipment will be deployed and contractors will participate. Frontier Field Services, LLC shall conduct a table top exercise annually at a minimum.

## **NOTIFICATION AND TRAINING OF OTHERS ON PROTECTIVE MEASURES IN EMERGENCY SITUATIONS**

At the time of submission of this plan there are no residences within the 100 ppm ROE. However, in the event of a release, Frontier personnel will make a visual inspection of the ROE area to insure that no individuals are seen inside the ROE, and if any are observed, they will be advised to immediately evacuate to the designated Emergency Evacuation Area.

The only businesses located within the 100 ppm ROE are unmanned meter stations owned by Enterprise/Chaparral Pipeline Company and Chevron Pipeline Company and an unmanned ConocoPhillips Production Office. In the event of an H<sub>2</sub>S release that cannot be immediately resolved, these companies will be contacted by Frontier personnel (see Appendix C for contact information). If anyone is present at those location, they would be instructed either to evacuate to an Emergency Assembly or Emergency Staging Area or to shelter-in-place, depending on prevailing wind conditions, magnitude of the release, etc. They will also be instructed to immediately alert all company personnel, third party contractors and/or service companies working in the area and those imminently scheduled to work in the area of the release of evacuation status of the Plant and AGI Facility. They will be trained not to enter/reenter the area within the roadblocks until they are given the “all clear” by Frontier personnel. The ConocoPhillips facility has no employees who regularly work at the facility, however, Conoco-Phillips personnel will be invited to participate in and/or observe annual drills where they will be briefed on notification, evacuation and shelter-in-place plans.

The Conoco Playa Lake Project Wetlands Habitat Area (see Figures 4, 9a and 9b) is located approximately 1.2 miles southeast of the Plant, and is included within the 100 ppm ROE of the Plant. In the event of an H<sub>2</sub>S emergency that necessitates activation of the Plan at Level 2, Frontier personnel will be dispatched to inspect this area to instruct any members of the public who might be visiting to evacuate the area.

There are a number of producing wells or new wells in the process of being completed within the 100 ppm ROE of the Plant (see Appendix C). In the event of an H<sub>2</sub>S release that cannot be immediately resolved, these producers will be contacted by designated Frontier personnel, advised of the status of the release and instructed to immediately alert all company personnel, third party contractors and/or service companies working in the area and those imminently scheduled to work in the area of the release and to be on stand-by for possible evacuation. If evacuated, they will be instructed not to enter/re-enter the area within the roadblocks until further notice.

## **TRAINING AND ATTENDANCE DOCUMENTATION**

All training and drills will be documented. Documentation of the training, drills and reviews will be on file at the Frontier Field Services office at the Maljamar Plant. Documentation shall include sign in sheets, synopsis of the training conducted, and an after action review of the training.

Annual training will also include making contact with the entities including any that are identified as being within the 500 ppm and 100 ppm ROE (see Appendix C). To make sure contact information is current, Appendix C will be verified and updated annually to be sure any changes of occupancy, ownership or new commercial and/or residential buildings are reflected, and all owners/occupants receive training on protective measures.

## **BRIEFING OF PUBLIC OFFICIALS ON EVACUATION AND SHELTER IN PLACE PLANS**

Local law enforcement, first responders, and fire personnel will also be invited to participate and/or observe annual drills, as well as being briefed on notification, evacuation, and shelter-in-place plans.

## **IX. COORDINATION WITH STATE EMERGENCY PLANS [NMAC 19.15.11.9.B(2)(e)] NOTIFICATIONS AND REPORTS**

The Plant has various notification and reporting obligations. Some are related to its State Air Quality Permit that is overseen by NMED as well as State and Federal spill reporting obligations. In addition to these regulatory obligations Plant personnel also have internal and external notification and reporting obligations associated with the activation of this plan. External reporting obligations are as follows:

### **NATIONAL RESPONSE CENTER (NRC)**

Within one hour after activation of the Plan, Frontier will begin agency notifications by calling the National Response Center (see Appendix C for phone numbers).

### **NEW MEXICO OIL CONSERVATION DIVISION (OCD) [NMAC 19.15.11.16]**

As soon as possible, but no later than four hours after plan activation, (recognizing that a prompt response should supersede notification), OCD will be notified by the IC or the IC's designee via email or fax to the District 1 Office of the activation of the H<sub>2</sub>S Contingency Plan. In the event of a power failure, a phone call will be made within four hours. A full report of the incident to the OCD, utilizing Form C-141 (see Appendix G) shall be made no later than 15 days following the release. As stated in Section IX. of this Plan and per requirements of [NMAC 19.15.11.9C] plan activation will take place when a release creates an H<sub>2</sub>S concentration greater than the activation levels set forth in the Plan itself (see Appendix C for phone number.)

### **NEW MEXICO STATE POLICE/HAZARDOUS MATERIALS EMERGENCY RESPONSE PLAN**

The New Mexico State Police are responsible for overall scene management and coordination of all resources. Law enforcement-related activities will be coordinated by State Police (see Appendix C for phone number).

### **BUREAU OF LAND MANAGEMENT (BLM)**

The BLM will also be contacted (see Appendix C for phone number) in the event of activation of the Plan since the AGI Facility is located on land leased from BLM by Frontier.

### **LOCAL EMERGENCY PLANNING COMMITTEE (LEPC)**

Both Eddy and Lea County LEPCs will be given a copy of this plan. Although the Plant is located in Lea County, the Eddy County LEPC, located in Carlsbad, NM is closer to the Plant than is the Lea County LEPC which is located in Lovington and they both coordinate planning for Maljamar. Both offices will be notified in the event of activation of the Plan (see appendix C for phone numbers).

## **X. PLAN ACTIVATION AND EVENTS THAT COULD LEAD TO A RELEASE [NMAC 19.15.11.9.C] [API RP-55 7.4 d]**

The plan will be activated when a release creates an H<sub>2</sub>S concentration greater than the activation levels set forth in the Plan itself. At a minimum, the Plan shall be activated at Level 2 whenever a release may create a hydrogen sulfide concentration of more than 100 ppm in a public area, 500 ppm at a public road or 100 ppm 3,000 feet from the site of release.

### **ACTIVATION LEVELS**

#### **Level 1**

Continuous audible alarm sounded and/or flashing blue beacons activated for H<sub>2</sub>S greater than or equal to 10 ppm. (See Appendix A for Immediate Action Plan and Appendix B for Response Flow Diagram.)

## **Level 2**

Catastrophic release; fire; explosion; a continuous release of maximum volume for 24 hours; or as per NMAC 19.15.11 there is indication of 100 ppm at any defined public area; 500 ppm at any public road or 100 ppm at a distance greater than 3,000 feet from the site of the release. If H<sub>2</sub>S is at 20 ppm or greater and repair efforts at Level 1 have been unsuccessful. (See Appendix A for Immediate Action Plan and Appendix B for Response Flow Diagrams.)

## **EVENTS THAT COULD LEAD TO A RELEASE OF H<sub>2</sub>S**

- Inlet and plant piping failure
- Amine still failure (This would be a leak in the amine process equipment or amine still utilized to separate methane from H<sub>2</sub>S and CO<sub>2</sub>.)
- Flange/gasket leaks on inlet and plant piping
- Flange/gasket leak on the acid gas compressors
- Flange/gasket or valve packing leak at the AGI Well or associated piping
- Valve packing
- Seal failure on acid gas compressors
- Failure of flare to ignite during Plant emergency blow down
- Damage to Maljamar AGI #1 or #2 Wellhead

## **XI. SUBMISSION AND RETENTION OF CONTINGENCY PLANS [NMAC 19.15.11.9.D]**

### **SUBMISSION**

Frontier Field Services, LLC submitted a revised H<sub>2</sub>S Contingency Plan to the OCD for review in August 2015, and the plan was accepted for record on October 6, 2015. Due to subsequent increases in the maximum allowable daily injection rate and H<sub>2</sub>S gas concentration approved by the New Mexico Oil Conservation Commission (NMOCC) on October 7, 2015 (NMOCC Order No. R-13443-C), the Commission required that the H<sub>2</sub>S Contingency Plan reflect the necessary changes and be reviewed again by the OCD. Consequently, the plan was amended and resubmitted to OCD for review on October 28, 2015.

### **RETENTION**

Frontier Field Services, LLC shall maintain a copy of the contingency plan at the Maljamar Gas Plant and at Frontier Field Services Headquarters office in Tulsa, OK and the AKA Energy Corporate Offices in Durango, CO. The plan as approved by the OCD will be readily accessible for review by the OCD at the facility upon request.

### **REVISIONS TO THE PLAN**


This H<sub>2</sub>S Plan will be reviewed annually and revised at that time as necessary to address changes to the Plant facilities, operations or training requirements, contact information, public areas including roads, businesses or residences potentially affected by the operation of the Plant and AGI Facility, specifically those areas within the radii-of-exposure.

### **ANNUAL INVENTORY**

Frontier Field Services, LLC will file an annual inventory of wells, facilities and operations for which H<sub>2</sub>S Contingency Plans are on file with the OCD with the LEPC and the State Emergency Response Commission as per NMAC 19.15.11.9(H). The inventory shall include the name, address, telephone number, and point of contact for all operations in which H<sub>2</sub>S Contingency Plans are on file with the OCD.

## FIGURES



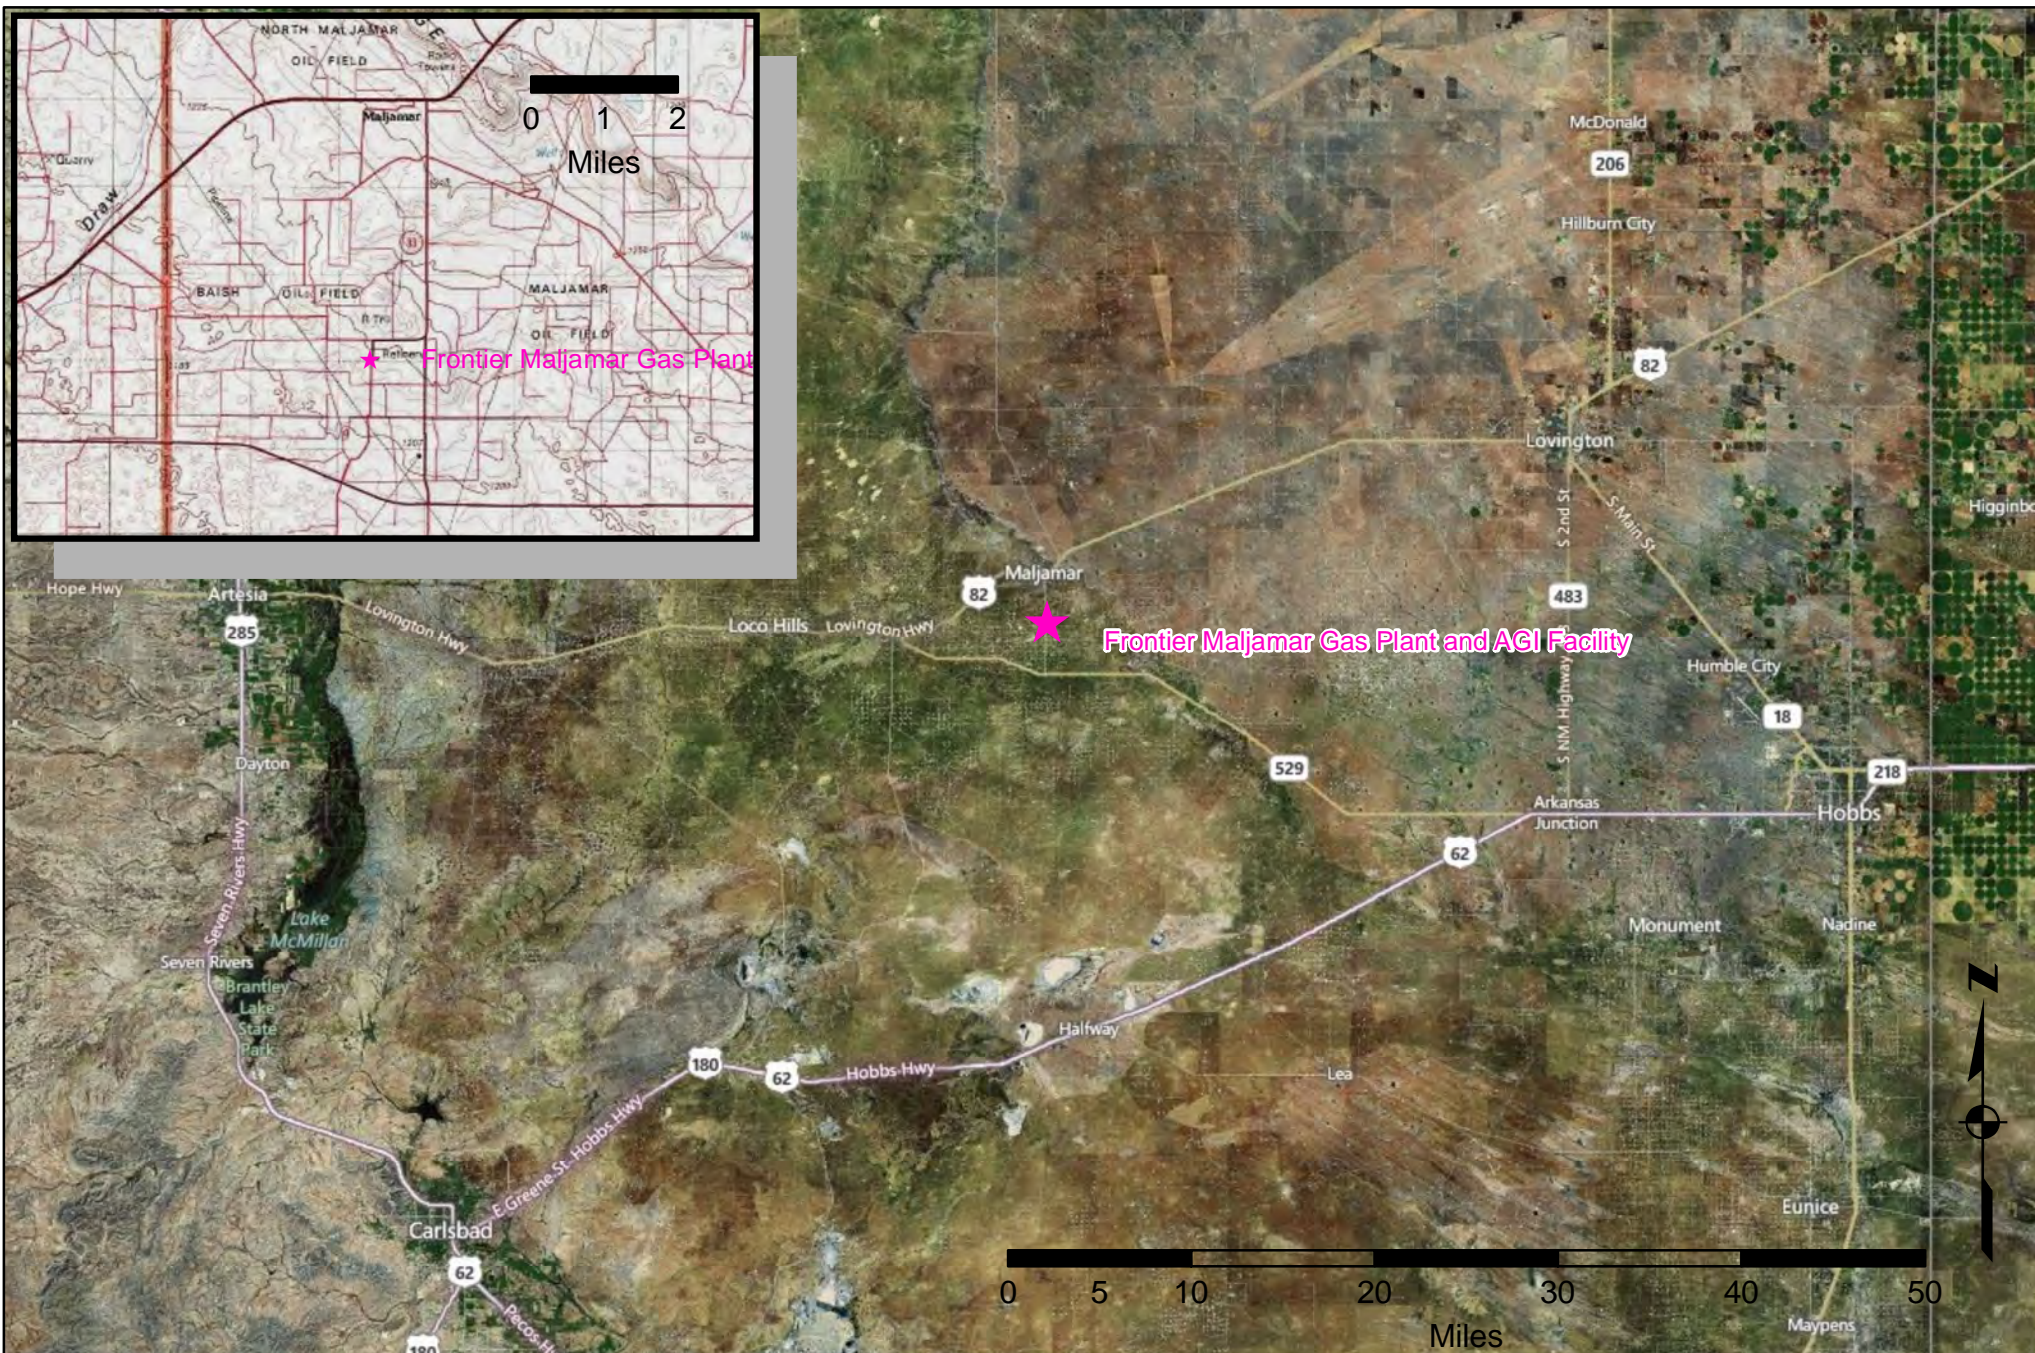

**Figure 1 Location of Frontier Maljamar Gas Plant and AGI Facility**






AGI #1: 130' FSL, 1813' FEL, S21-T17S-R32E  
 AGI #2: 400' FSL, 2100' FEL, S21-T17S-R32E

**Figure 2a**  
 Locations of Maljamar AGI #1 and AGI #2



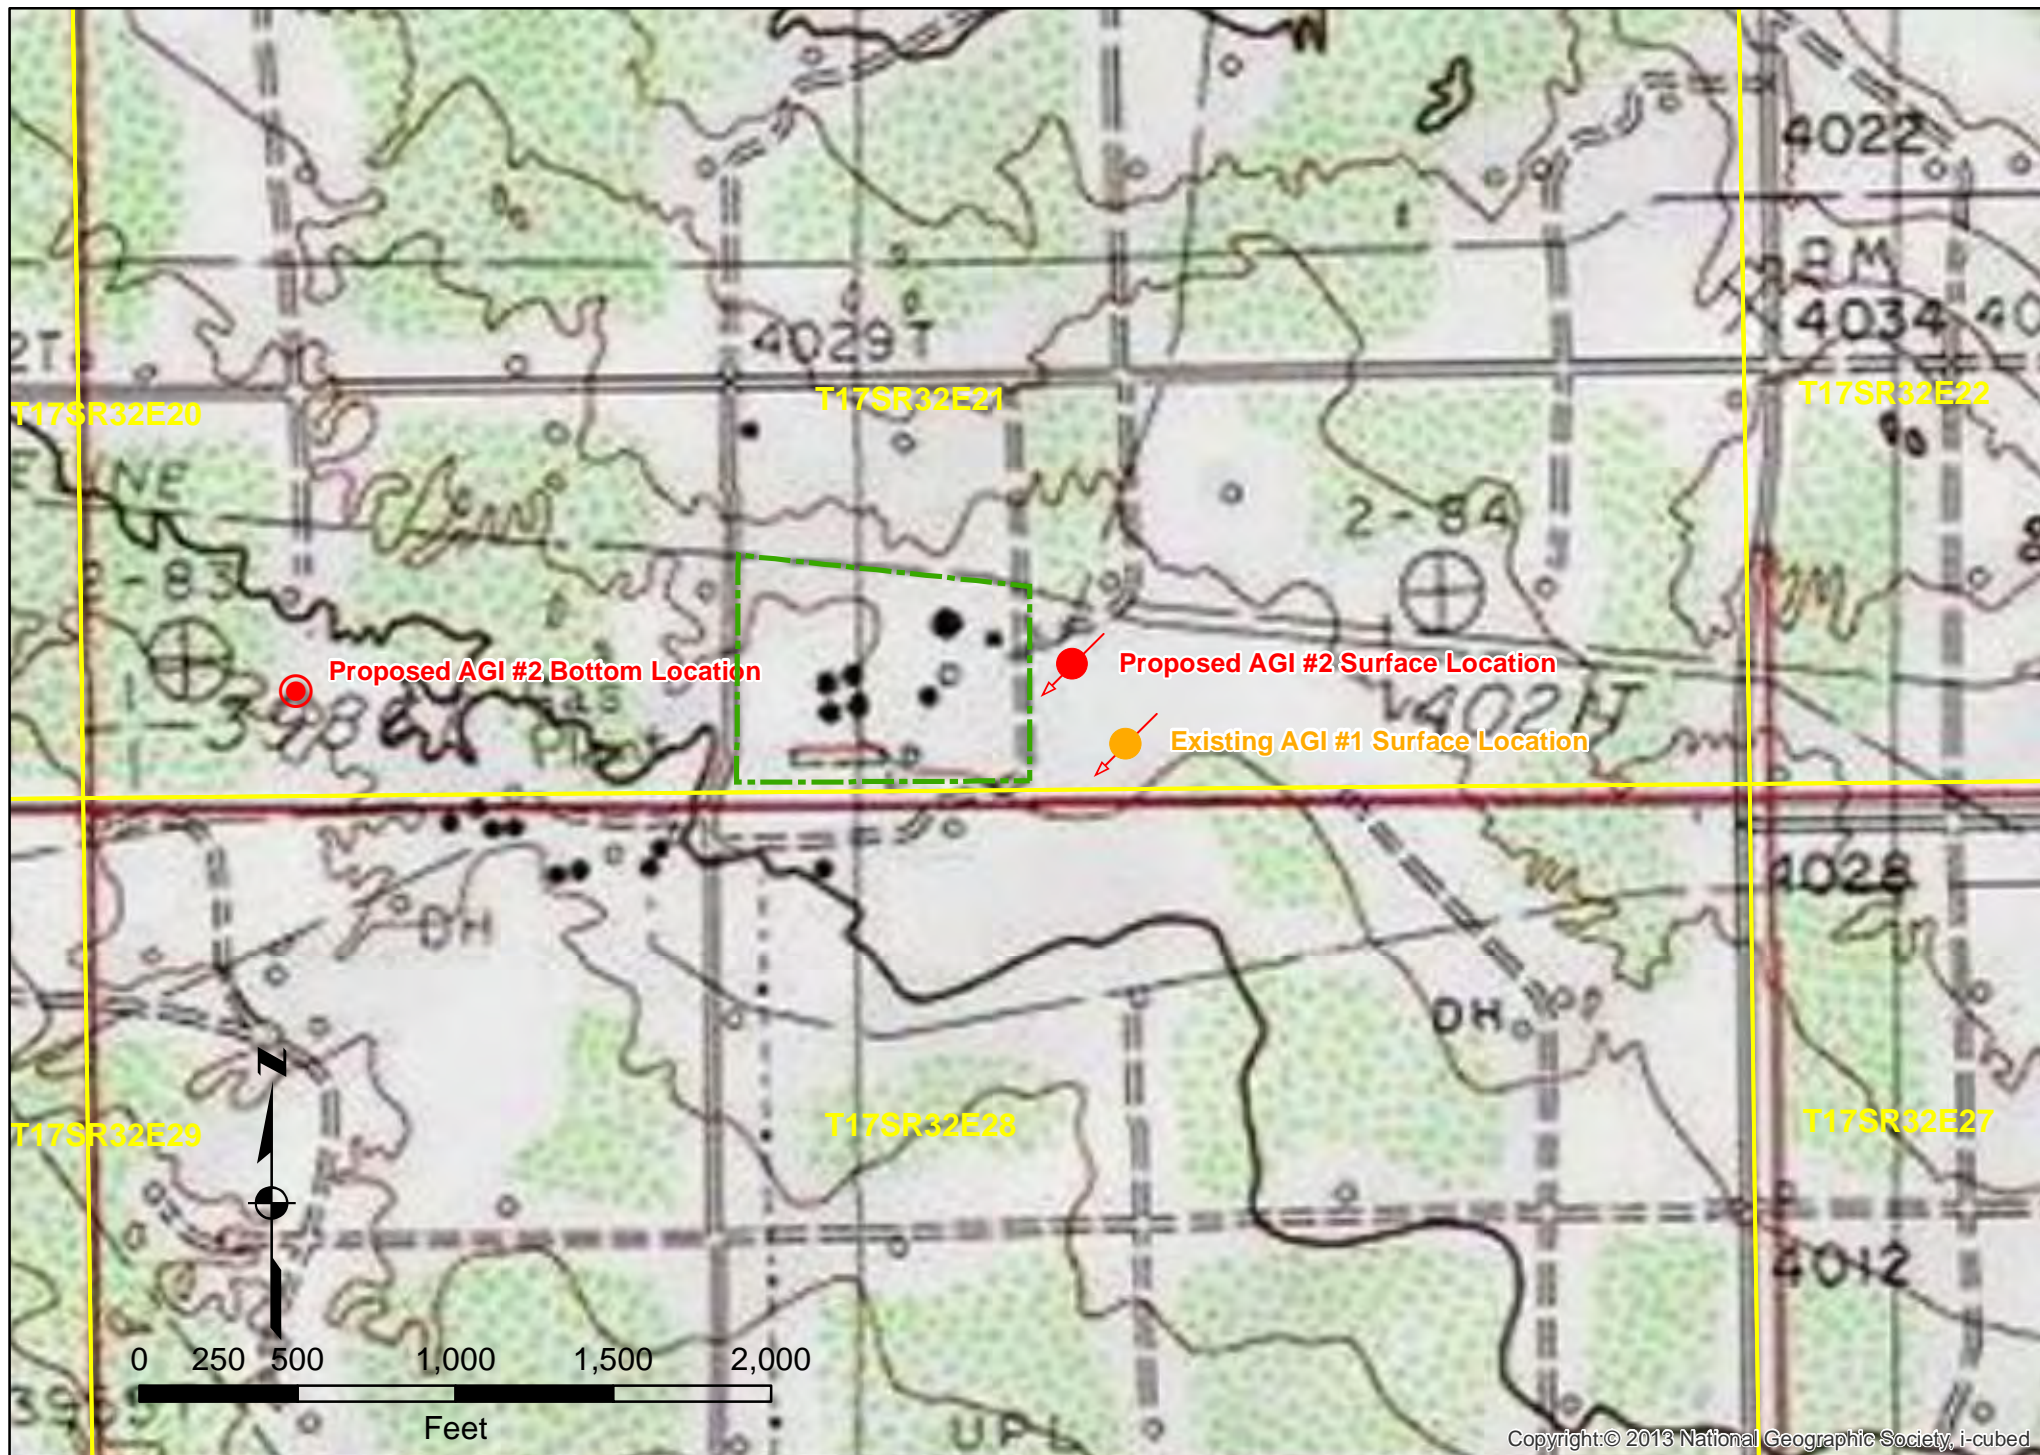


AGI #1: 130' FSL, 1818' FEL, S21 - T17S-R32E  
 AGI #2: 400' FSL, 2100' FEL, S21 - T17S-R32E

Figure 2b  
 Locations of Maljamar AGI #1 and AGI #2








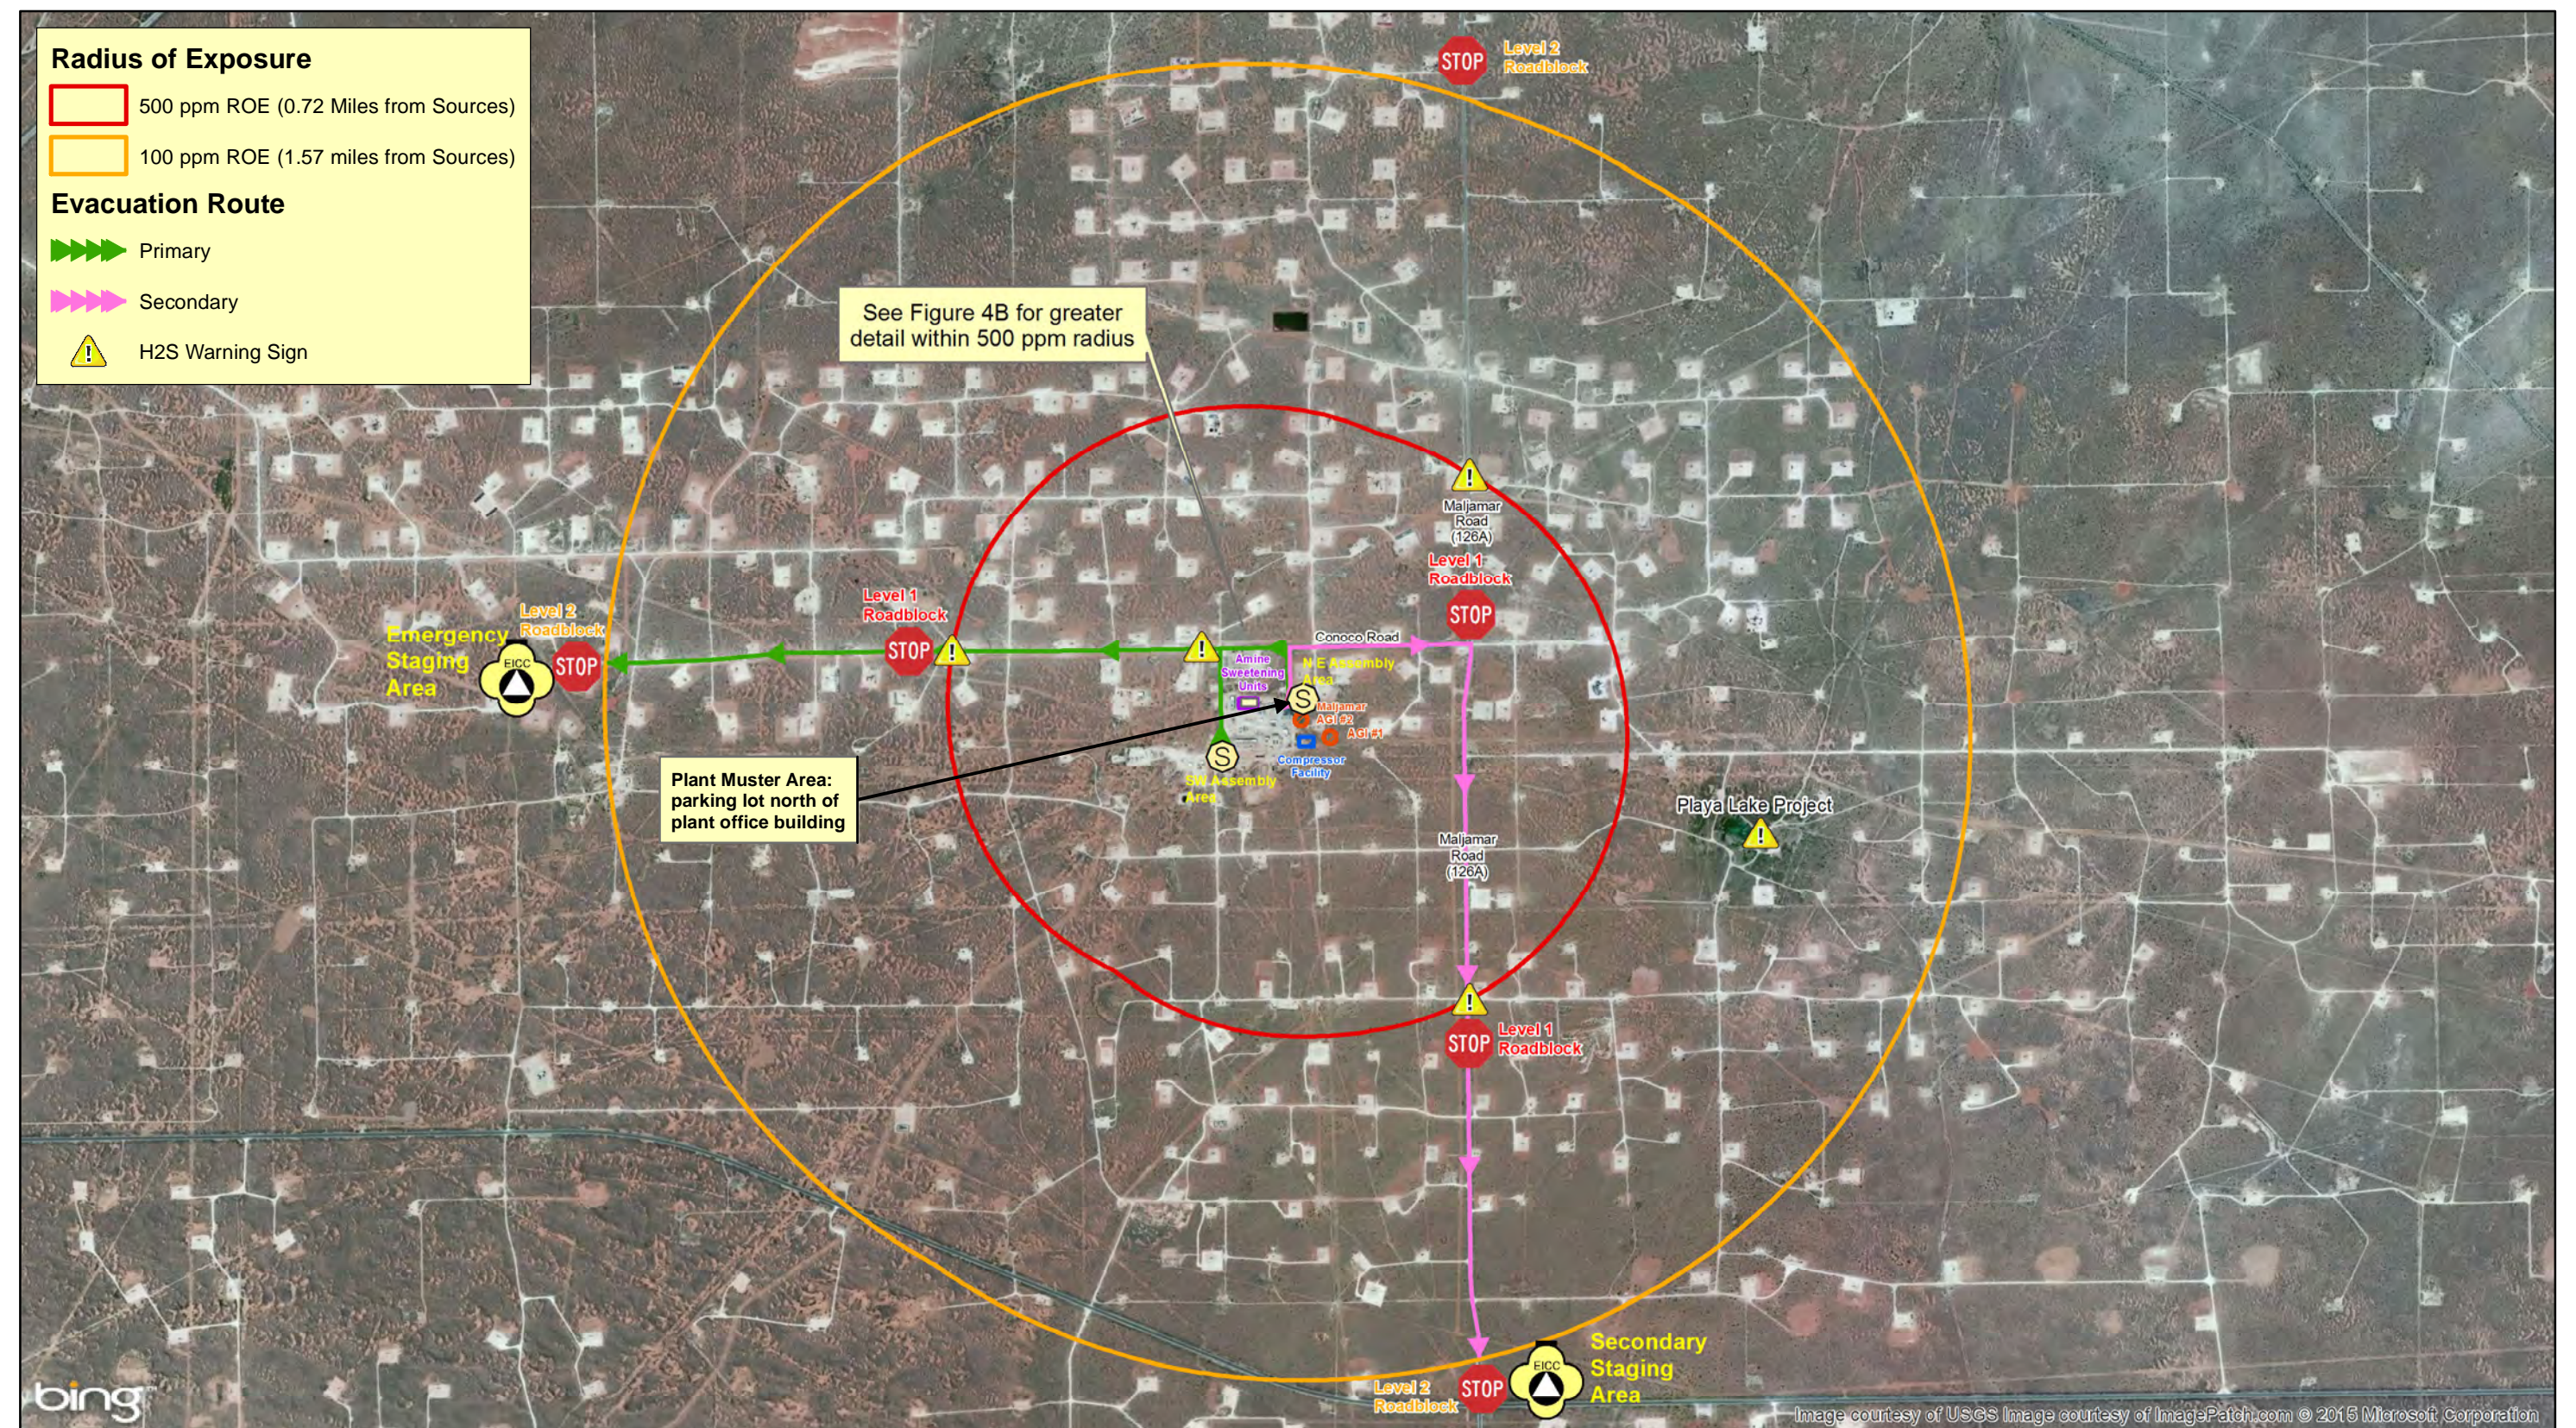

Author: Ed McCasland; Modified by: Michael Mixer  
 Path: \\gfhshares\GISData\USER\_DATA\AKA\Projects\Workspace\Users\mmixer\151028\_MalEmergencyRoutes\_Coufa\Mal\_H2S\_ROE\_150700\_BL\_4A.mxd  
 Coordinate System: NAD 1983 UTM Zone 13N  
 Projection: Transverse Mercator  
 Datum: North American 1983  
 False Easting: 500,000.0000  
 False Northing: 0.0000  
 Central Meridian: -105.0000  
 Scale Factor: 0.9996  
 Latitude Of Origin: 0.0000  
 Units: Meter



1 inch = 2,167 feet  
 Date: 10/28/2015

**Figure 4A: 500 and 100 ppm H2S ROE Map  
 Roadblocks, Evacuation Routes and  
 Emergency Assembly Areas**


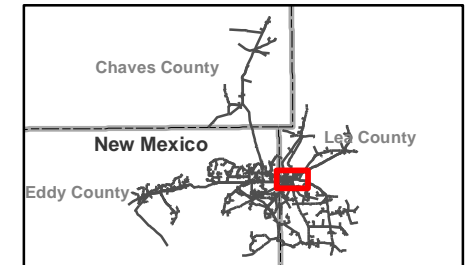


Image courtesy of USGS Image courtesy of ImagePatch.com © 2015 Microsoft Corporation



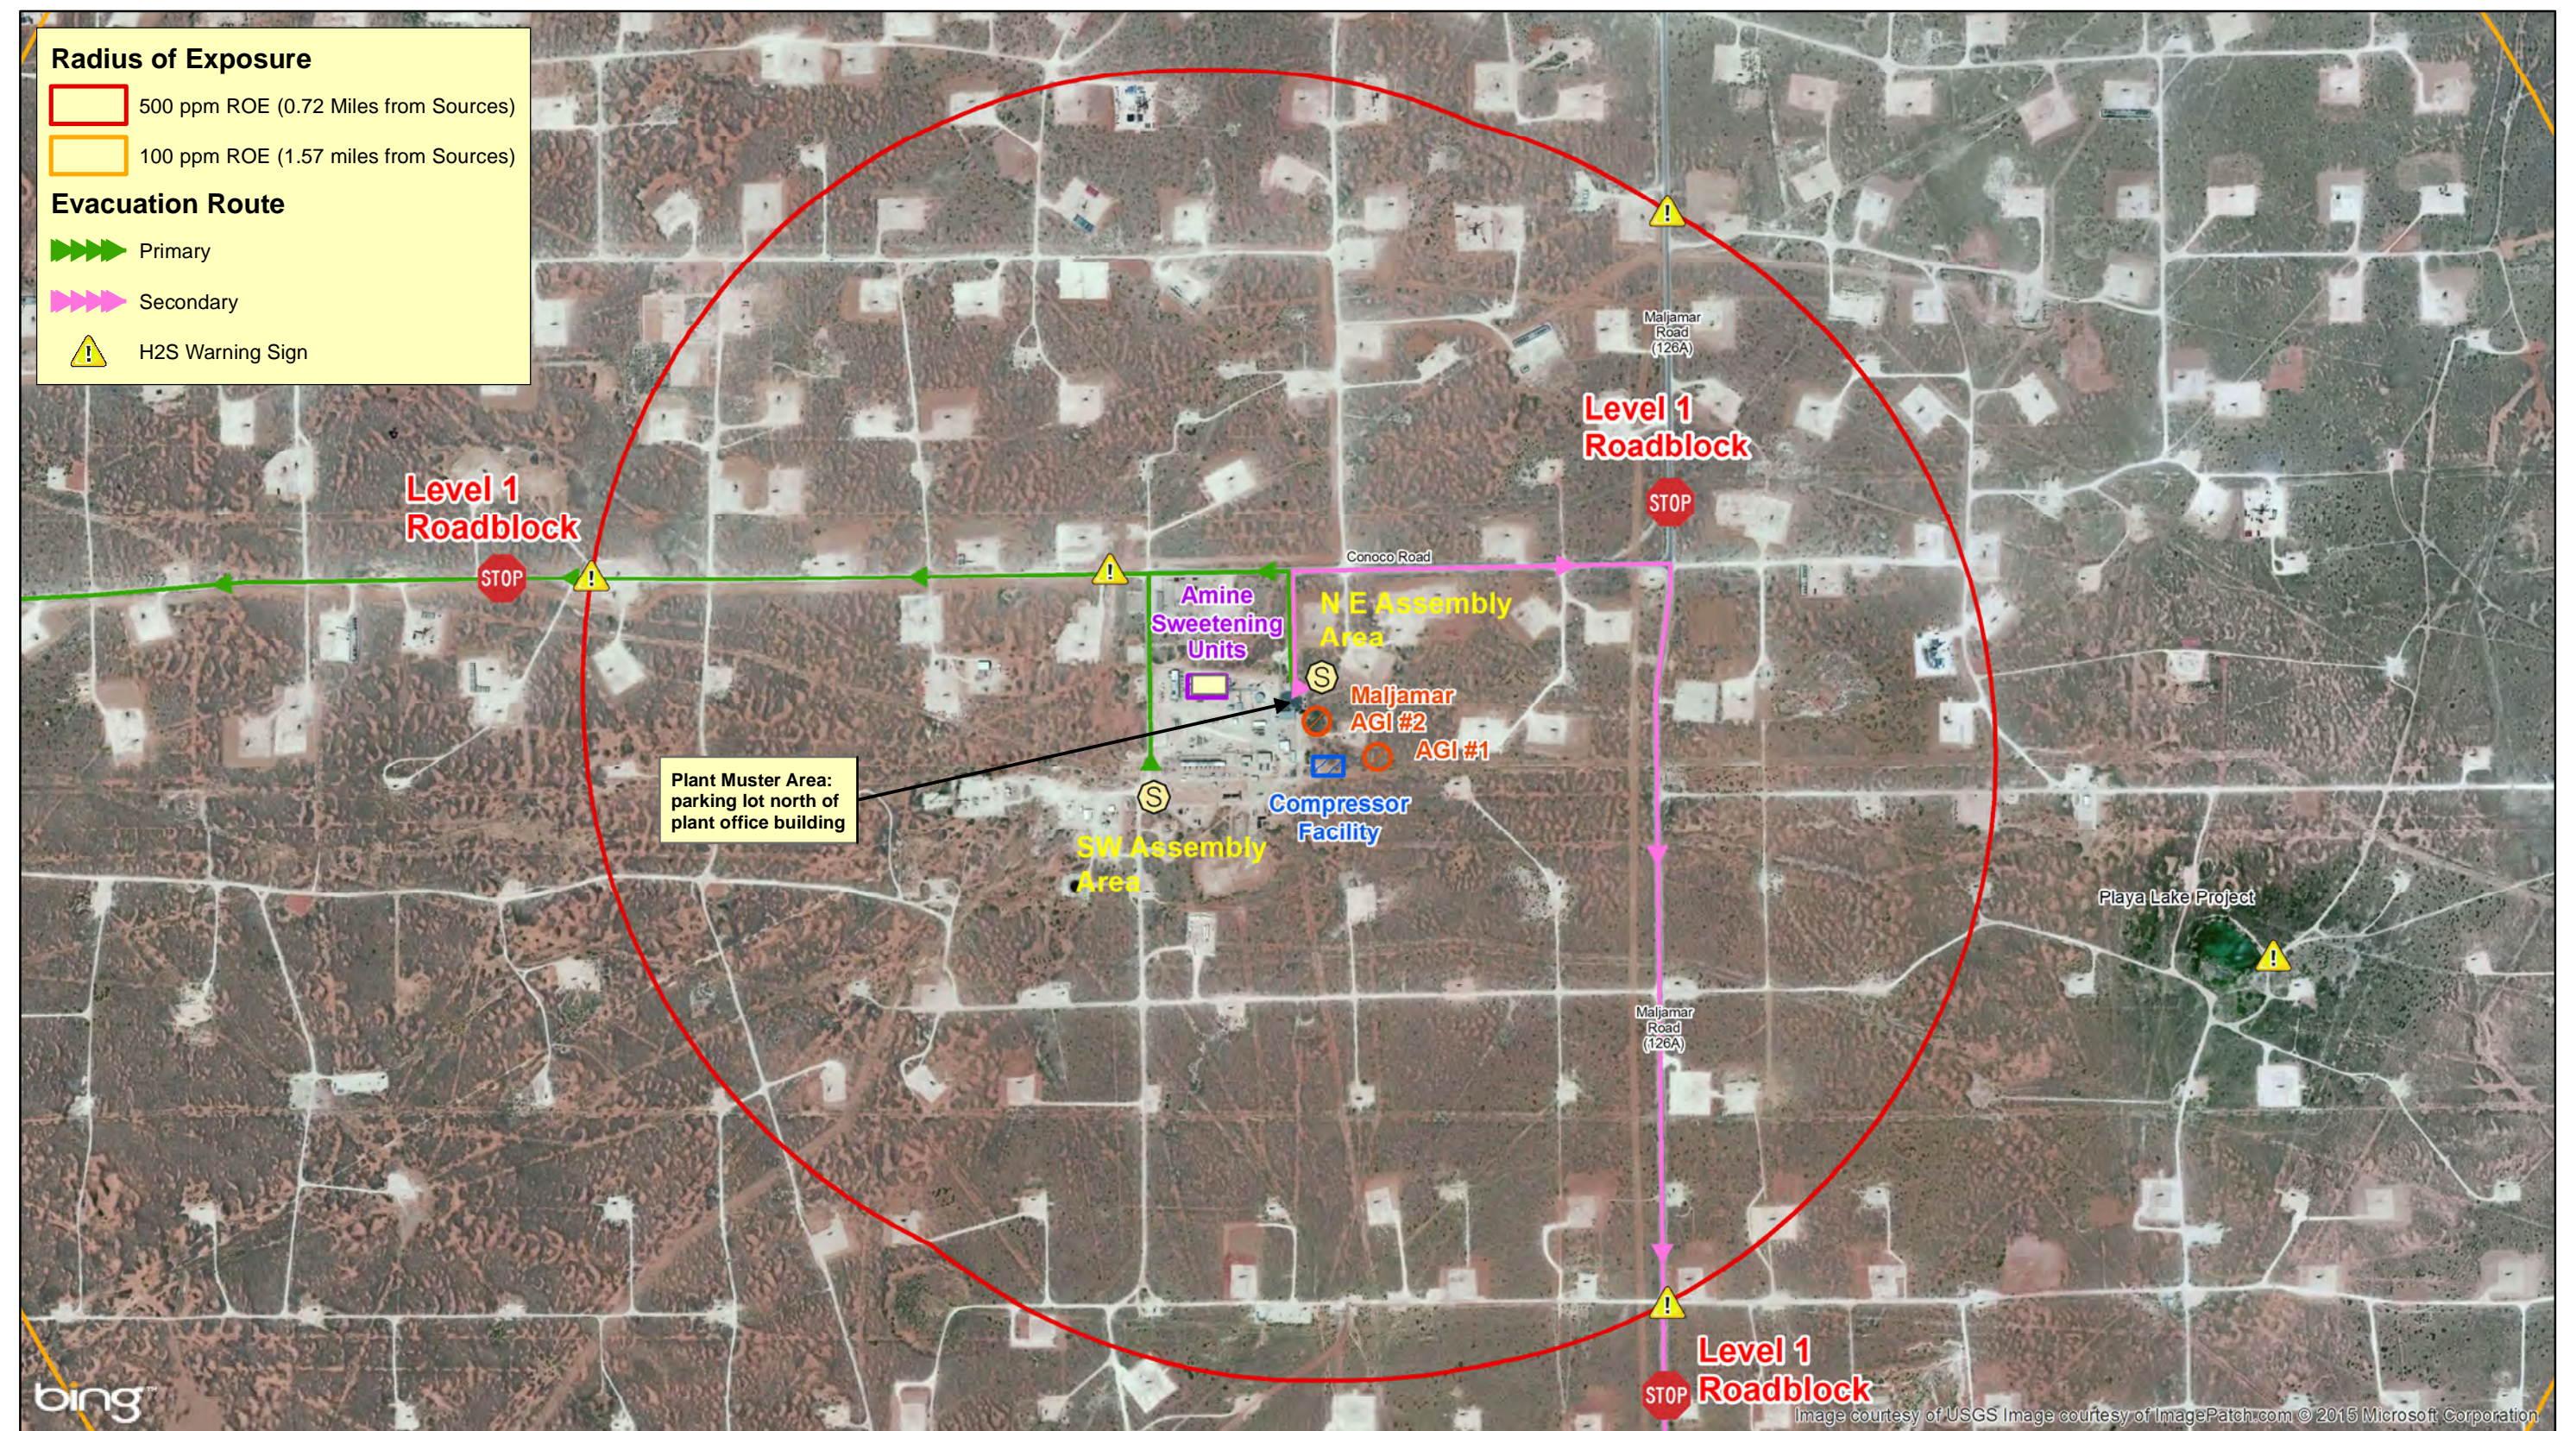


0 0.125 0.25 0.5 Miles

Author: Ed McCasland; Modified by: Michael Mixer  
 Path: \\gfs\shares\GIS\DATA\USER\_DATA\AKA\Projects\Workspace\Users\mmixer\151028\_MalEmergencyRoutes\_Coufa\Mal\_H2S\_ROE\_150700\_BL\_4B.mxd  
 Coordinate System: NAD 1983 UTM Zone 13N  
 Projection: Transverse Mercator  
 Datum: North American 1983  
 False Easting: 500,000.0000  
 False Northing: 0.0000  
 Central Meridian: -105.0000  
 Scale Factor: 0.9996  
 Latitude Of Origin: 0.0000  
 Units: Meter

1 inch = 1,042 feet


Date: 10/28/2015

**Figure 4B: 500 ppm H2S ROE Map Detail  
 Roadblocks, Evacuation Routes and  
 Emergency Assembly Areas**

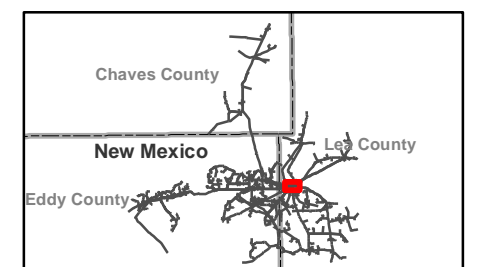



**Location:** 130' FSL & 1831' FEL  
**STR** S22-T17S-R32E  
**County, St.:** LEA COUNTY, NEW MEXICO

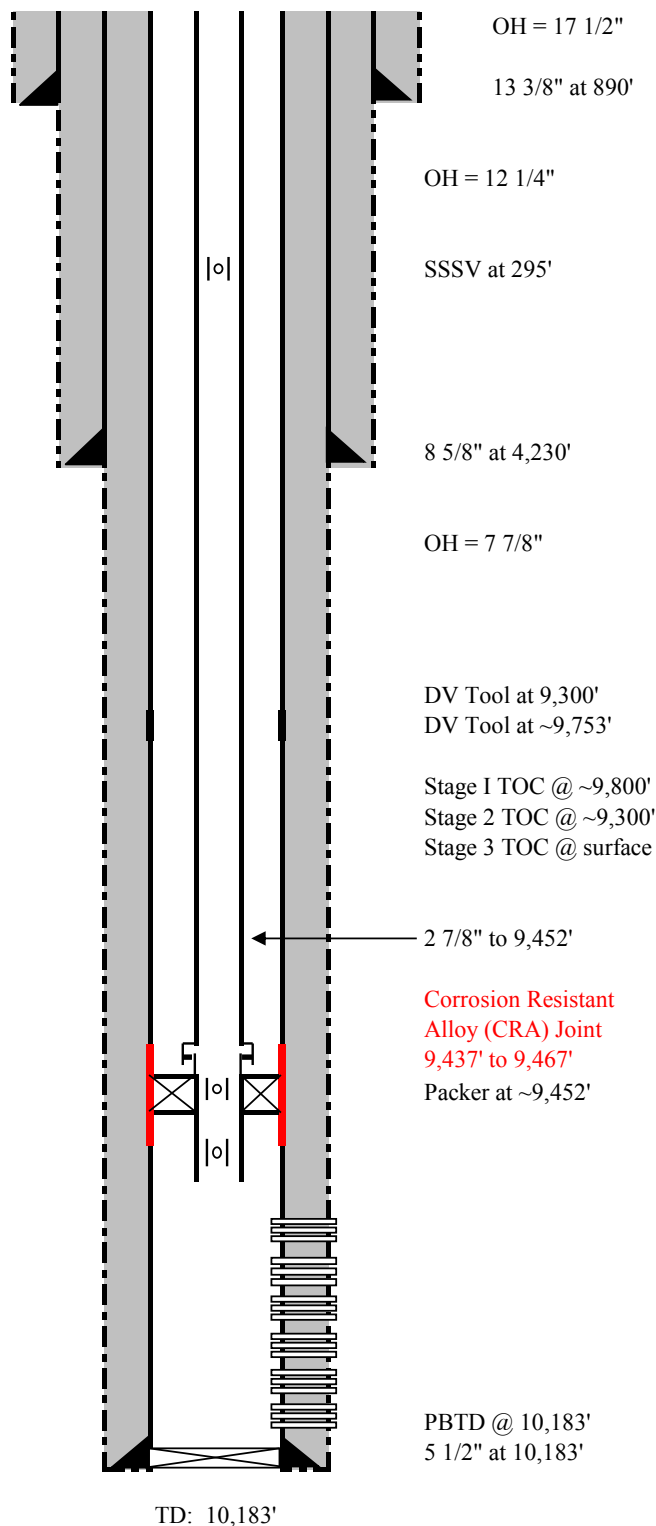

**CONDUCTOR CASING**

20", 94#/ft, J55, STC at 80 ft (Augered and set)

**SURFACE CASING:**

13 3/8", 48.00#/ft, H40, STC at 890'

**INTERMEDIATE CASING:**

8 5/8", 24.0 #/ft, J55, STC at 4,230'

**PRODUCTION CASING:**

5 1/2", 17 #/ft, L80, STC at ~10,183'

**ANNULAR FLUID:**

Corrosion-inhibited diesel fuel from top of packer to surface.

**DEVIATION:**

Stuck string at ~5,200' required cmt plug at 5,157' to ~5,800', redrill w/total deviation ~ 17 feet from original track, returned to track 6,000' for a total deviation at base of hole of less than 50'.

**TUBING:**

Subsurface Safety Valve at 295 ft

2 7/8", 6.5#/ft, L80, Premium thread at ~9,452'

**PACKER:**

Permanent Production Packer

**PERFORATIONS:**

Primary Targets	Perforation Intervals
Upper Wolfcamp (W6)	9,579'-9,632'
Middle Wolfcamp (W5)	9,768'-9,821'
Middle Wolfcamp (W3, W4)	9,850'-9,917'
Middle Wolfcamp (W2)	9,979'-9,997'
Lower Wolfcamp (W1)	10,009'-10,025'
Lower Wolfcamp (W0)	10,090'-10,130'

All zones perforated with 4 spf @ 90 degrees


**Note:**

Christmas tree and SSSV provide redundant safety features to control the well under pressure and provide accessibility to safely bring the well under control in the event of any mechanical problem.

**Figure 5b**  
Schematic of AGI #2 Well Design

**Location:** Frontier Field Services Maljamar Gas Plant  
3 miles south of Maljamar, NM  
**STR** Section 21, T17S, R32E  
**County, St.:** LEA COUNTY, NEW MEXICO

## 29.30° INCLINE

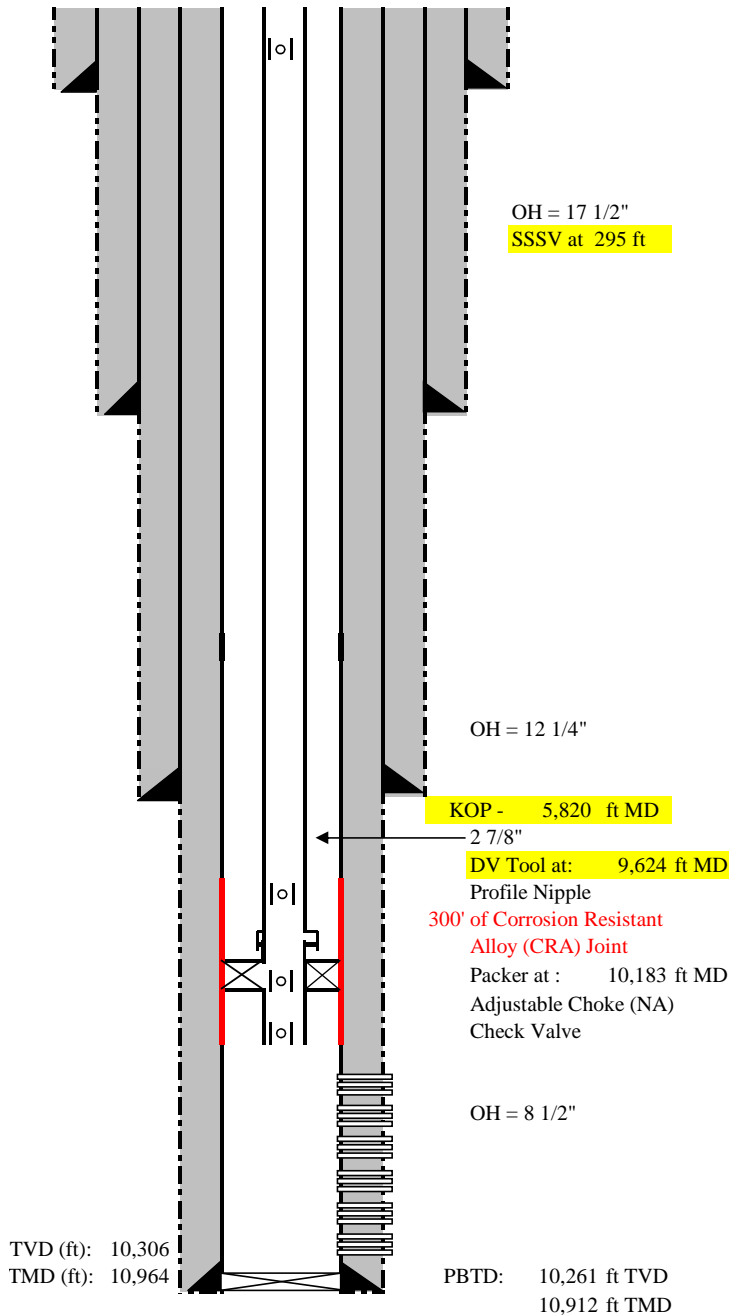

CONDUCTOR CASING	TVD (ft)	MD (ft)
20" Conductor	20	20

SURFACE CASING	TVD (ft)	MD (ft)
13 3/8", 48.00#/ft, H40, STC	890	890
Cemented to Surface		

INTERMEDIATE CASING:	TVD (ft)	MD (ft)
9 5/8", 40.0 #/ft, J55, LTC	5,700	5,700
Cemented to Surface; verified w/CBL		

PRODUCTION CASING:	TVD (ft)	MD (ft)
7", 26 #/ft, HCL-80, LTC	9,400	9,925
7", 26 #/ft, CRA, SM2535 Prem	9,662	10,226
7", 26 #/ft, HCL-80, LTC	10,306	10,964
Cemented to Surface; verified w/CBL		

ANNULAR FLUID:
Diesel Fuel from top of packer to surface

TUBING:	TVD (ft)	MD (ft)
SSSV at 295 ft		
2 7/8", 6.5#/ft, L-80, Prem (internally coated)	9,625	10,183

PACKER:
Permanent Injection Packer @ 10,183 ft MD
Adj. Choke (if needed, placed in nipple below packer)
Check valve (if needed, placed in nipple below packer)


PERFORATIONS:
6 Shots per foot at 60 degrees

	TVD (ft)	TMD (ft)
Calculated Injection Zone Top in WC	9,673	10,238
Calculated Injection Zone Bottom in WC	10,238	10,886
Specific sections of the inj.zone will be perforated based on elogs		

Bottom Location: 350 FSL 650 FWL Sec 21, T17S, R32E

**Note:**  
Christmas tree and SSSV provide redundant safety features to control the well under pressure and provide accessibility to safely bring the well under control in the event of any mechanical problem.


**FIGURE 6**  
**FRONTIER MALJAMAR PLANT**  
**SCHEMATIC OF AGI FACILITY**

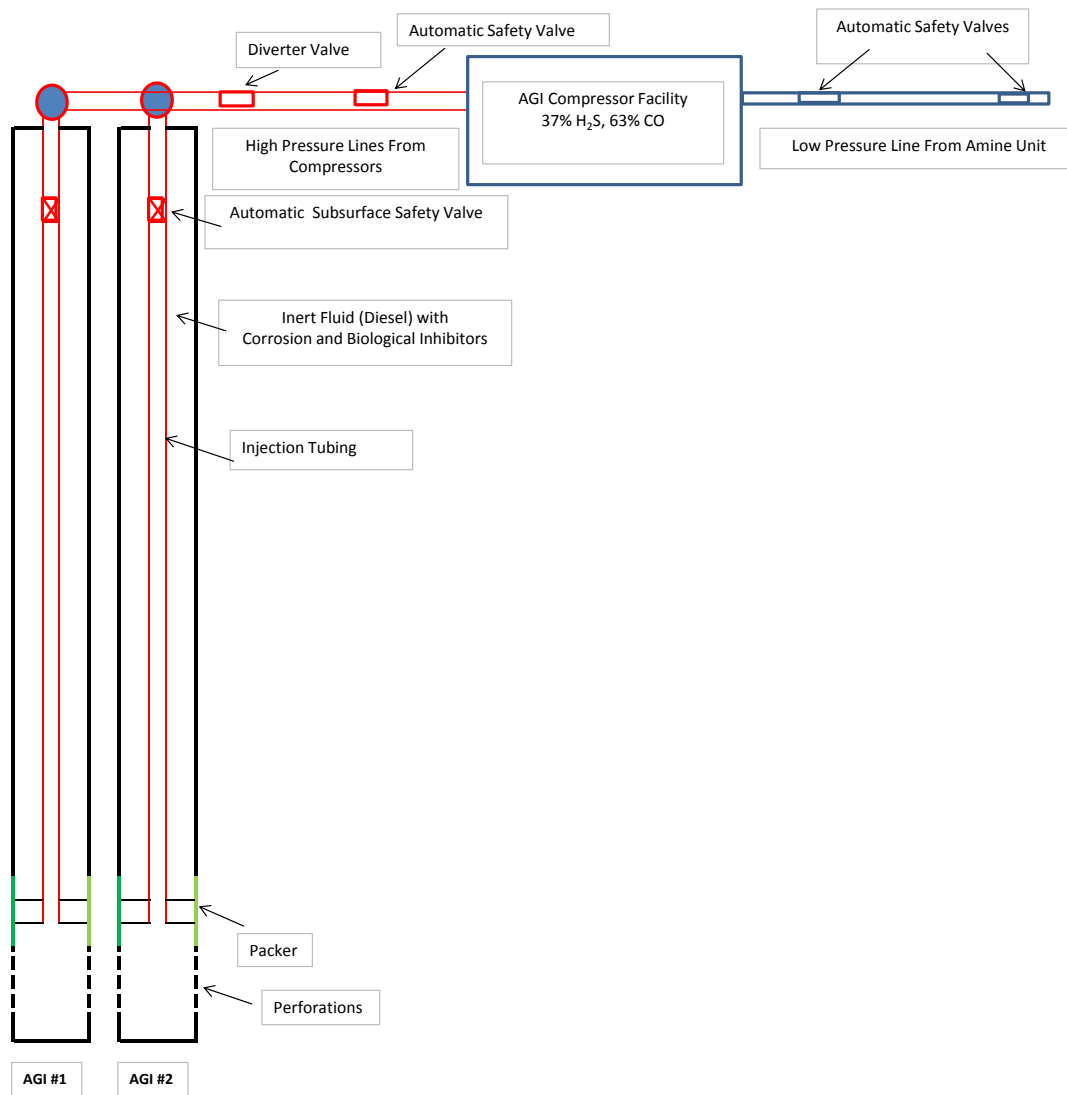

Maljamar AGI #1 API #30-025-40420  
Maljamar AGI #2 API #30-025-42628

NOTE: THIS DRAWING IS NOT TO SCALE



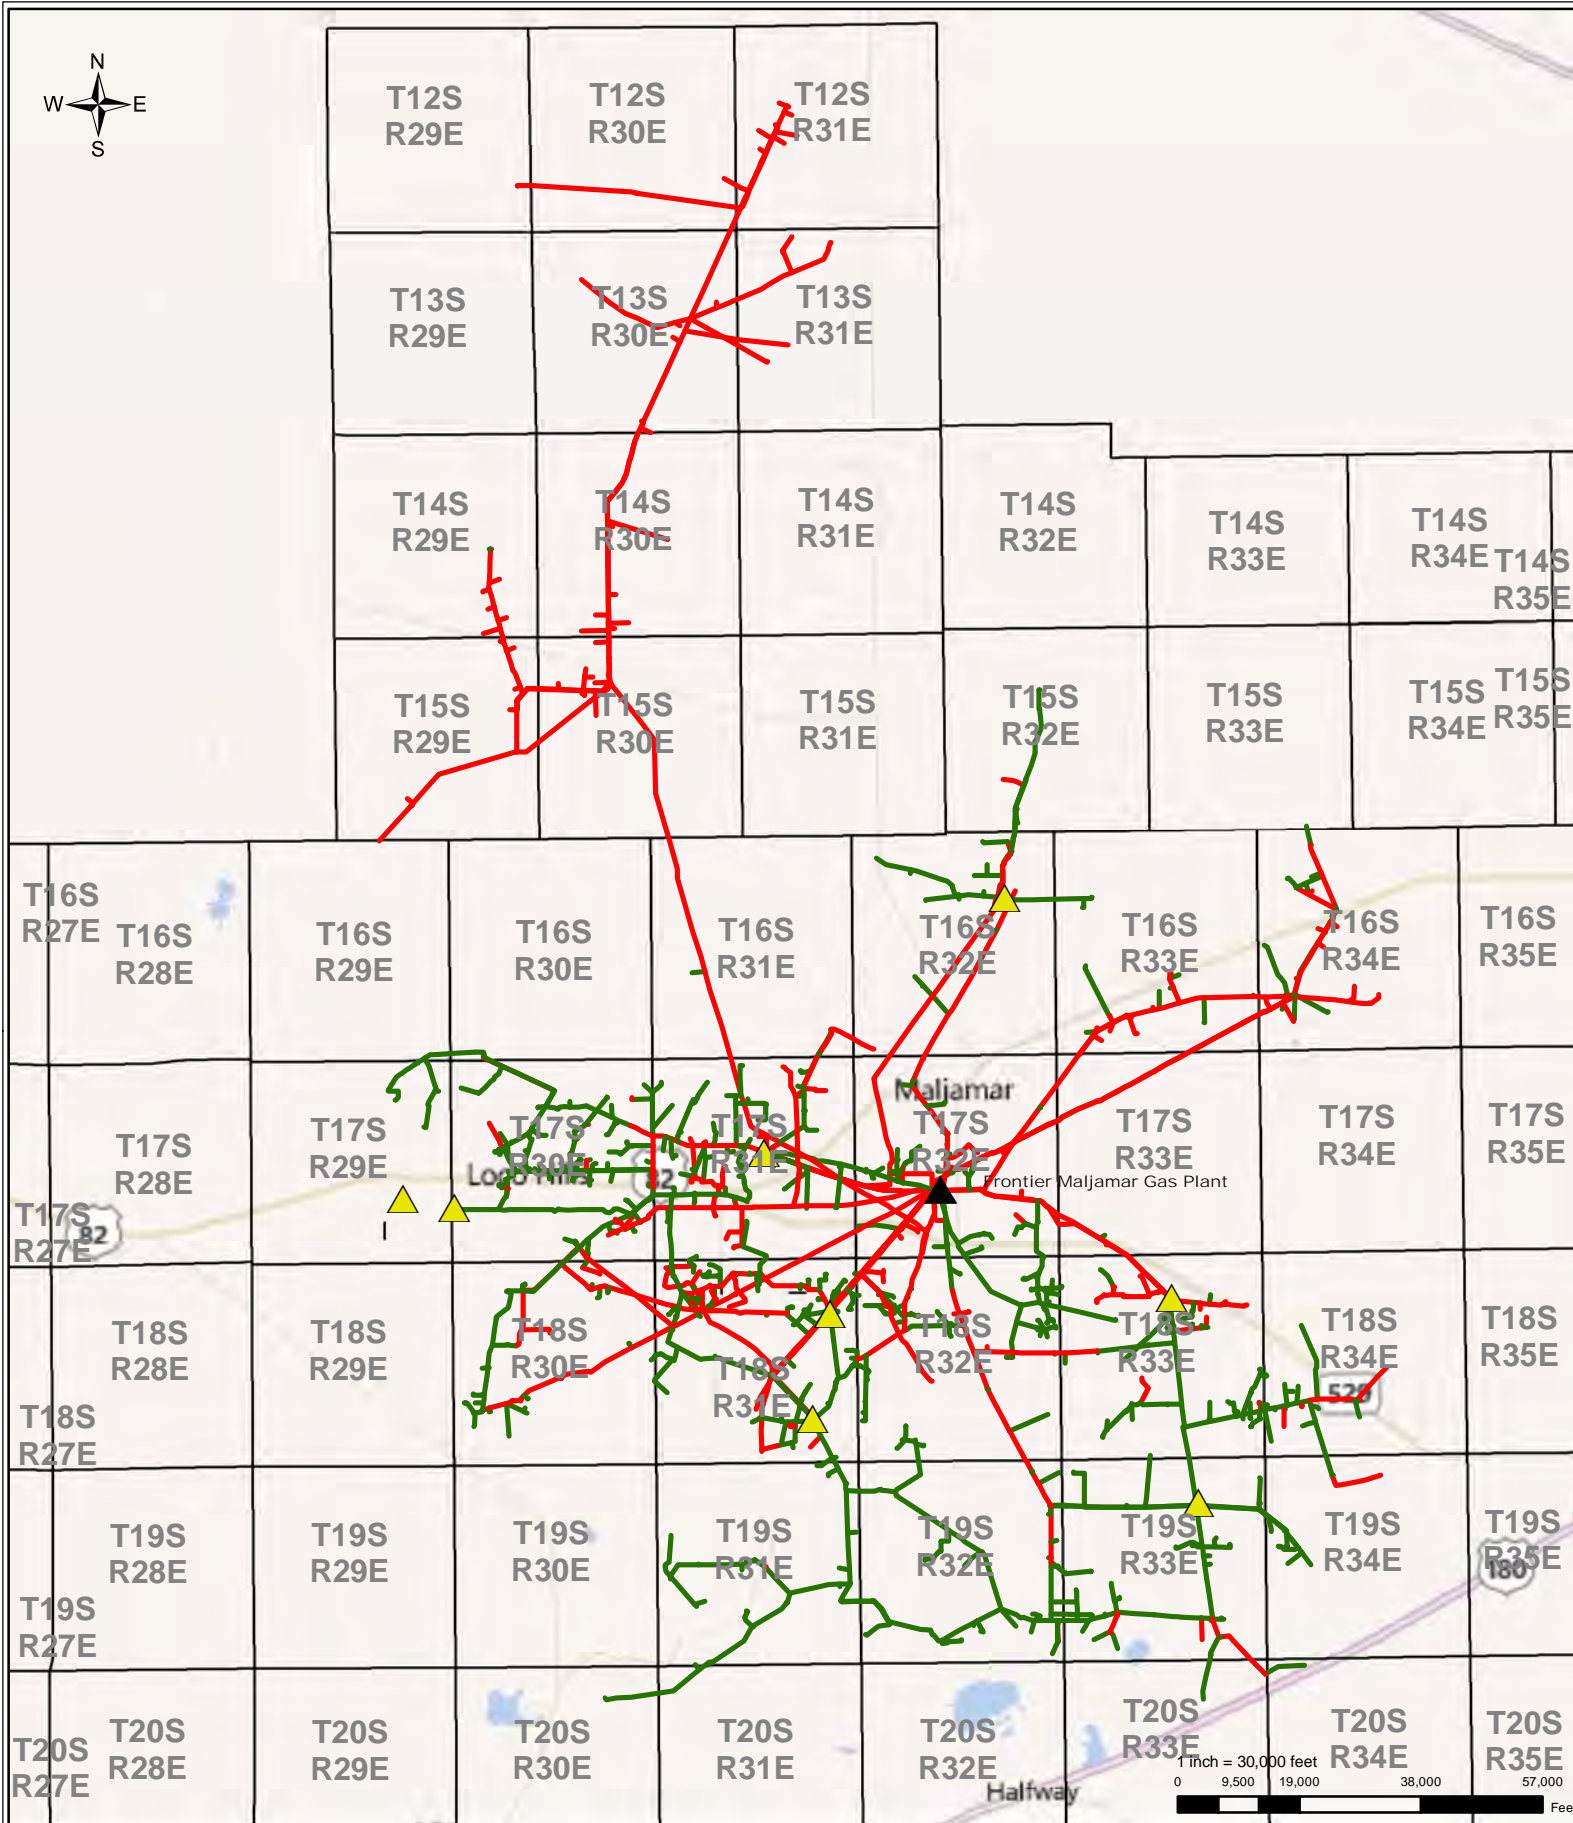

Date: 11/14/2012

Figure 7a Gathering System for Frontier Maljamar Plant

Coordinate System: NAD 1983 UTM Zone 13N  
 Projection: Transverse Mercator  
 Datum: North American 1983  
 false easting: 500,000.0000  
 false northing: 0.0000  
 central meridian: -105.0000  
 scale factor: 0.9996  
 latitude of origin: 0.0000  
 Units: Meter



### Legend


Compressors/Boosters

### Maljamar Pipeline

#### Type

POLYETHYLENE

STEEL

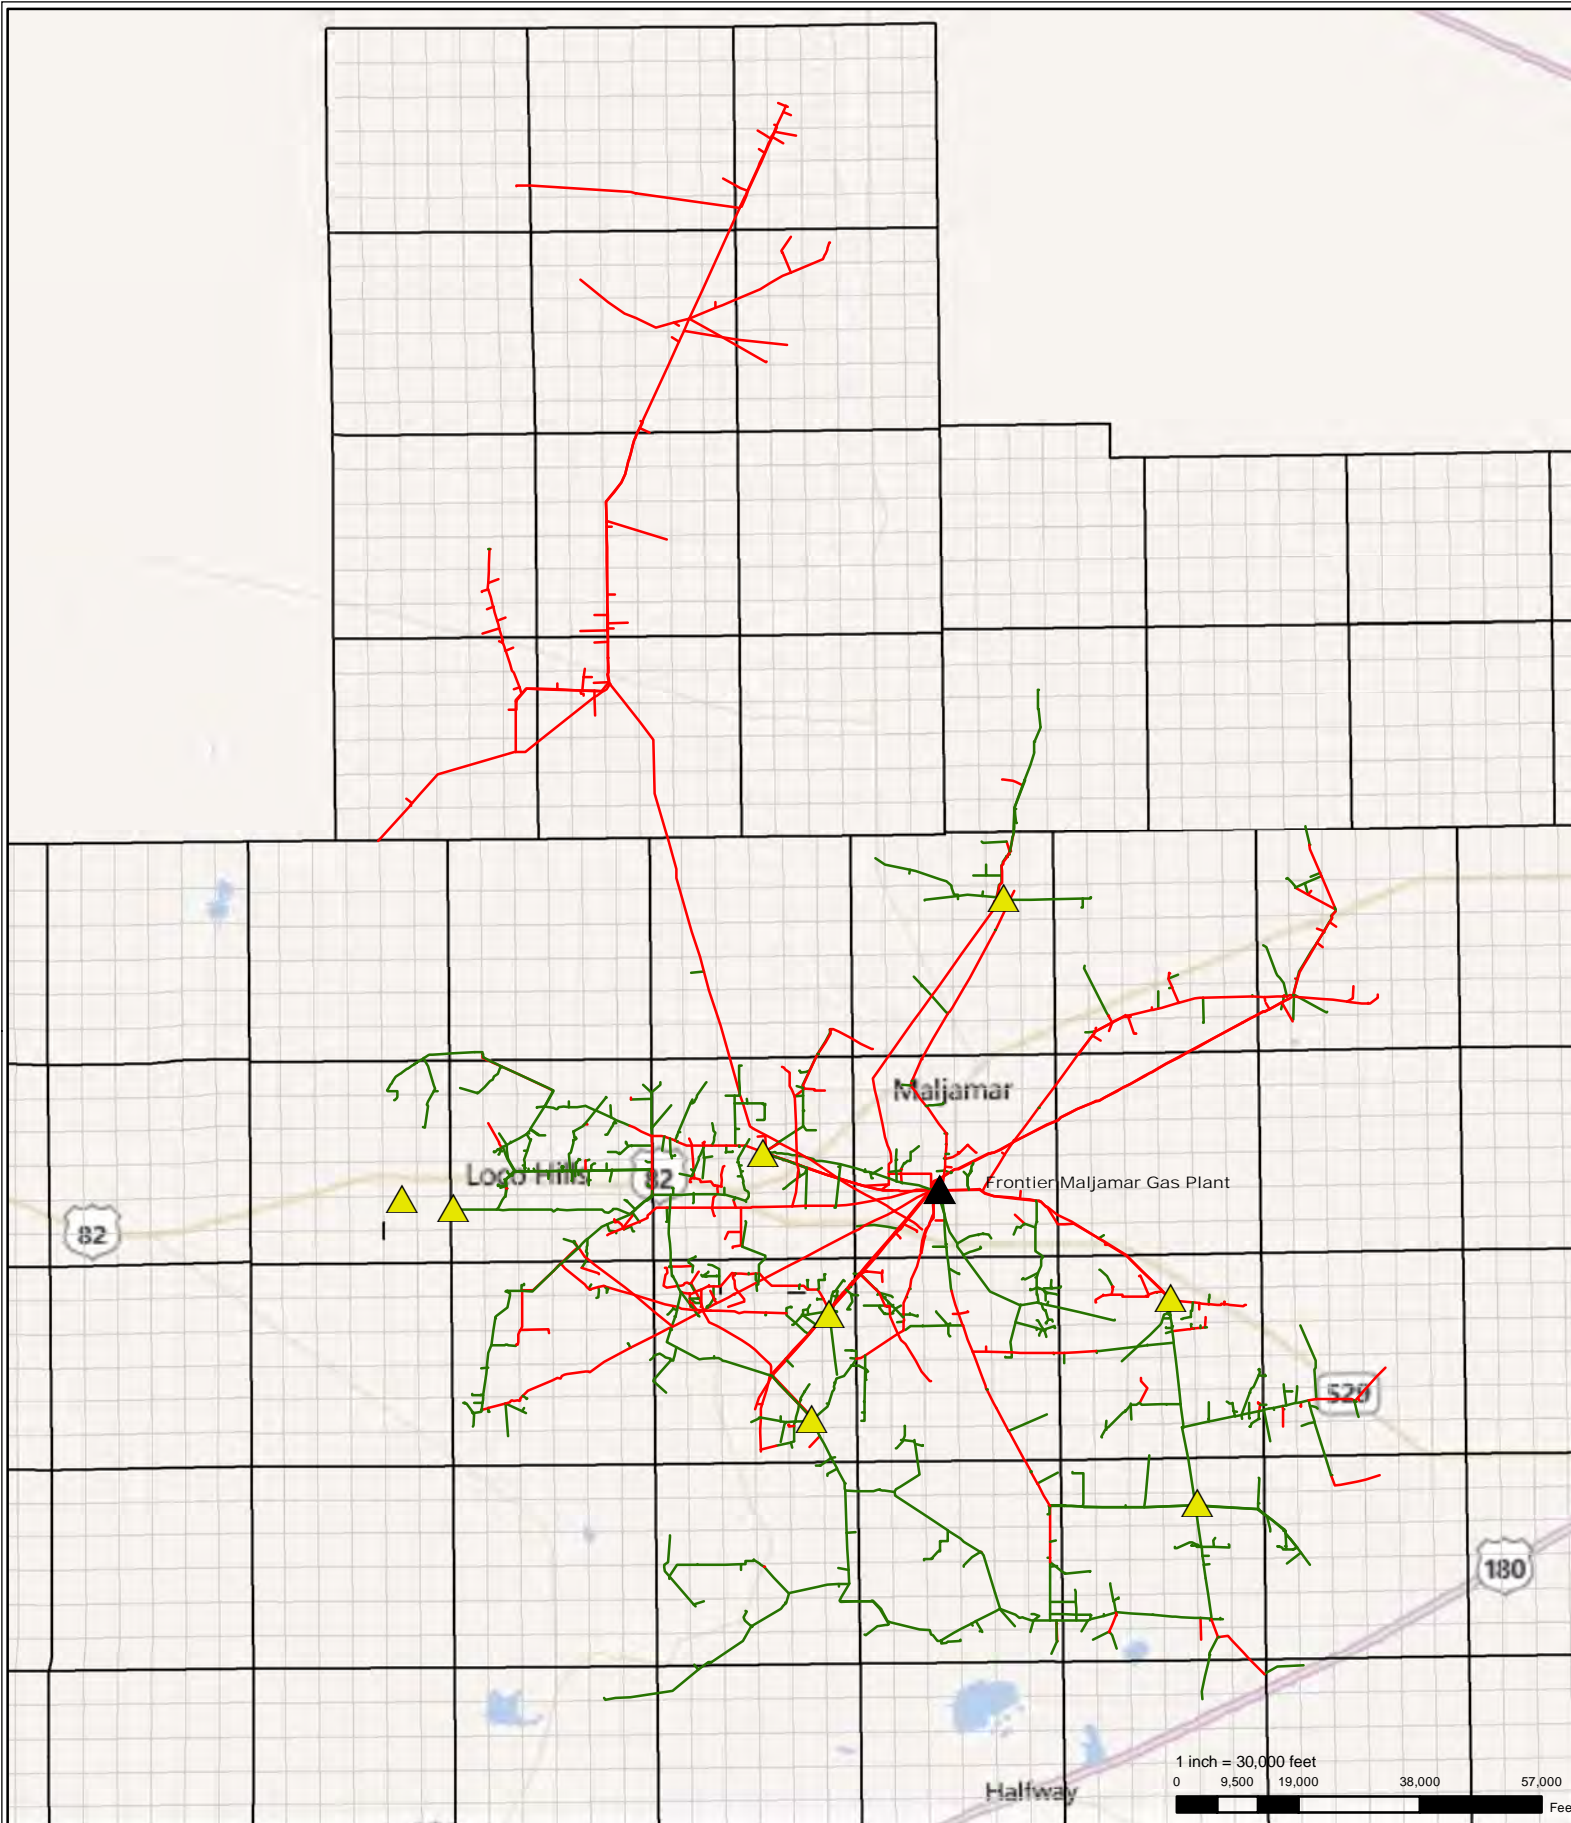

Date: 11/14/2012

Author:

Coordinate System: NAD 1983 UTM Zone 13N

Projection: Transverse Mercator

Datum: North American 1983

false easting: 500,000.0000

false northing: 0.0000

central meridian: -105.0000

scale factor: 0.9996


latitude of origin: 0.0000

Units: Meter

Figure 7b Gathering System for Frontier Maljamar Plant



### Legend

Compressors/Boosters 

### Maljamar Pipeline

#### Type

 POLYETHYLENE


 STEEL



Figure 8





FIGURE 9a





FIGURE 9b



## **APPENDICES**

## **APPENDIX A**

### **IMMEDIATE ACTION PLANS**

## **Level 1 Response – IMMEDIATE ACTION PLAN**

### **Alarm:**

Continuous audible alarm sounded and flashing blue lights activated for H<sub>2</sub>S at 10 ppm or greater.

### **Preliminary Actions:**

1. At the initial sound of the alarm all company personnel working in the area of the alarm will proceed to the Plant Control Room. All visitors/contractors proceed to the Plant Muster Area (see Figures 4a and 4b). Any person in distress will be assisted from the area, so long as doing so does not pose a danger to others.
2. Plant Supervisor or Lead Operator verifies that alarm is not false and makes initial determination of cause. If alarm is not immediately resolved, activate H<sub>2</sub>S Contingency Plan Level 1 Response.

### **Level 1 Response Actions:**

1. Plant Supervisor or Lead Operator verifies that alarm is not false and determines magnitude of the release and attempts to correct the situation from the Control Room.
  - a. Field Office Administrator (FOA) will take a radio, cell phone and H<sub>2</sub>S monitor to the Plant Muster Area (see Figures 4a and 4b) and conduct roll call for visitors/contractors.
  - b. FOA or designated Plant personnel will monitor air quality at the Plant Muster Area for H<sub>2</sub>S concentrations.
  - c. If the muster area becomes untenable (H<sub>2</sub>S % >10 ppm) personnel will proceed to the NE Assembly Area (see Figures 4a and 4b).
  - d. The Plant Supervisor or Lead Operator may direct visitors/contractors gathered at Plant Muster Area to move to NE Emergency Assembly Area (see Figures 4a and 4b) or to leave the area and not return until further notice on the basis of wind directions, magnitude of release, etc.
2. Plant Supervisor or Lead Operator will call to request back-up if after hours.
3. Plant Supervisor or Lead Operator will designate teams with 30 minute SCBA to take corrective action in the area of the release, and if necessary, initiate AGI or Amine Unit shutdown to resolve the release.
4. Plant Supervisor or Lead Operator will notify local emergency responders if deemed necessary.
5. Designated personnel will continue to monitor H<sub>2</sub>S levels
6. If H<sub>2</sub>S increases to  $\geq 20$  ppm, at the direction of the Plant Supervisor or Lead Operator, the Plant will be evacuated. The Lead Operator will designate necessary operations personnel to remain to assist with Plant shutdown.
7. The Plant Supervisor or Lead Operator will activate the evacuation horn. Depending on prevailing wind conditions all personnel will proceed to either the NE Assembly Area or the SW Assembly Area (see Figures 4a and 4b).
  - a. FOA will use Plant sign in sheet and radio to communicate with those at the SW Assembly area to account for personal.
  - b. Designated personnel will monitor air quality at Assembly Area for H<sub>2</sub>S Concentrations.
  - c. If either Assembly Area becomes untenable (H<sub>2</sub>S % >10 ppm) personnel will proceed to the appropriate Emergency Staging Area (see Figures 4a and 4b).
  - d. Roadblocks will be established by designated personnel in order to prevent anyone from entering the 500 ppm ROE (see Figures 4a and 4b).
  - e. Personnel designated by the Plant Supervisor or Lead Operator will notify all entities and individuals within 500 ppm ROE and advise to standby for further instructions. They may be asked to shelter-in-place or evacuate, depending on prevailing wind direction and magnitude of the release. They will also be directed to advise any of their personnel planning to work in the area not to enter until further notice.
  - f. Designated personnel will Contact Mid-America Pipeline Company and Enterprise/Chaparral Pipeline Company unmanned meter station and the unmanned Conoco-Phillips Field Warehouse, and if individuals are present advise them that the Plant is being evacuated and to shelter-in-place or evacuate, depending on prevailing wind direction and magnitude of the release. They will also be instructed to advise any of their personnel planning to work in the area not to enter the area until further notice.
  - g. Designated personnel will make a visual inspection of the 500 ppm ROE and relocate any individuals observed there to the NE or SW Assembly Area.



8. When personnel are clear of the Plant, the Plant Supervisor or Lead Operator will activate Plant ESD and with any remaining personnel choose to either shelter in place or evacuate to an Assembly Area or Staging Area, depending on conditions on site including wind direction, status of the release, etc.
9. The LEPC and law enforcement will be contacted by phone and notified of the release and status of containment. Communications with arriving emergency responders will be established, and the Plant manager, Plant supervisor or their designee will participate in their Unified Incident Command Structure as requested. A situation report will be delivered to Incident Command.
10. The OCD shall be notified within four hours of any release that activated this Plan. **Per 19.15.11.16 NMAC, notification of Contingency Plan implementation will be submitted to the OCD via form C-141 within 15 days of the release. A copy of Form C-141 is contained in Appendix G.**
11. Maintain Chronologic Record of Events Log.
12. If situation is resolved and monitored levels of H<sub>2</sub>S at the Plant and AGI Facility are less than 10 ppm personnel may re-enter. If H<sub>2</sub>S levels continue to increase and release cannot be controlled: Activate Level 2 response.

## **Level 2 Response – IMMEDIATE ACTION PLAN**

**Alarm: Continuous Plant-wide audible alarm and flashing blue lights.**

### **Activating Conditions:**

- **Corrective actions at Level 1 are unsuccessful.**
- **H<sub>2</sub>S of > 20 ppm detected on any fixed or hand-held monitor.**
- **A catastrophic release, fire or explosion.**
- **A continuous release of maximum volume for 24 hours occurs.**
- **As per NMAC 19.15.11 activate the plan whenever a release may create a hydrogen sulfide concentration of more than 100 ppm in a public area, 500 ppm at a public road or 100 ppm 3000 feet from the site of release.**

### **Level 2 Response Actions:**


1. Plant Supervisor or Lead Operator will immediately activate, or verify activation of Plant ESD.
2. The Plant Supervisor or Lead Operator will activate the Plant evacuation horn. Immediately evacuate or verify evacuation of all company personnel and third party contractors to Emergency Staging Area (see Figures 4a and 4b). Assist any persons in distress to the Emergency Staging Area, so long as doing so does not pose a danger to others.
3. Field Administrative Officer will account for all personnel using Plant sign-in sheet.
4. Plant Supervisor or Lead Operator will call to request back-up if after hours.
5. Plant Supervisor or Lead Operator will dispatch personnel to establish designated roadblocks, blocking entry to 100 ppm ROE (see Figures 4a and 4b).
6. Designated personnel will monitor H<sub>2</sub>S at roadblocks.
7. Designated personnel will notify the following and advise them of release and status of containment:
  - a. Local emergency responders, if deemed necessary,
  - b. Local law enforcement (LEPC) and state agencies, including OCD District office,
  - c. Entities and individuals within the 100 and 500 ROE.
8. Designated personnel will advise all entities within the 500 and 100 ROE either to evacuate or shelter in place, closing windows and shutting off any air conditioning/heating until further notice. Decision whether to evacuate or shelter-in-place will be made on the basis of wind direction, magnitude of release, etc. They will also be directed to advise all of their personnel or third parties scheduled to work in the area not to enter/re-enter until further notice.
9. Designated personnel will establish roadblocks to prevent entry into the 100 ppm ROE (see Figures 4a and 4b).
10. Designated personnel Contact Mid-America Pipeline Company and Enterprise Chaparral Pipeline company unmanned meter station and the unmanned ConocoPhillips field warehouse and if individuals are present, advise to either evacuate to Emergency Staging Area or shelter-in-place, closing windows and shutting off any air conditioning/heating until further notice. The decision to evacuate or shelter-in-place will be made on the basis of wind direction, magnitude of release, etc. They will be instructed to advise any of their personnel scheduled to work in the area not to enter/re-enter until further notice.
11. Designated personnel will make visual inspection of the 500 ppm ROE, and relocate any individual(s) observed in that area to the Emergency Staging Area.
12. Designated personnel will be dispatched to the Conoco Playa Lake Wetland Area to make a physical inspection of the area and advise any member of the public to evacuate and not return until further notice.
13. Designated personnel will establish Media Staging Area adjacent to Emergency Staging Area, and direct all media to it.
14. Designated personnel will Monitor H<sub>2</sub>S at Emergency Staging Area.

15. Plant Supervisor, Lead Operator or designee will establish communication with emergency responders and participate in their Unified Incident Command structure as requested.
16. Situation report will be delivered to Incident Command by Plant Supervisor or designee.
17. If escaping vapors have been ignited, allow to burn unless fire poses danger to the public, other property or equipment.
18. Allow conditions at the Plant to stabilize, relying on engineering controls.
19. Once the release is resolved and  $\text{H}_2\text{S} < 10$  ppm at all locations on Plant.
  - a. Signal all clear.
  - b. Personnel sign in and reenter Plant to resume work.
  - c. Notify outside parties of status.
  - d. Recall roadblocks and restore traffic.
  - e. Initiate chronologic Record of Events Log
  - f. Begin making appropriate external notifications.
  - g. Notify OCD within 4 hours of release.
  - h. Submit Form C-141 to OCD within 15 days of release. A copy of Form C-141 is contained in Appendix G.**

## **APPENDIX B**

### **RESPONSE FLOW DIAGRAMS**

## LEVEL 1 RESPONSE

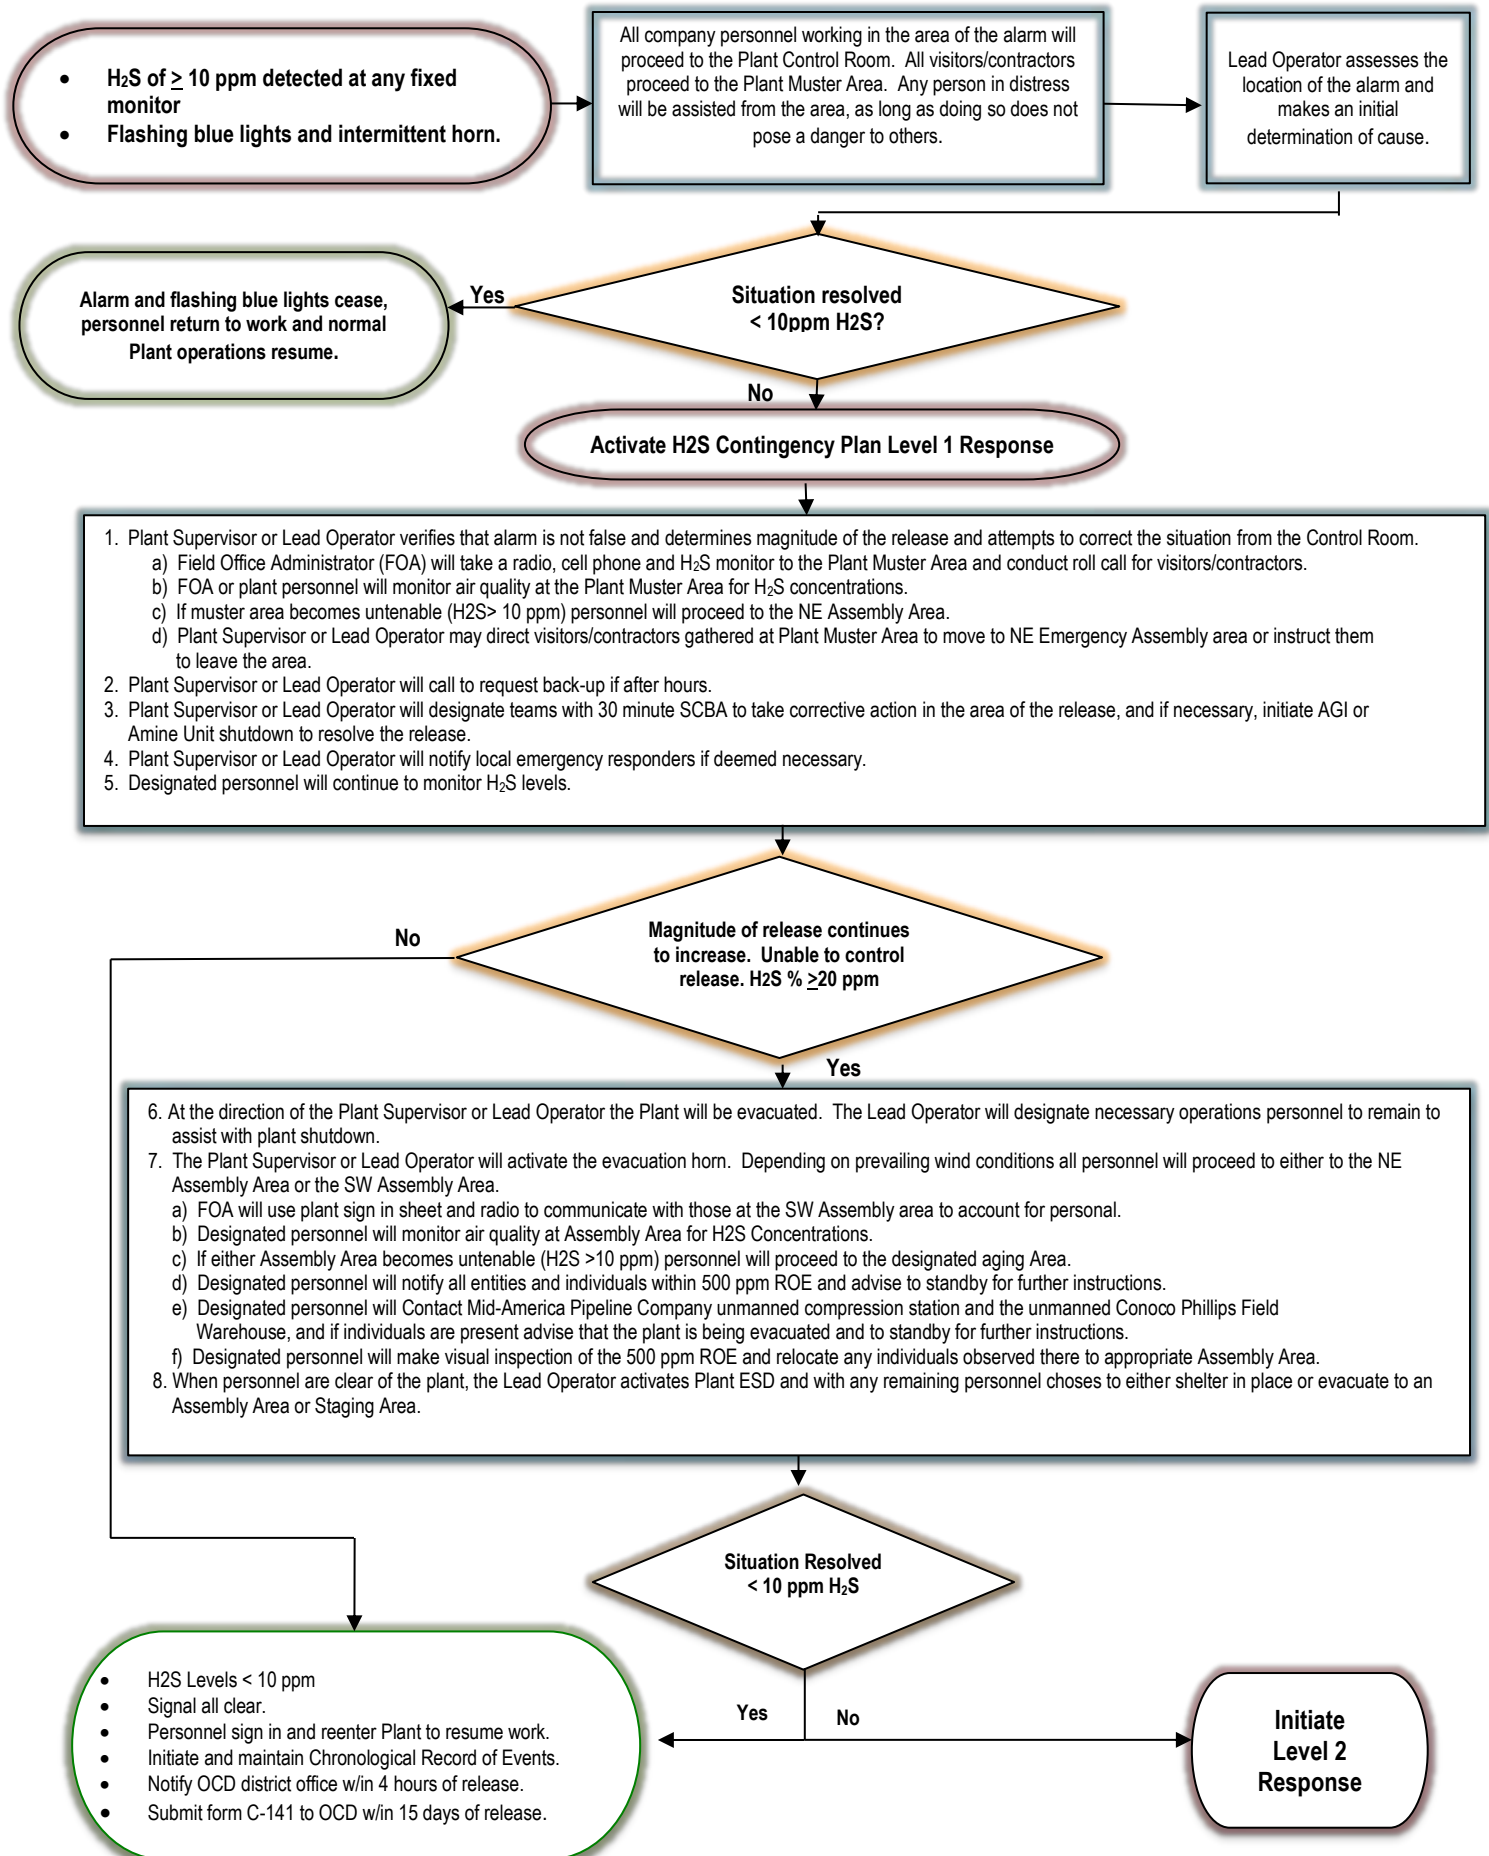

## Level 2 RESPONSE

- Corrective actions at Level 1 are unsuccessful.
- H<sub>2</sub>S of > 20 ppm detected on any fixed or hand-held monitor.
- A catastrophic release, fire or explosion.
- A continuous release of maximum volume for 24 hours occurs.
- As per NMAC 19.15.11 there is indication of 100 ppm H<sub>2</sub>S in any defined public area, 500 ppm at any public road.
- Continuous horn and flashing blue lights.

- Immediately activate, or verify activation of Plant ESD.
- Activate Plant Evacuation Alarm.
- Evacuate all personnel to Emergency Staging Area.
- Assist anyone in distress to Emergency Staging Area if doing so does not pose a danger to others.
- Field Administrative Officer Accounts for all personnel using Plant sign-in sheet.
- Plant Supervisor of Lead Operator will call for back-up if after hours.

**PLANT ESD**  
Verify that Emergency Shut Down to shut down the entire plant, including the AGI and Amine units has been activated.

- Dispatch personnel with emergency trailers to establish designated roadblocks, blocking entry to 100 ppm ROE.
- Monitor H<sub>2</sub>S at roadblocks.

**Notify** the following and advise of release and status of containment:

- Emergency responders.
- Local law enforcement (LEPC) and state agencies, including OCD District office.
- Entities and individuals within the 100 and 500 ROE.
  - Advise to evacuate or shelter in place, closing windows and shutting off any air conditioning/heating until further notice.
  - Instruct all personnel and third parties to leave and not re-enter Plant vicinity until further instructed.
  - Inform of roadblocks.
- Contact Mid-America Pipeline Company and Enterprise/Chaparral Pipeline Company unmanned meter station and the unmanned ConocoPhillips Field Warehouse and if individuals are present, advise to either evacuate to Emergency Staging Area or shelter in place, closing windows and shutting off any air conditioning/heating until further notice.
- Make a visual inspection of Conoco Playa Lake Wetland Area and advise all present to evacuate and not return until further notice.
- Make visual inspection of the 500 ppm ROE, and relocate any individual(s) observed to Emergency Staging Area.

- Establish Media Staging Area adjacent to Emergency Staging Area, and direct all media to it.
- Monitor H<sub>2</sub>S at Emergency Staging Area.

- Plant Supervisor, Lead Operator or designee will establish communication with emergency responders and participate in their Unified Incident Command structure as requested.
- Situation report will be delivered to the Incident Command.

Escaping vapors ignited?

Yes

Allow vapors to burn unless fire endangers public, other property or other equipment.

No

Allow conditions at the plant to stabilize, relying on engineering controls.

**Release Resolved and H<sub>2</sub>S < 10 ppm at all locations**

- Signal all clear.
- Personnel sign in and reenter Plant to resume work.
- Notify outside parties of status.
- Recall roadblocks and restore traffic.
- Initiate chronological Record of Events Log.
- Notify OCD w/in 4 hours of release.
- Submit form C-141 to OCD w/in 15 days of release.

**APPENDIX C**  
**TELEPHONE NUMBERS**  
**EMERGENCY CALL LIST**

## TELEPHONE NUMBERS EMERGENCY CALL LIST

### Emergency Services

Lovington Fire Department	575- 369-2359
Maljamar Fire Department	575-676-4100
Artesia Fire Department	575-746-5050
Hobbs Fire Department	575-397-9308
Loco Hills Fire Department	575-677-2349
Ambulance Services Hobbs	575-397-9308
Artesia	575-746-5050
Carlsbad	575-885-2111
Lovington	575-396-2359
Hospitals Artesia General	575-748-3333
Carlsbad Medical Center	575-887-4100
Lovington-Nor Lea	575-396-6611
Hobbs- Lea Regional	575-392-6581
Lubbock University Medical Center (UMC) Level I Trauma Center	806-775-8200
State Police (HMER) Eddy County	575-885-3137
Poison Control (Albuquerque)	800-222-1222
Helicopter Services Air Ambulance (Artesia)	800-550-1025
Lifeguard (Albuquerque)	888-633-5438
Southwest Medivac (Hobbs)	800-669-4851
AeroCare (Lubbock)	800-823-1991
Air Med (El Paso)	915-772-9292

### Government Agencies

Oil Conservation Division, Santa Fe, NM (OCD)	505-476-3440
Oil Conservation District Office (Hobbs)	575-370-3186
Air Quality Bureau, Santa Fe, NM	505-827-1494
US BLM (Carlsbad District Office)	575-887-6544
Local Emergency Planning Committee (LEPC) Eddy County	575-887-9511
Local Emergency Planning Committee (LEPC) Lea County	575-396-8602
National Response Center (NRC)	800-424-8802



**Businesses within the 100 ppm ROE**

COMPANY	CONTACT	PHONE
ConocoPhillips Company	Highway 62 180 Hobbs, NM 88241	575-393-5826
Chevron Pipeline Company	2827 N Dal Paso St Hobbs, NM	575- 738-0218
Enterprise/Chaparral Pipeline Company		888-883-6308

**Producers with Wells within the 100 ppm ROE**

COMPANY	CONTACT	PHONE
ConocoPhillips Company	Highway 62 180 Hobbs, NM 88241	575-393-5826
COG Operating, LLC	2208 West Main St Artesia, NM	575-748-6940
Cimarex Energy Company of Colorado	2020 W Bender Blvd Hobbs, NM 88240	575-393-1020

**Public:**

The Playa Lake Wetlands Habitat Project (a joint venture between the US Department of Interior Bureau of Land Management and ConocoPhillips) is located approximately 1.2 miles southeast of the Plant (see Figures 4, 9a and 9b) and is within the calculated 100 ppm H<sub>2</sub>S gas ROE of the Plant and AGI Facility. In the event of an emergency which requires Contingency Plan activation at Level 2, Frontier response personnel will complete a physical inspection of the area and instruct anyone present to evacuate the area.

**There are no residences within the 100 ppm ROE.**

**Frontier Internal Call List**

NAME	TITLE	Office #	Cell #	Home #
	Maljamar Plant Control Room	575-676-2400		
	24 Hour Emergency Number	800-503-5545		
Tom Williams	Executive Vice President of Operations	918-388-8417	918-740-6198	
John Prentiss	Area Manager	575-676-3528	575-706-6983	575-885-1265
Joe Ysusi	Manager, Compliance Safety Officer	575-676-3505	575-706-9670	575-746-2213
Rudy Quiroz	Assistant Area Manager	575-676-3520	575-942-4104	575-396-1748
Rudy Lizardo	Maintenance Foreman	575-676-3504	575-361-0135	575-396-3771

Ed McCasland	Measurement Technician, Information Officer	575-676-3503	575-706-9671	
Joe Calderon	Field Foreman, Logistics Section Chief	575-676-3506	575-361-0148	575-885-3504

## **APPENDIX D**

### **RADII OF EXPOSURE**

## RADII OF EXPOSURE

**WORST CASE SCENARIOS:** The basis for worst case scenario calculations is as follows:

- The worst case ROE for this Plan has been calculated utilizing the anticipated inlet flow rate (24-hour rate) into the Plant which is 135 MMSCFD with an H<sub>2</sub>S concentration for inlet gas of .85 mole percent. In addition, corresponding numbers for TAG injection rate and concentration have increased to a TAG injection rate of 3.1 MMCFD and a TAG H<sub>2</sub>S concentration of 37 mole percent.
- The worst case scenario ROE assumes an uncontrolled instantaneous release of a 24-hour volume of gas at the Plant. Because the Plant is a throughput process Plant, it is impossible that the entire 24-hour throughput volume of the Plant could be released instantaneously as is assumed in the worst case scenario calculations of the ROE. Further, the Plant's ESD systems would be activated in the event of a catastrophic emergency and would prevent the flow of gas into the Plant and would isolate the AGI compressors and equipment and route the acid gas safely to the Plant acid gas flare. To comply with NMAC 19.15.11, the worst case scenario calculations (assuming an instantaneous release of the 24-hour processing and/or TAG volume) are utilized here.

The formulas for calculating the radius of exposure (ROE) are as follows:

**100 ppm ROE Calculation (as per 19 NMAC 15.11.7.K.1):**

$$X = [(1.589)(\text{hydrogen sulfide concentration})(Q)](0.6258)$$

**500 ppm ROE Calculation (as per 19 NMAC 15.11.7.K.2):**

$$X = [(0.4546)(\text{hydrogen sulfide concentration})(Q)](0.6258)$$

Where:

X = radius of exposure in feet

"hydrogen sulfide concentration" = the decimal equivalent of the mole or volume fraction of hydrogen sulfide in the gaseous mixture

Q = Escape rate expressed in cubic feet per day (corrected for standard conditions of 14.73 psi absolute and 60 degrees Fahrenheit)

### ROE FOR MALJAMAR PLANT WORST CASE SCENARIO

**500-ppm ROE 3,784 feet (.72 mile)**

**100-ppm ROE 8,281 feet (1.57 mile)**

Both the 500 ppm and the 100 ppm radii of exposure for the Plant and the AGI Facility are shown on Figures 4a and 4b. This ROE pattern is designed to include the 100 and 500 ppm radii for a potential worst case failure. The actual calculation of the 500 and 100 ppm ROE for inlet gas as well as for TAG at this Plant and AGI Facility are shown on the following pages.

FRONTIER FIELD SERVICES		MALJAMAR PLANT INLET STREAM		ROE CALCULATIONS PURSUANT TO RULE 11	
If data is provided in mole% use calculator below for getting ppm					
Enter Mole % in cell C5	Mole %	ppm			
Convert mole% to ppm	0.85	8500			
If data is provided in mole fraction use calculator below for getting ppm					
Enter Mole Fraction in cell C10	Mole Fraction	ppm			
Convert mole fraction to ppm		0			
Use ppm derived from either of above calculations to input data below					
Input Data Here		H <sub>2</sub> S Concentration (ppm)	8500		
		24 Hour Throughput (MMSCFD)	135		
The radius of exposure is calculated using the following equations:					
100 ppm ROE calculation (as per 19 NMAC 15.11.7.K.1)					
$X_{100\text{ppm}} = [(1.589)(\text{Conc}_{\text{H}_2\text{S}})(Q)]^{0.6258}$					
500 ppm ROE calculation (as per 19 NMAC 15.11.7.K.2)					
$X_{500\text{ppm}} = [(0.4546)(\text{Conc}_{\text{H}_2\text{S}})(Q)]^{0.6258}$					
Where:					
X = radius of exposure (ft)					
Conc <sub>H<sub>2</sub>S</sub> = the decimal equivalent of the mole or volume fraction of H <sub>2</sub> S in the gas					
Q = daily plant throughput corrected to standard conditions (SCFD)					
Plant parameters					
Q =	135	MMSCFD =	135000000	SCFD	
Conc <sub>H<sub>2</sub>S</sub> =	8500	ppm =	0.85	Mole % =	0.0085 Mole Fraction
ROE calculation:					
$X_{500\text{ppm}}$ =	$[(1.589)(0.0085)(135000000)]^{0.6258}$				
$X_{100\text{ppm}}$ =	8281 ft	=	1.57 miles		
$X_{500\text{ppm}}$ =	$[(0.4546)(0.0085)(135000000)]^{0.6258}$				
$X_{100\text{ppm}}$ =	3784 ft	=	0.72 miles		

<b>FRONTIER FIELD SERVICES</b>	<b>MALJAMAR TAG STREAM</b>	<b>ROE CALCULATIONS PURSUANT TO RULE 11</b>
If data is provided in mole% use calculator below for getting ppm		
Enter Mole % in cell E3 Convert mole% to ppm	Mole % 37	ppm 370000
If data is provided in mole fraction use calculator below for getting ppm		
Enter Mole Fraction in cell C10 Convert mole fraction to ppm	Mole Fraction 0	ppm 0
Use ppm derived from either of above calculations to input data below		
Input Data Here	H <sub>2</sub> S Concentration (ppm) 370000	24 Hour Throughput (MMSCFD) 3.1
The radius of exposure is calculated using the following equations: 100 ppm ROE calculation (as per 19 NMAC 15.11.7.K.1) $X_{100\text{ppm}} = [(1.589)(\text{Conc}_{\text{H}_2\text{S}})(Q)]^{(0.6258)}$ 500 ppm ROE calculation (as per 19 NMAC 15.11.7.K.2) $X_{500\text{ppm}} = [(0.4546)(\text{Conc}_{\text{H}_2\text{S}})(Q)]^{(0.6258)}$		
Where: X = radius of exposure (ft) Conc <sub>H<sub>2</sub>S</sub> = the decimal equivalent of the mole or volume fraction of H <sub>2</sub> S in the gas Q = daily plant throughput corrected to standard conditions (SCFD)		
Plant parameters		
Q =	3.1 MMSCFD =	3100000 SCFD
Conc <sub>H<sub>2</sub>S</sub> =	370000 ppm =	37 Mole % = 0.37 Mole Fraction
ROE calculation:		
$X_{100\text{ppm}} =$	$[(1.589)(0.37)(3100000)]^{(0.6258)}$	
$X_{100\text{ppm}} =$	8278 ft =	1.57 miles
$X_{500\text{ppm}} =$	$[(0.4546)(0.37)(3100000)]^{(0.6258)}$	
$X_{500\text{ppm}} =$	3783 ft =	0.72 miles

## **APPENDIX E**

### **H<sub>2</sub>S CONTINGENCY PLAN DISTRIBUTION LIST**

## **H<sub>2</sub>S Contingency Plan Distribution List**

### **New Mexico Oil Conservation Division**

1220 South St. Francis Drive  
Santa Fe, NM 87505

### **New Mexico Oil Conservation Division (Hobbs District Office)**

1625 N. French Drive  
Hobbs, NM 88240

### **New Mexico Department of Public Safety**

5100 Jack Gomez Blvd.  
Hobbs, NM 88240

### **Lea Co. Local Emergency Planning Committee**

100 North Main  
Lovington, NM 88260

### **Bureau of Land Management Hobbs Field Office**

Carlsbad Field Office  
620 E. Greene Street  
Carlsbad, NM 88220

### **Maljamar Fire Department**

U.S. Highway 82 and 126  
Maljamar, NM 88264

### **Lovington Fire Department**

213 S Love ST  
Lovington, NM 88260

### **Artesia Fire Department**

309 North 7th Street  
Artesia, NM 88210-1913

### **Hobbs Fire Department**

301 E White Street  
Hobbs, NM 88240

### **Loco Hills Fire Department**

132706 Lovington HWY  
Loco Hills, NM 88255

### **New Mexico State Police, District 3 Office**

4207 West 2<sup>nd</sup> Street  
Roswell, NM 88201



**Lea County Sheriff's Department**

1417 South Commercial Street  
Lovington, NM 88260

**Maljamar Gas Plant**

1001 Conoco Rd.  
Maljamar, NM 88264

**Frontier Field Services LLC Main Office**

4200 Skelly Drive, Suite 700  
Tulsa, OK 74135

**AKA Energy Corporate Headquarters**

**65 Mercado Street, Suite 250**  
**Durango, CO 81301**

**Conoco Phillips Lovington Office for Conoco Phillips Field Warehouse**

29 Vacuum Complex Lane  
Lovington, NM 88260

## **APPENDIX F**

### **CHRONOLOGICAL RECORD OF EVENTS LOG**

## CHRONOLOGIC RECORD OF EVENTS LOG

1. Incident Name		2. Operational Period (Date/Time)		UNIT /ACTIVITY LOG ICS 214	
		From: To:			
3. Individual Name		4. ICS Section		5. Assignment/Location	
6. Activity Log				Page	of
TIME		MAJOR EVENTS			
7. Prepared by:				Date/Time	
UNIT/ACTIVITY LOG				ICS 214	

## **APPENDIX G**

### **NEW MEXICO OIL CONSERVATION DIVISION FORM C-141**

District I  
1625 N. Hatch Dr., Hobbs, NM 88240  
District II  
811 S. First St., Artesia, NM 88210  
District III  
1000 Rio Brazos Road, Aztec, NM 87410  
District IV  
1220 S. St. Francis Dr., Santa Fe, NM 87505

State of New Mexico  
Energy Minerals and Natural Resources

Oil Conservation Division  
1220 South St. Francis Dr.  
Santa Fe, NM 87505

Form C-141  
Revised August 8, 2011

Submit 1 Copy to appropriate District Office in  
accordance with 19.15.29 NMAC.

**Release Notification and Corrective Action**

**OPERATOR**

☐ Initial Report ☐ Final Report

Name of Company	Contact	
Address	Telephone No.	
Facility Name	Facility Type	
Surface Owner	Mineral Owner	API No.

**LOCATION OF RELEASE**

Unit Letter	Section	Township	Range	Feet from the	North/South Line	Feet from the	East/West Line	County
Latitude _____ Longitude _____								

**NATURE OF RELEASE**

Type of Release	Volume of Release	Volume Recovered
Source of Release	Date and Hour of Occurrence	Date and Hour of Discovery
Was Immediate Notice Given? <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Not Required	If YES, To Whom?	
By Whom?	Date and Hour	
Was a Watercourse Reached? <input type="checkbox"/> Yes <input type="checkbox"/> No	If YES, Volume Impacting the Watercourse	
If a Watercourse was Impacted, Describe Fully *		
Describe Cause of Problem and Remedial Action Taken *		
Describe Area Affected and Cleanup Action Taken *		
I hereby certify that the information given above is true and complete to the best of my knowledge and understand that pursuant to NMOCD rules and regulations all operators are required to report and/or file certain release notifications and perform corrective actions for releases which may endanger public health or the environment. The acceptance of a C-141 report by the NMOCD marked as "Final Report" does not relieve the operator of liability should their operations have failed to adequately investigate and remediate contamination that pose a threat to ground water, surface water, human health or the environment. In addition, NMOCD acceptance of a C-141 report does not relieve the operator of responsibility for compliance with any other federal, state, or local laws and/or regulations.		
<b>OIL CONSERVATION DIVISION</b>		
Signature:	Approved by Environmental Specialist:	
Printed Name	Approval Date: _____ Expiration Date: _____	
Title:	Conditions of Approval:	
E-mail Address:	Attached <input type="checkbox"/>	
Date: _____ Phone: _____		

\* Attach Additional Sheets If Necessary