


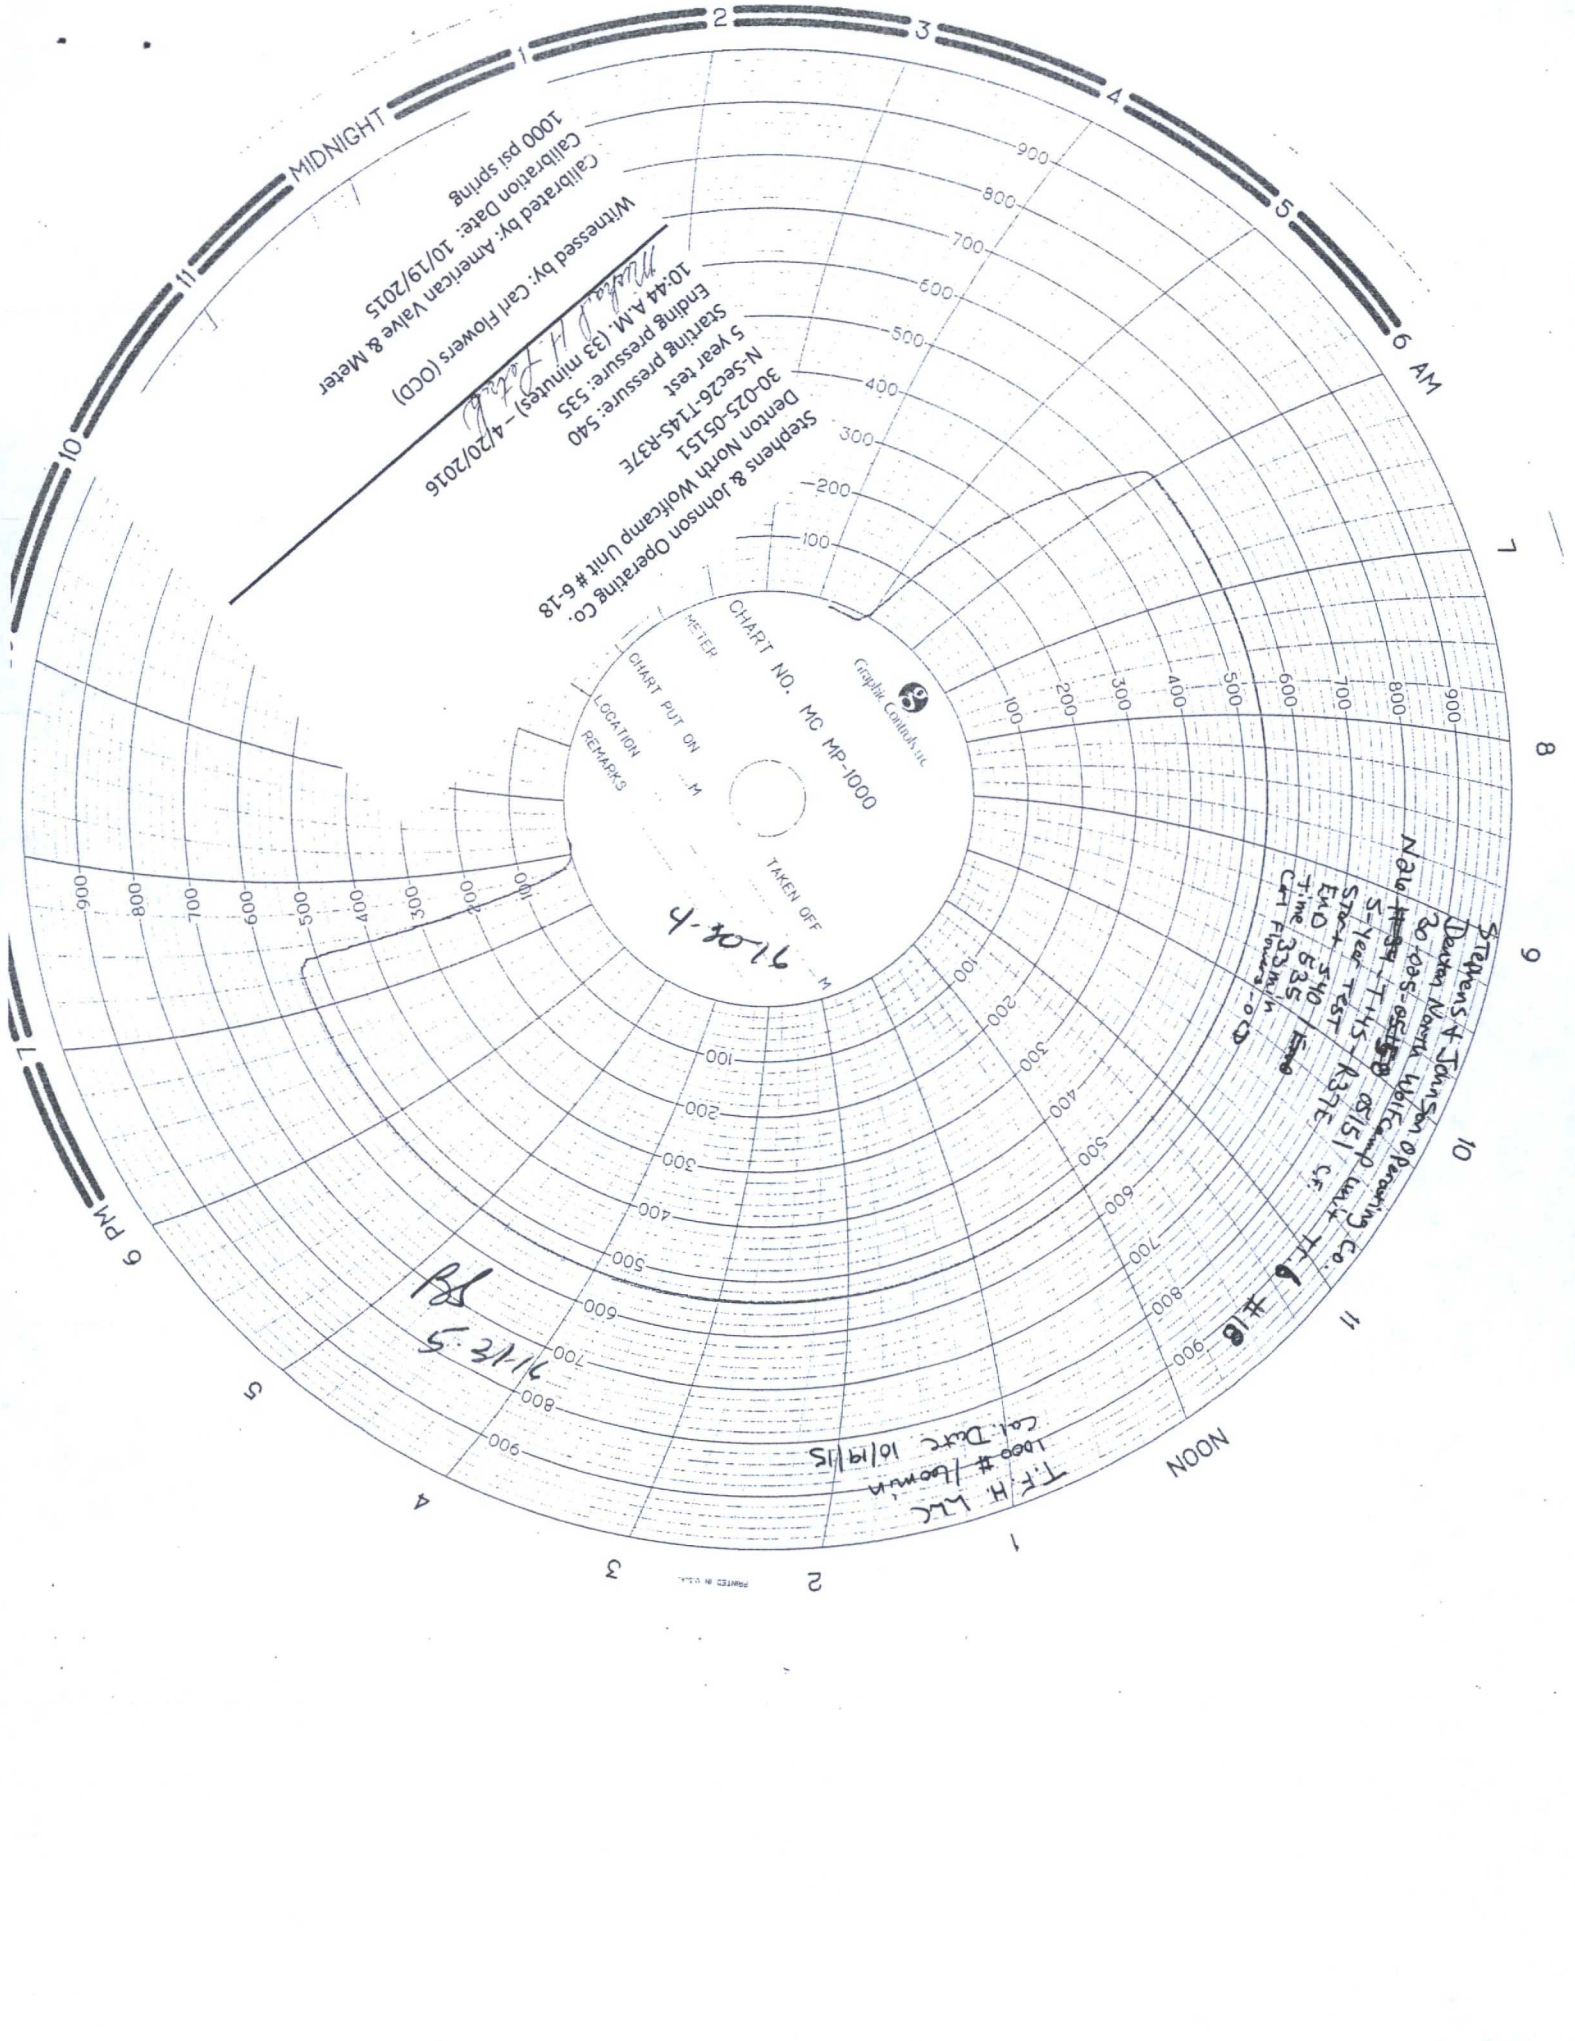

Witnessed by: Carl Flowers (OC)
Calibrated by: American Valve & Meter
Calibration Date: 10/19/2015
10:44 A.M. (33 minutes)
Starting pressure: 535
5 year test
N-sec26-T145-R37E
30-025-05151
Denton North Wolfcamp Unit # 6-18
Stephens & Johnson Operating Co.

CHART NO. MC MP-1000
TAKEN OFF
4-30-16
METER
LOCATION
REMARKS

Stephens & Johnson Operating Co.
Denton North Wolfcamp Unit # 6-18
N-sec26-T145-R37E
30-025-05151
5-year test
Start 540
End 535
Time 33 min
Carl Flowers - OC

T.F.H. LLC
Loop # 1600
Cal. Date 10/19/15

PS
5-21-16