


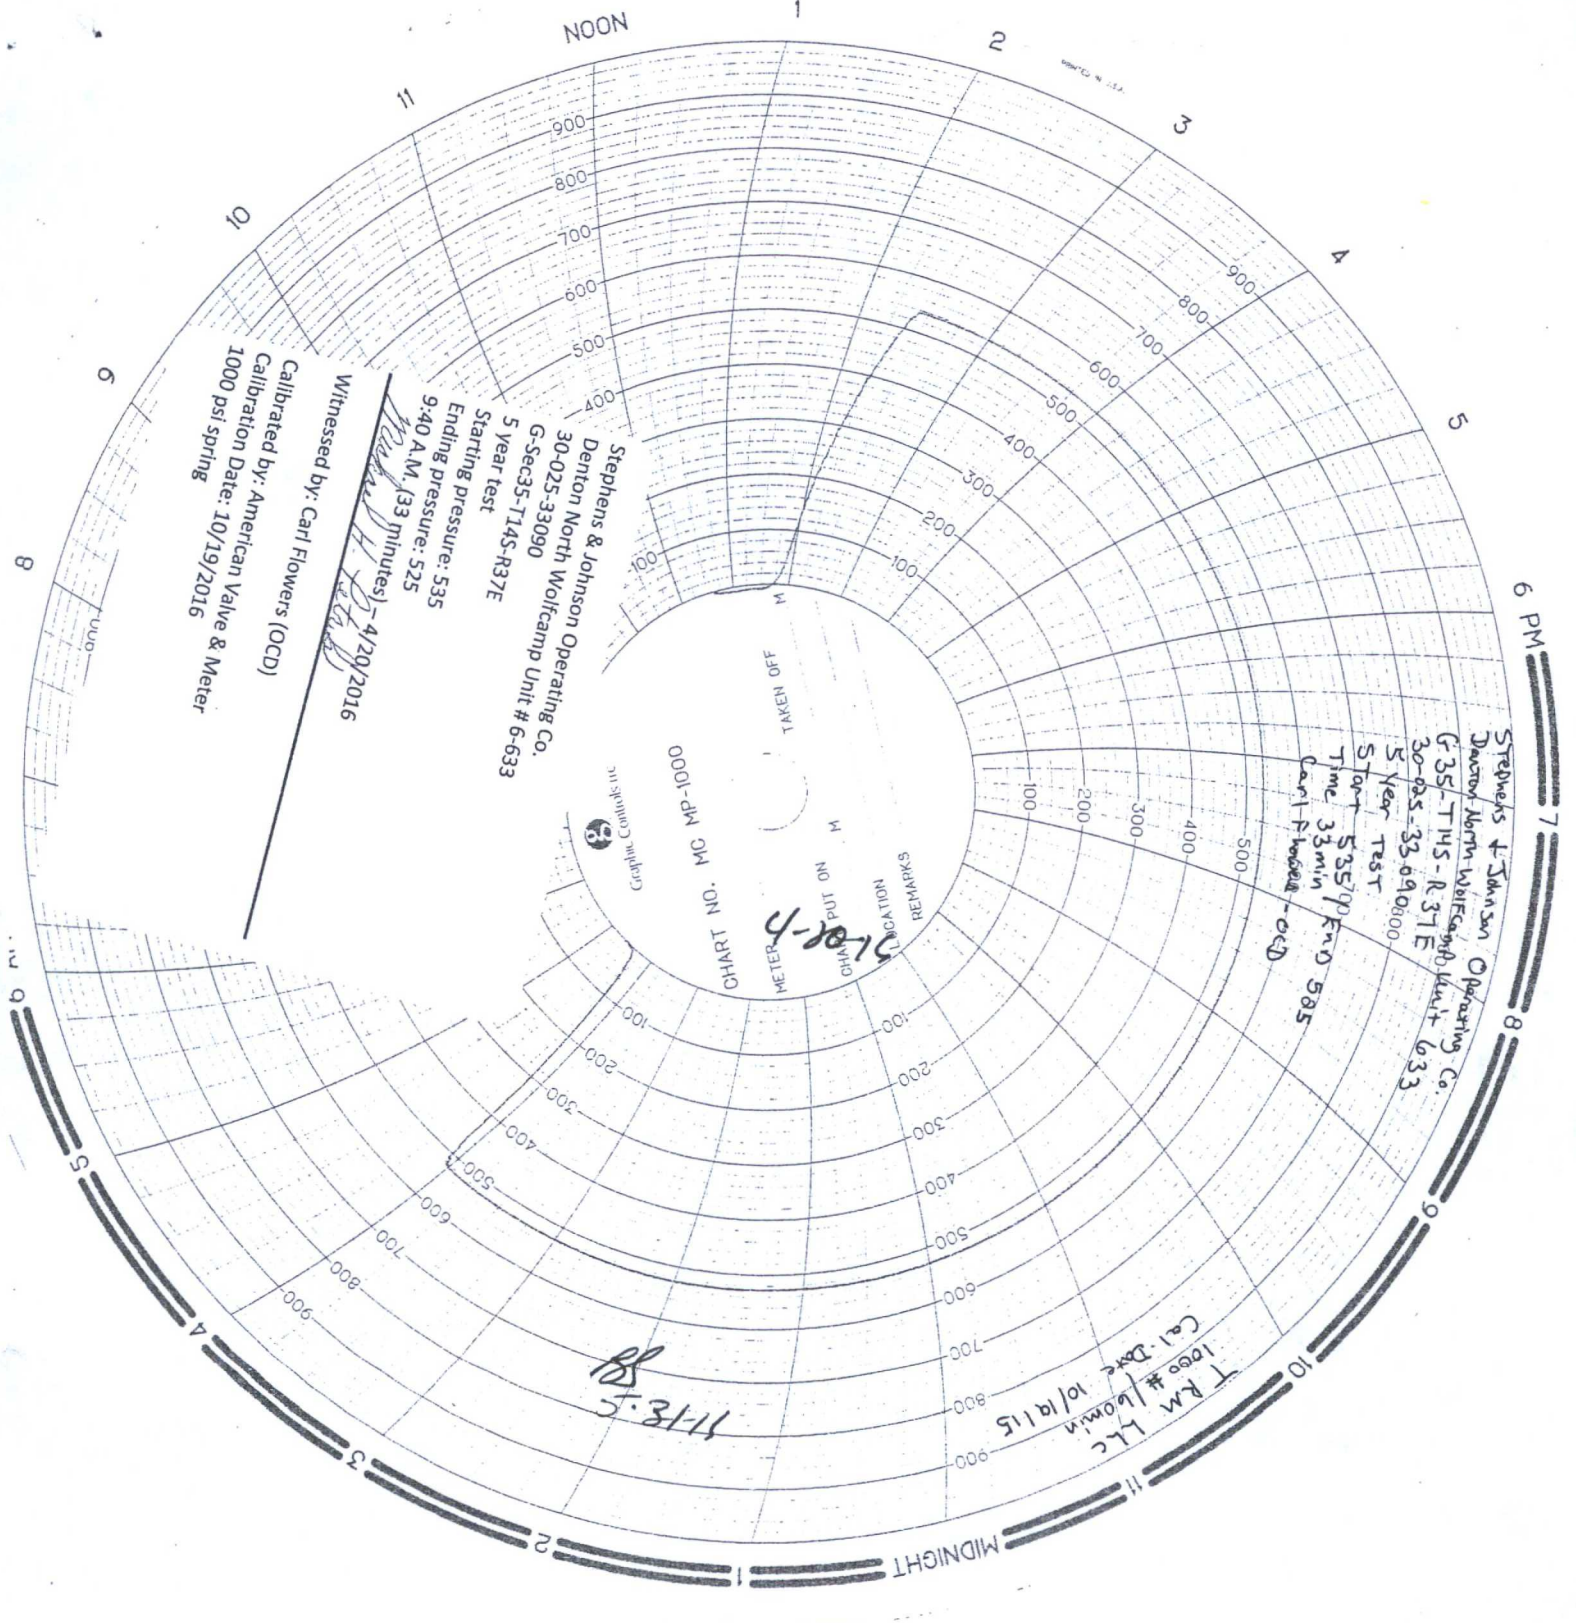

Witnessed by: Carl Flowers (OCD)
Calibrated by: American Valve & Meter
1000 psi Spring

Stephens & Johnson Operating Co.
Denton North Wolfcamp Unit # 6-633
G-35-T145-R37E
5 Year Test
Starting pressure: 535
Ending pressure: 525
9:40 A.M. (33 minutes) - 4/20/2016

Stephens & Johnson Operating Co.
Denton North Wolfcamp Unit # 6-633
G-35-T145-R37E
5 Year Test
Start 5:35 PM End 5:05
Time 33 min
Carl Flowers - OCD

T.R.M. LLC
Loss # 160 min
Cal Date 10/19/15

5/18/15