


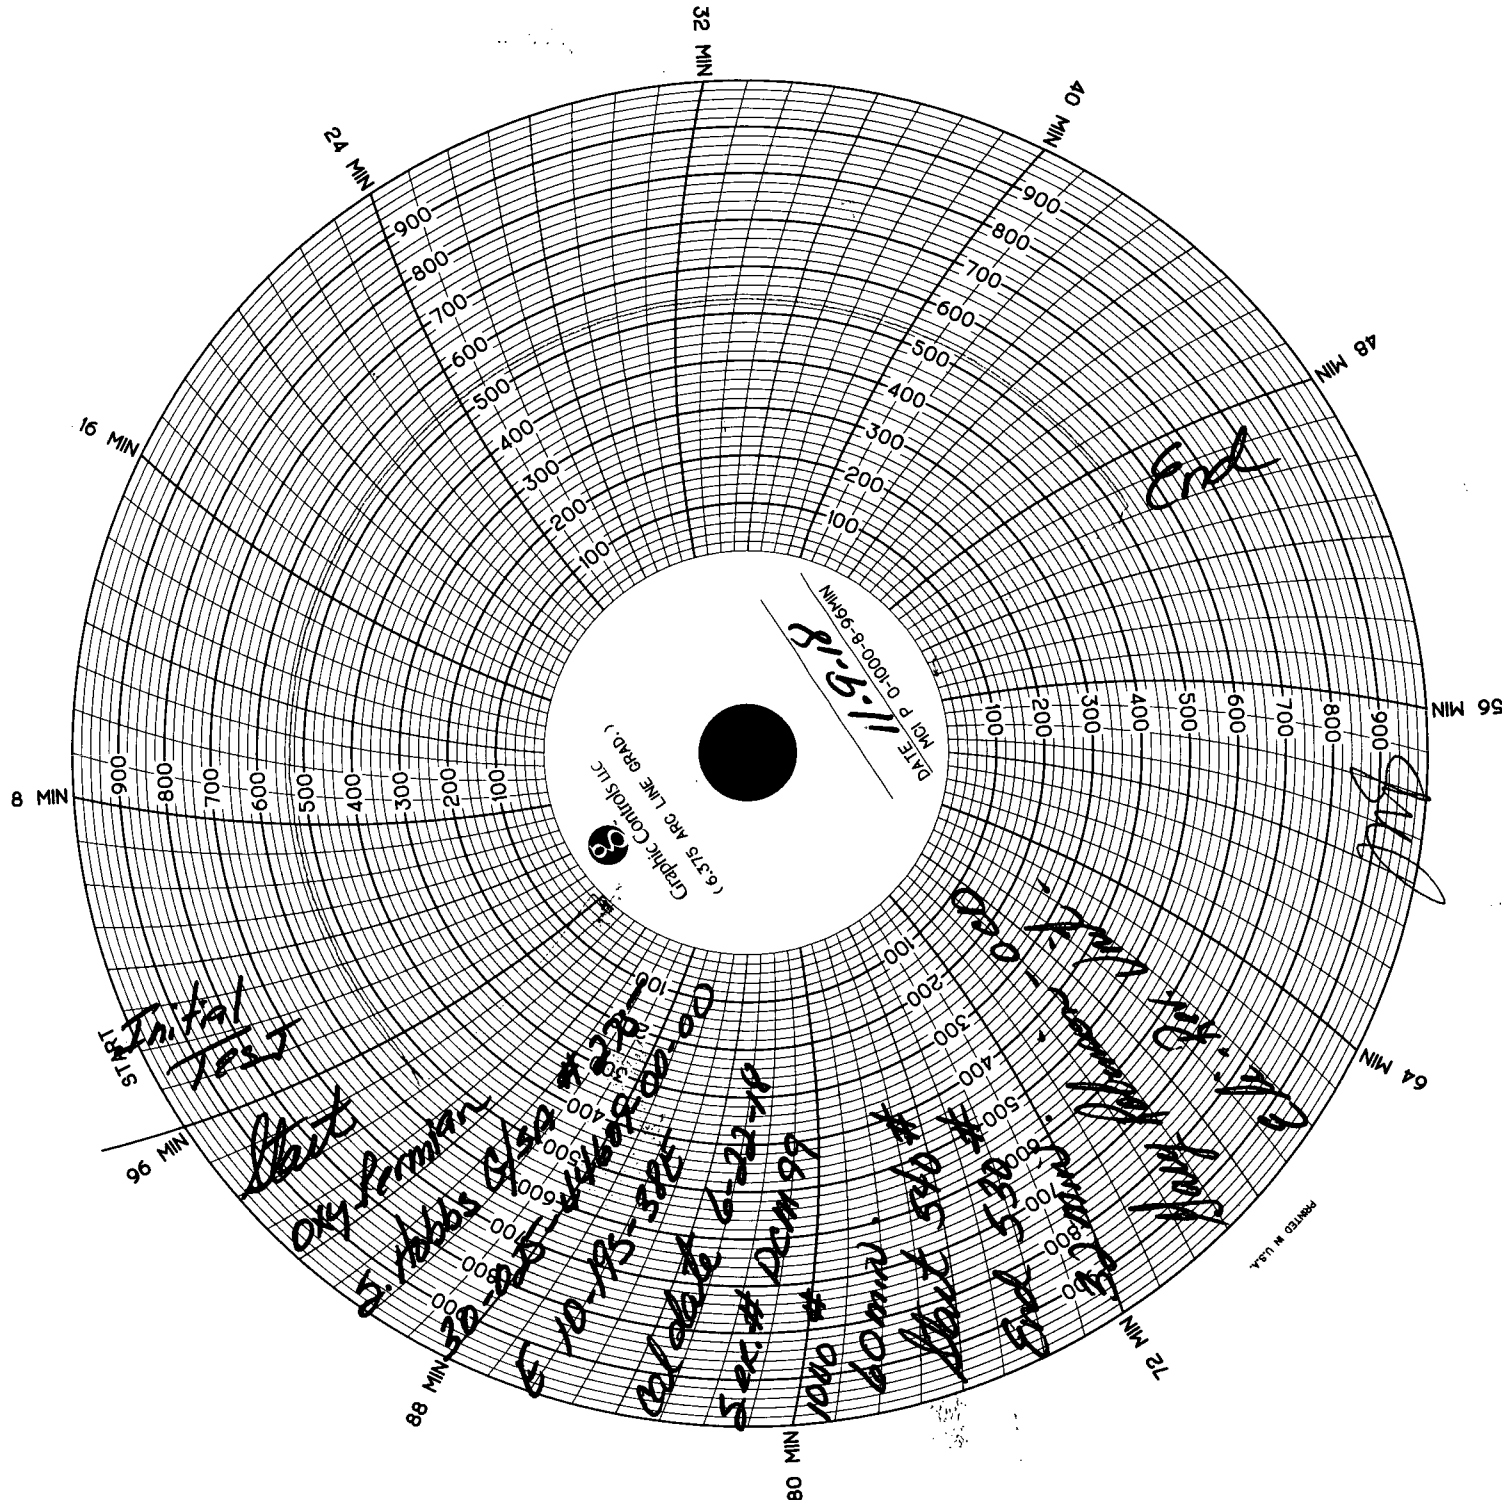

Graphic Controls LLC
(6.375 Arc Line Grad.)

DATE 11-5-11
KGT P 0-1000-8-32 MIN

Initial Test

Start

Oxy Forman

5.10000 0.100

E 10-13-500

Cal date 6-22-10

Ser # 02099

1000 # 0000

00000

Start test # 025

End 500

0.00000

0.00000

End

mp

PRINTED IN U.S.A.