


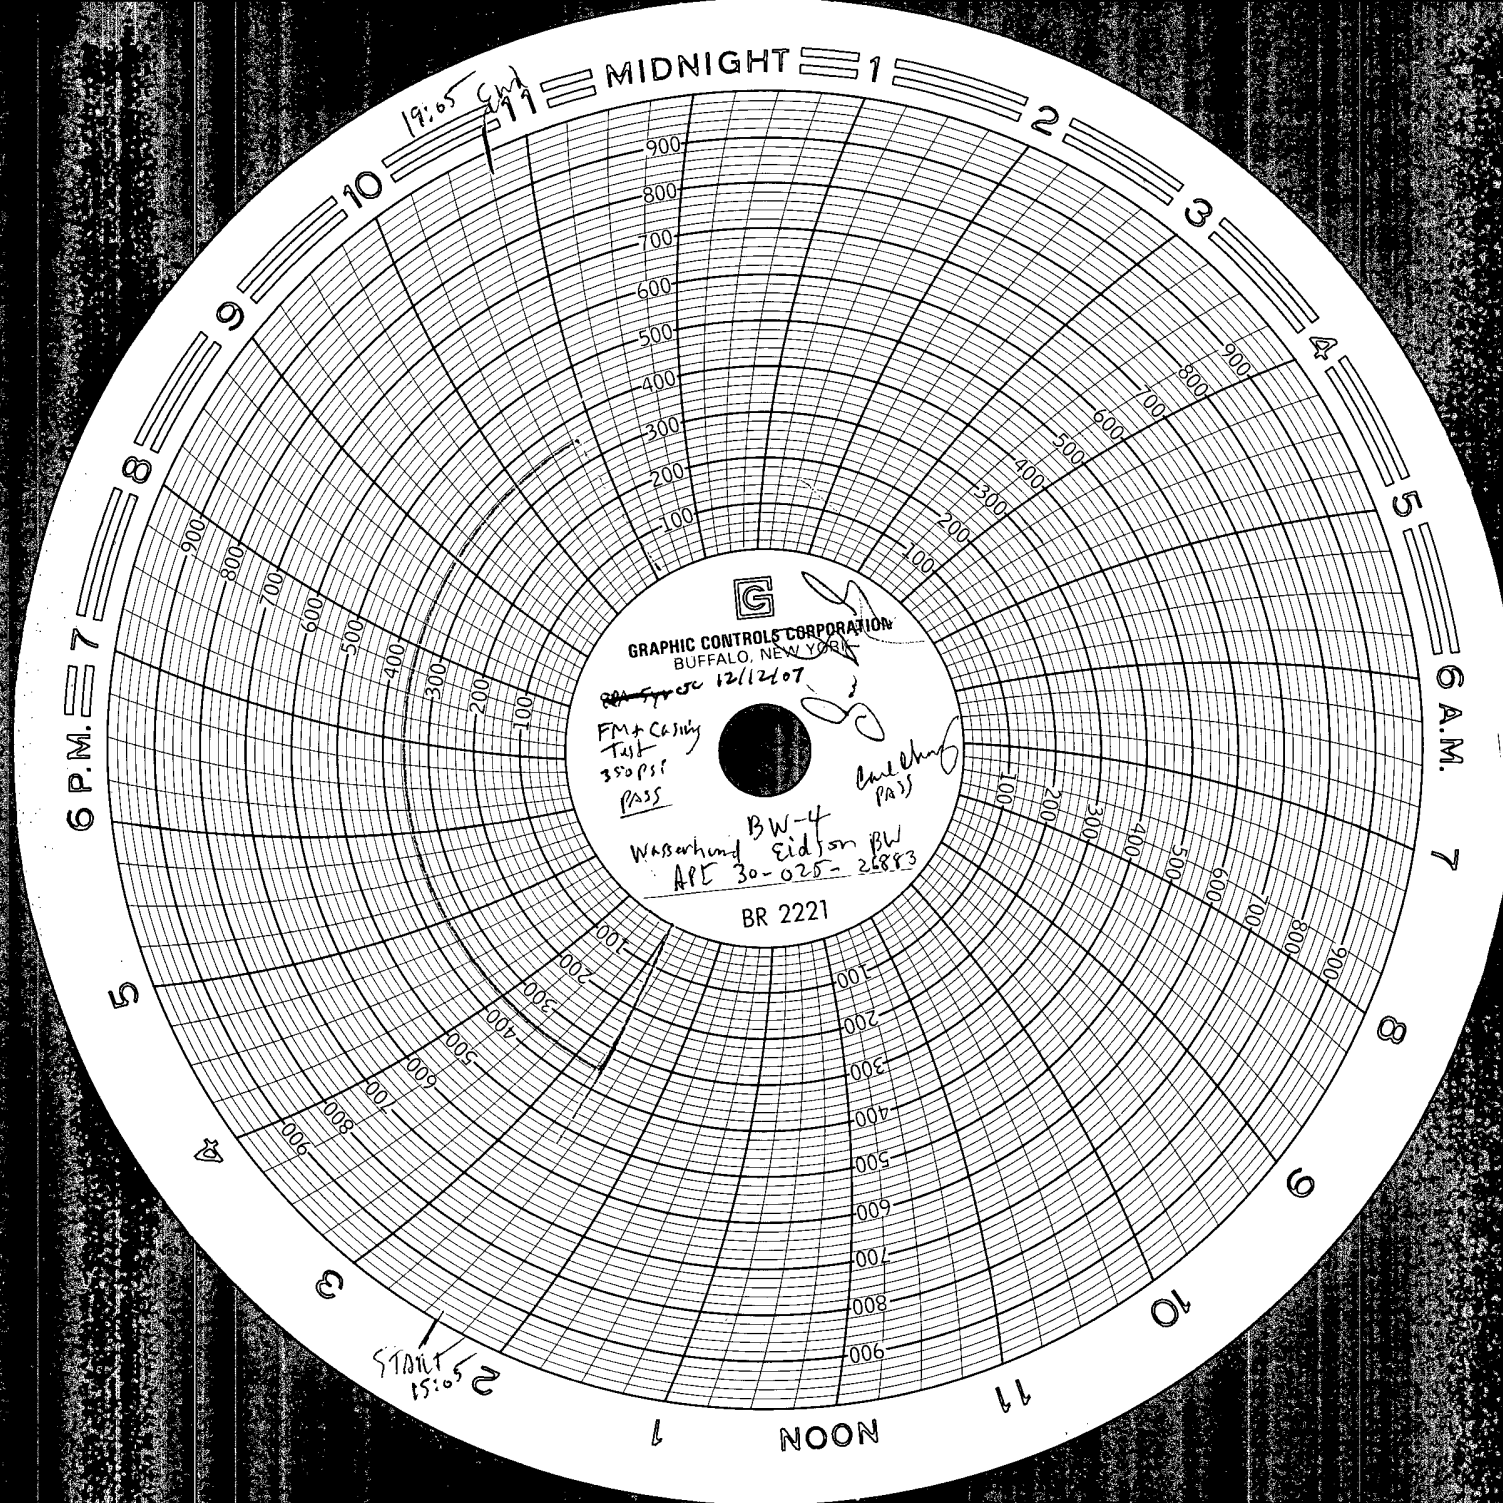

12/12/07

Chart Recorder # 0279

Time Started: 3:05

Finished 7:05

12/12/07

350 psi

350 psi

PASS

Chel V

X

GANDY


WASSER HAND #4

API 30-025-26883

CASING+FORMATION / WATER
EPA MIT 5yr.

San Diego

D & L Meters & Instrument Service, Inc.
P.O. Box 1621
Lovington, NM 88260
(505) 396-3715 FAX (505) 396-5812



TUESDAY , NOVEMBER 27, 2007

Certification of Pressure Recorder Test:

MODEL : 8" 1000# SER# 11219

**This Pressure Recorder was tested at midrange for accuracy and verified within
+5% and -5% for a 1000# pressure element.**


Jimmy Ortega, Technician