



BOP Diagram



30-025-40095

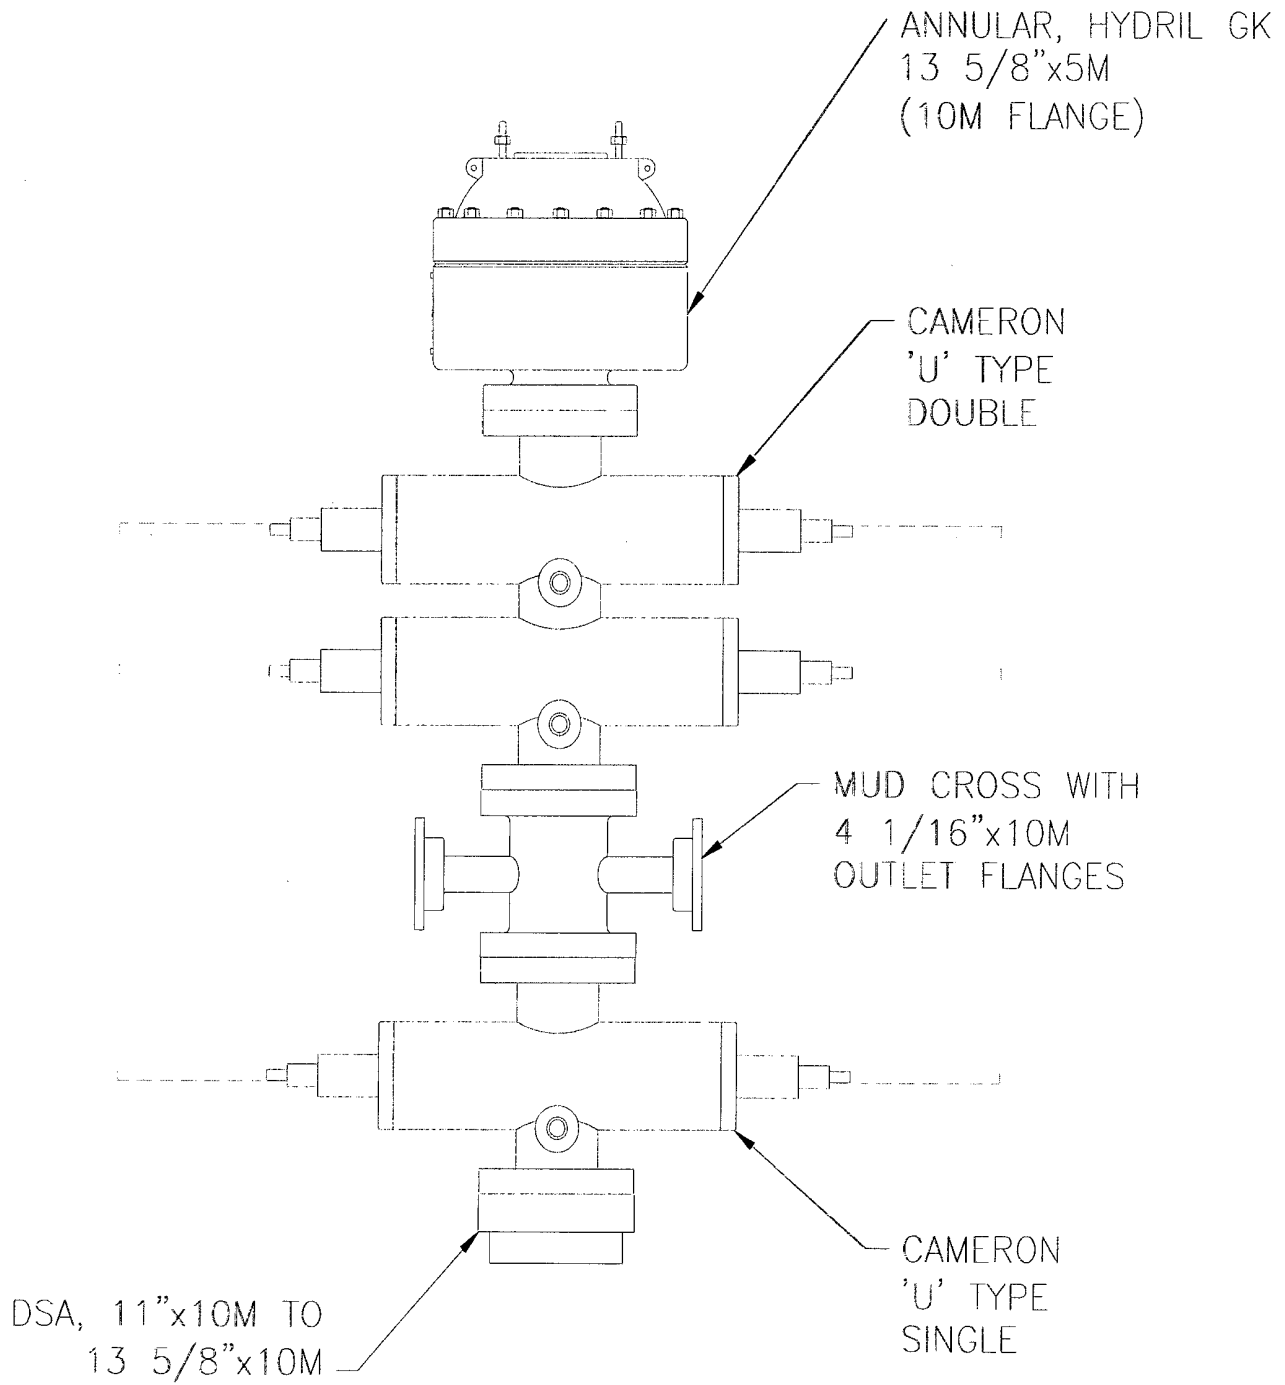

BOP STACK

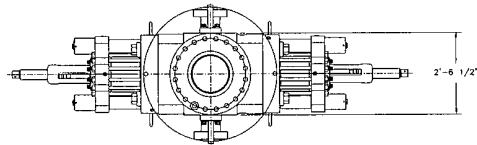

- LEGEND**
- ① - 4 1/16"-10M FLANGED END GATE VALVE
 - ② - 4 1/16"-10M FLANGED END GATE VALVE WITH DOUBLE ACTING HYDRAULIC ACTUATOR
 - ③ - 2 1/16"-10M FLANGED END GATE VALVE
 - ④ - 2 1/16"-10M FLANGED END CHECK VALVE
 - ⑤ - DOUBLE STUDDED ADAPTER

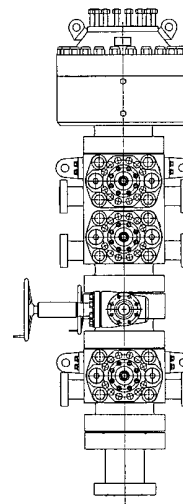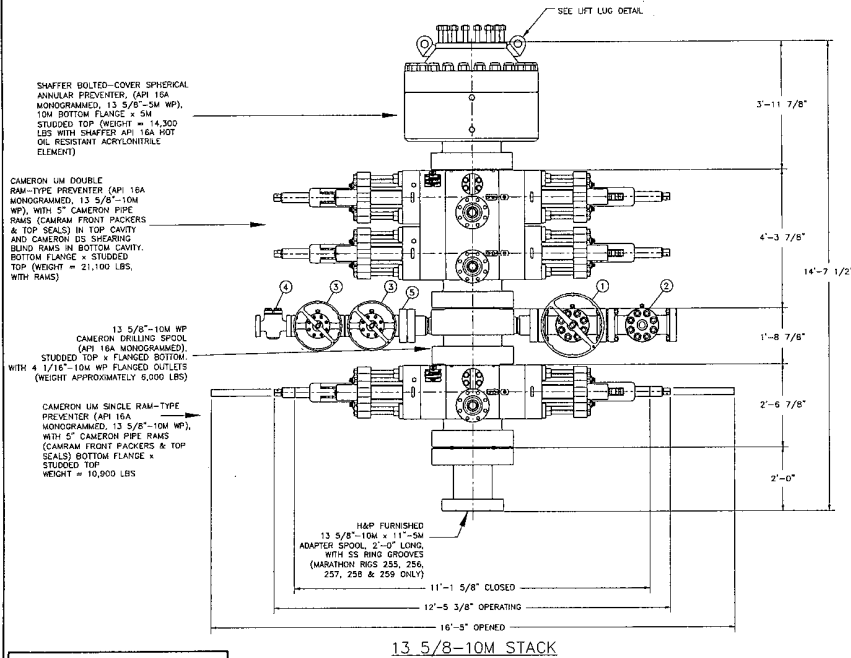

ISSUED FOR FABRICATION
December-18-2007
DRAFTSMAN
ENGINEER

API 6A MONOGRAMMED CAMERON CHOKER AND KILL WING VALVE ASSEMBLIES ARE NOT SHOWN FOR CLARITY.

WEIGHTS DO NOT INCLUDE HOSES, ADAPTER SPOOLS OR QUICK CONNECT FITTINGS


HELMERICH & PAYNE
INTERNATIONAL DRILLING CO.

ENGINEERING APPROVAL		DATE	TITLE
13 5/8"-10M BOP 3 RAM STACK			FLEXRIG3
15/11/07	ADDED SHEET 03	JAV	
4-10-07	DRYPOON ROSS TUBE TROUS OFFER, OVER L.S. & L. AND X5 CHECK HOLE APPROV.	JAV	
4-24-07	P. ADDED TO SPACER ADAPTER SPOOL	JAV	
02-07-07	ADDED ADAPTER SPOOL	WML	
05-13-02	CORRECTED BOP STACK	WML	
REV	DATE	DESCRIPTION	BY
1	05-13-02	CORRECTED BOP STACK	WML


PROJECT: FLEXRIG3
DRAWN: MTS
DATE: 6-5-02
DWG. NO.: 210-P1-07
SHEET: 1 OF 7

PROPRIETARY

THIS DRAWING AND THE IDEAS AND INFORMATION INCLUDED IN THIS DRAWING ARE PROPRIETARY AND ARE NOT TO BE REPRODUCED, DISTRIBUTED OR DISCLOSED IN ANY MANNER, WITHOUT THE PRIOR WRITTEN CONSENT OF A DAILY AUTHORIZED OFFICER OF HELMERICH & PAYNE INT'L DRILLING CO.

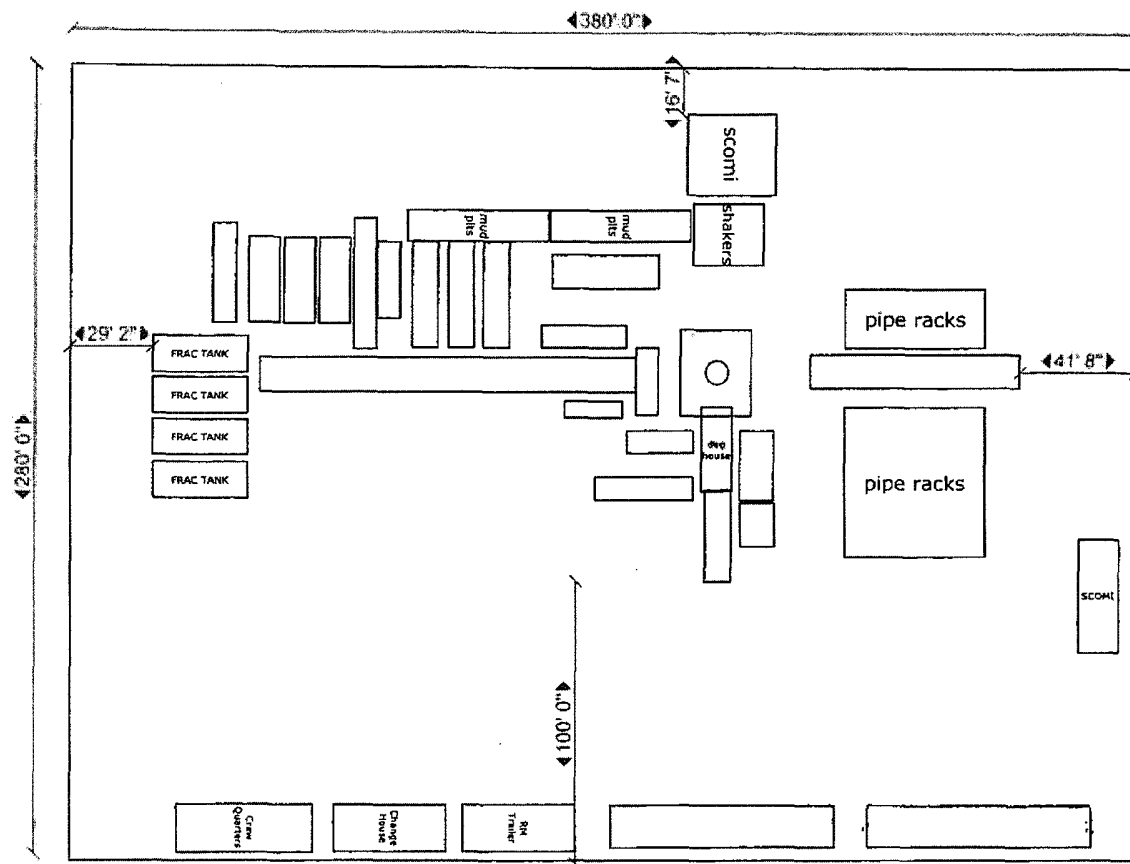

Rum Runner Fed # 1H



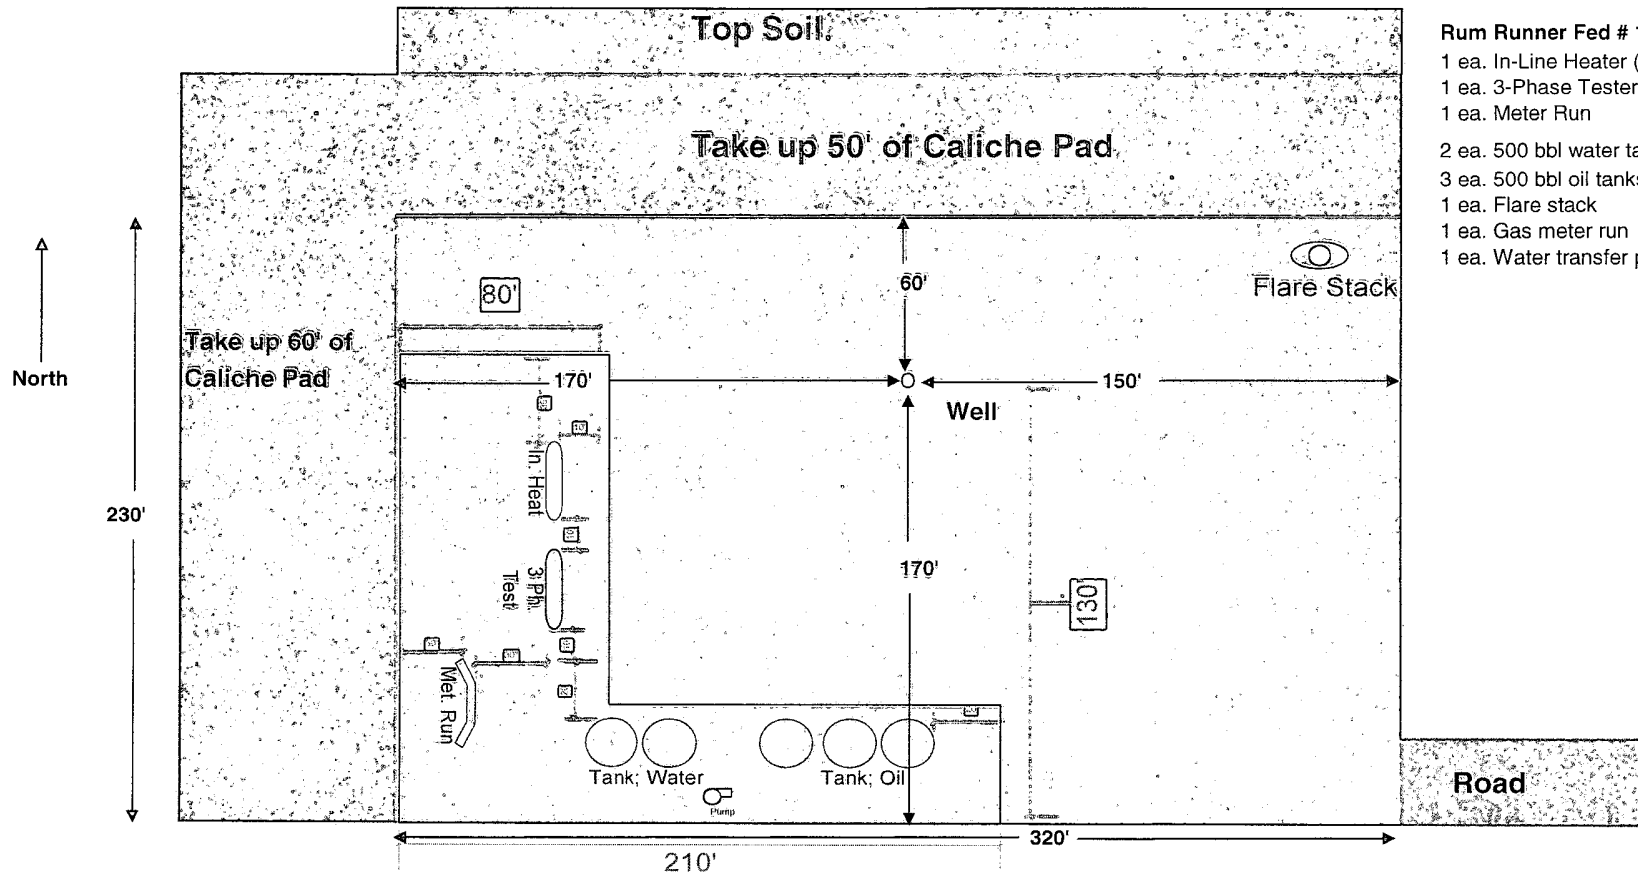


Rum Runner Fed # 1H Equipment list

- 1 ea. In-Line Heater (30"x10')
- 1 ea. 3-Phase Tester (36"x10')
- 1 ea. Meter Run
- 2 ea. 500 bbl water tanks
- 3 ea. 500 bbl oil tanks
- 1 ea. Flare stack
- 1 ea. Gas meter run
- 1 ea. Water transfer pump

If road comes into the Southwest corner of pad Oxy will take up and re-seed 60' on west side and 50' on north side of pad

Pipelines: 4" Polyethylene water transfer line will be laid on the surface to the WBR#2 battery.
 4" Polyethylene gas transfer line will be laid on the surface to the WBR#1 tie-in.
 Electrical distribution will be laid from the WBR#1 tie-in to the well site.

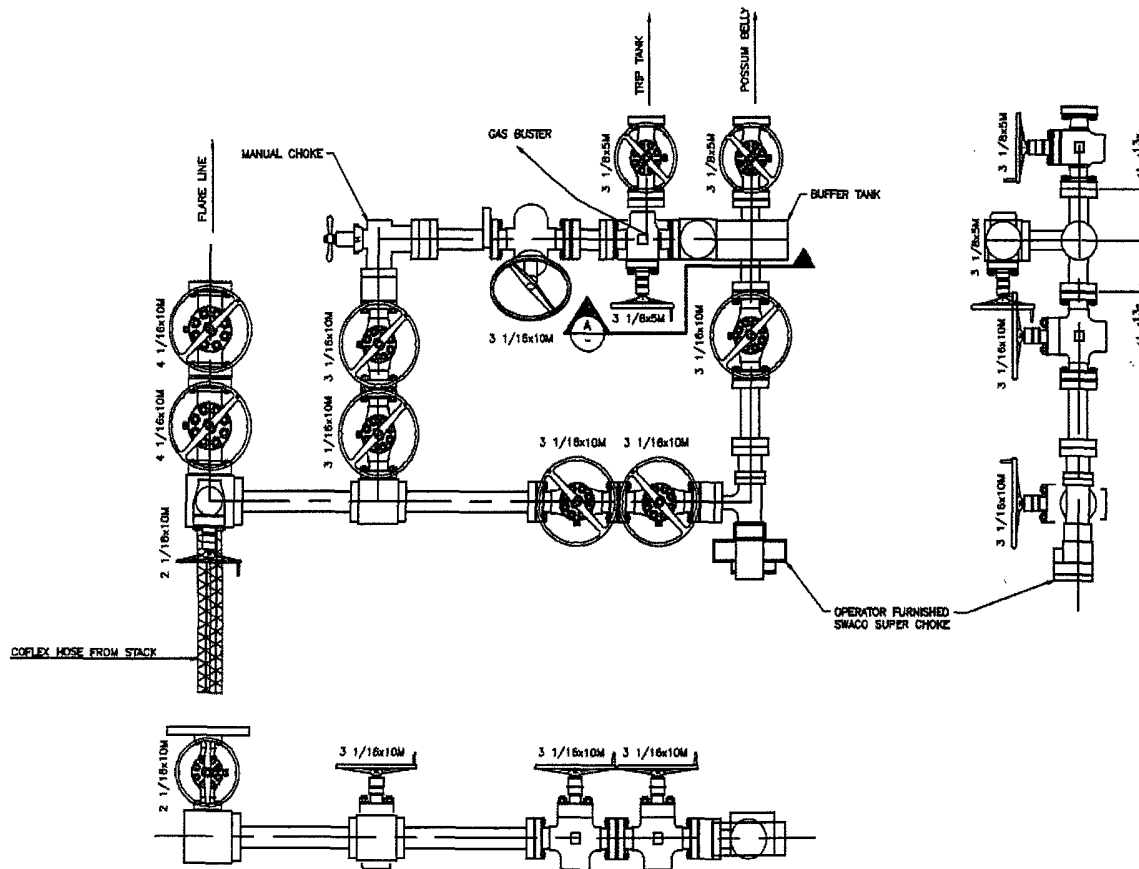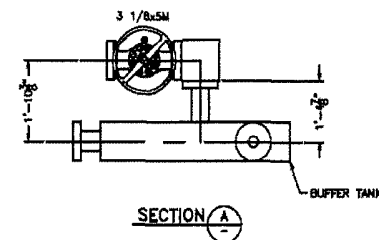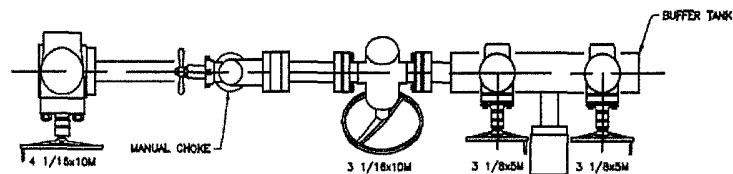

**ISSUED FOR
FABRICATION**
MARCH 8, 2008
DRAFTSMAN _____
ENGINEER _____

HELMERICH & PAYNE
INTERNATIONAL DRILLING CO.

CHOKE MANIFOLD

CUSTOMER: H&P

PROJECT: FLEXRIG3

DRAWN: MTS

DATE: 2-28-02

SCALE: 3/4"=1'

SHEET 1 OF 1

216-P1-05

REV: A

ENGINEERING APPROVAL DATE


10/15/02 ADJUST DIM TO FIELD CONFIRMED DIM RAY


BY

PROPRIETARY


THIS DRAWING AND THE IDEAS AND INFORMATION INCLUDED
IN THIS DRAWING ARE PROPRIETARY AND ARE NOT TO BE
REPRODUCED, DISTRIBUTED OR DISCLOSED IN ANY MANNER,
WITHOUT THE PRIOR WRITTEN CONSENT OF A DULY AUTHORIZED
OFFICER OF HELMERICH & PAYNE INTL. DRILLING CO.

10M CHOKE MANIFOLD CONFIGURATION

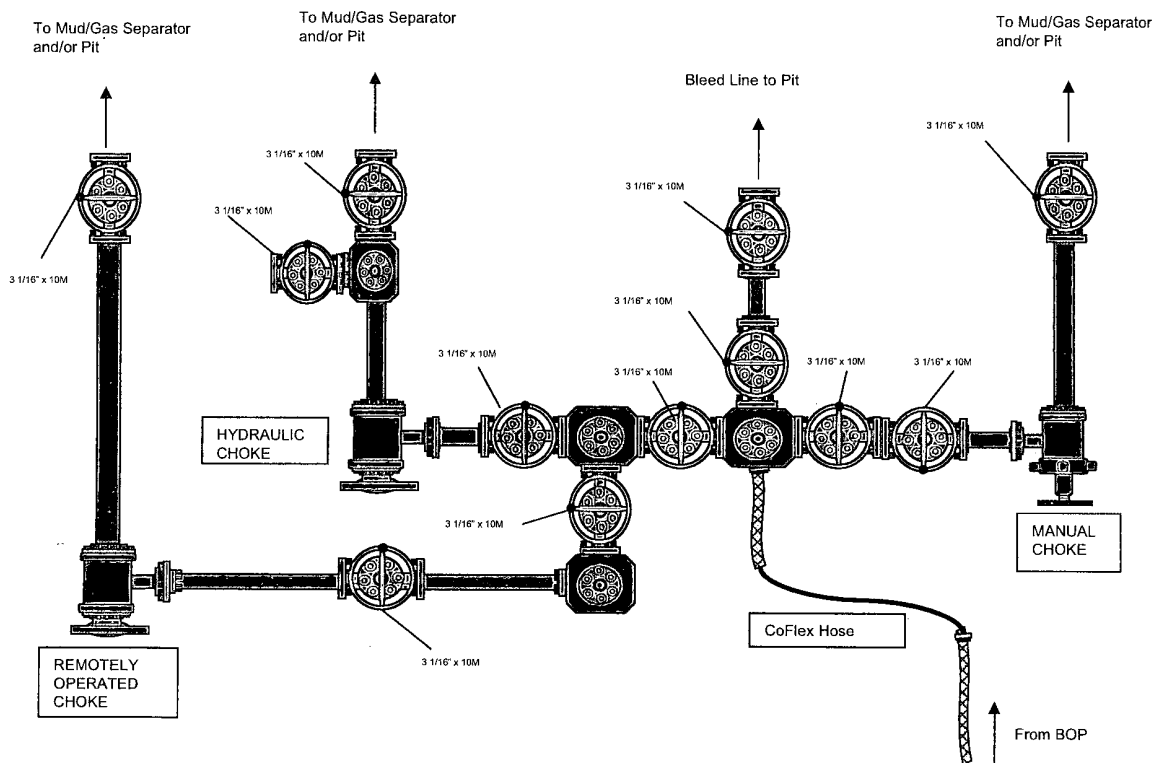

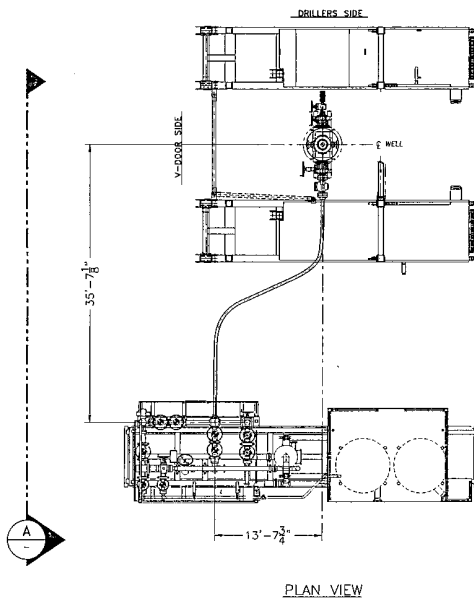

PLAN VIEW

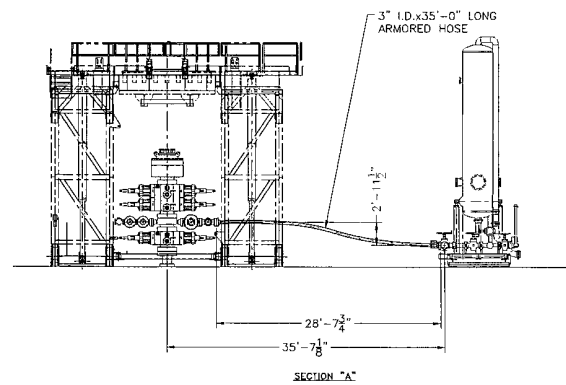

SECTION "A"

**ISSUED FOR
FABRICATION**
December-19-2007
DRAFTSMAN _____
ENGINEER _____

HELMERICH & PAYNE
INTERNATIONAL DRILLING CO.

CHOKE LINE SYSTEM
FLEXRIG3


CUSTOMER: _____
PROJECT: _____
DATE: 4-10-07 DWG. NO.: 210-P1-07
SCALE: 3/16"=1' SHEET 2 OF 3
REV. A

REV.	DATE	DESCRIPTION	BY
12/18/07		REMOVED SHEET TOTAL CALLOUT	JW


PROPRIETARY

THIS DRAWING AND THE IDEAS AND INFORMATION INCLUDED
IN THIS DRAWING ARE PROPRIETARY AND ARE NOT TO BE
REPRODUCED, DISTRIBUTED OR DISCLOSED IN ANY MANNER,
WITHOUT THE PRIOR WRITTEN CONSENT OF A QUALIFIED
OFFICER OF HELMERICH & PAYNE INTERNATIONAL DRILLING CO.

10M REMOTE
KILL LINE SCHEMATIC

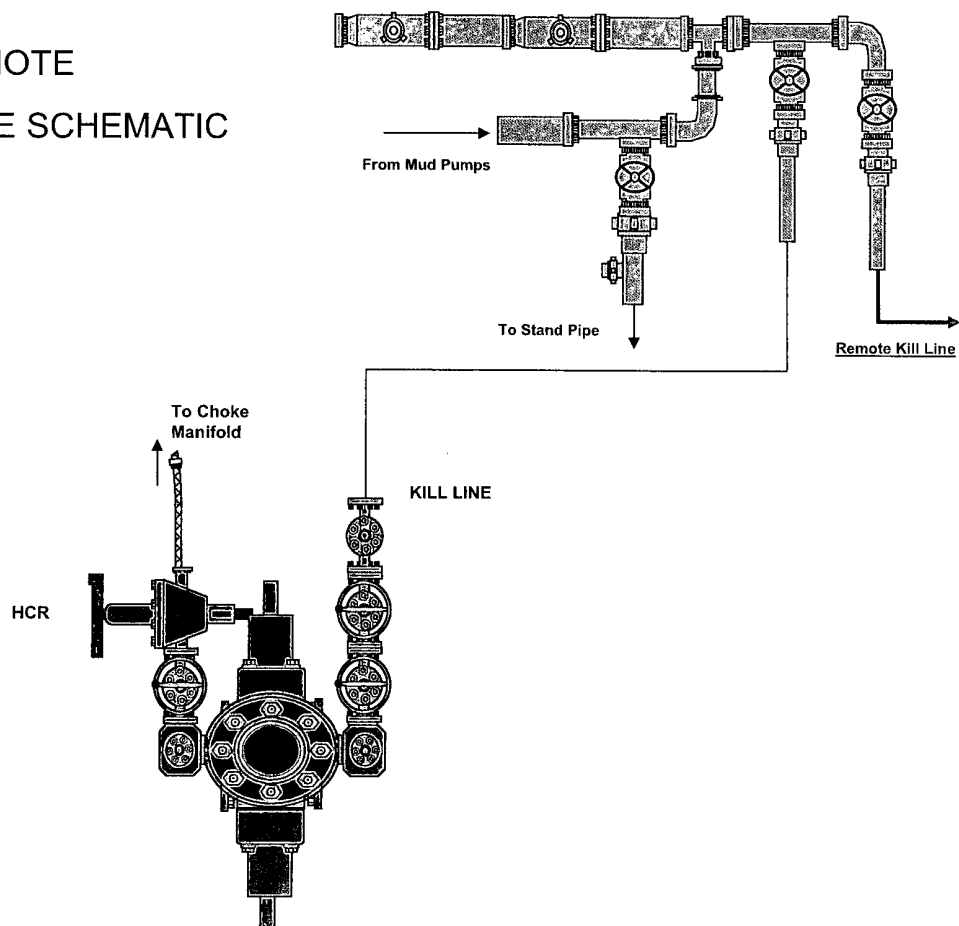



Flare Line Diagram

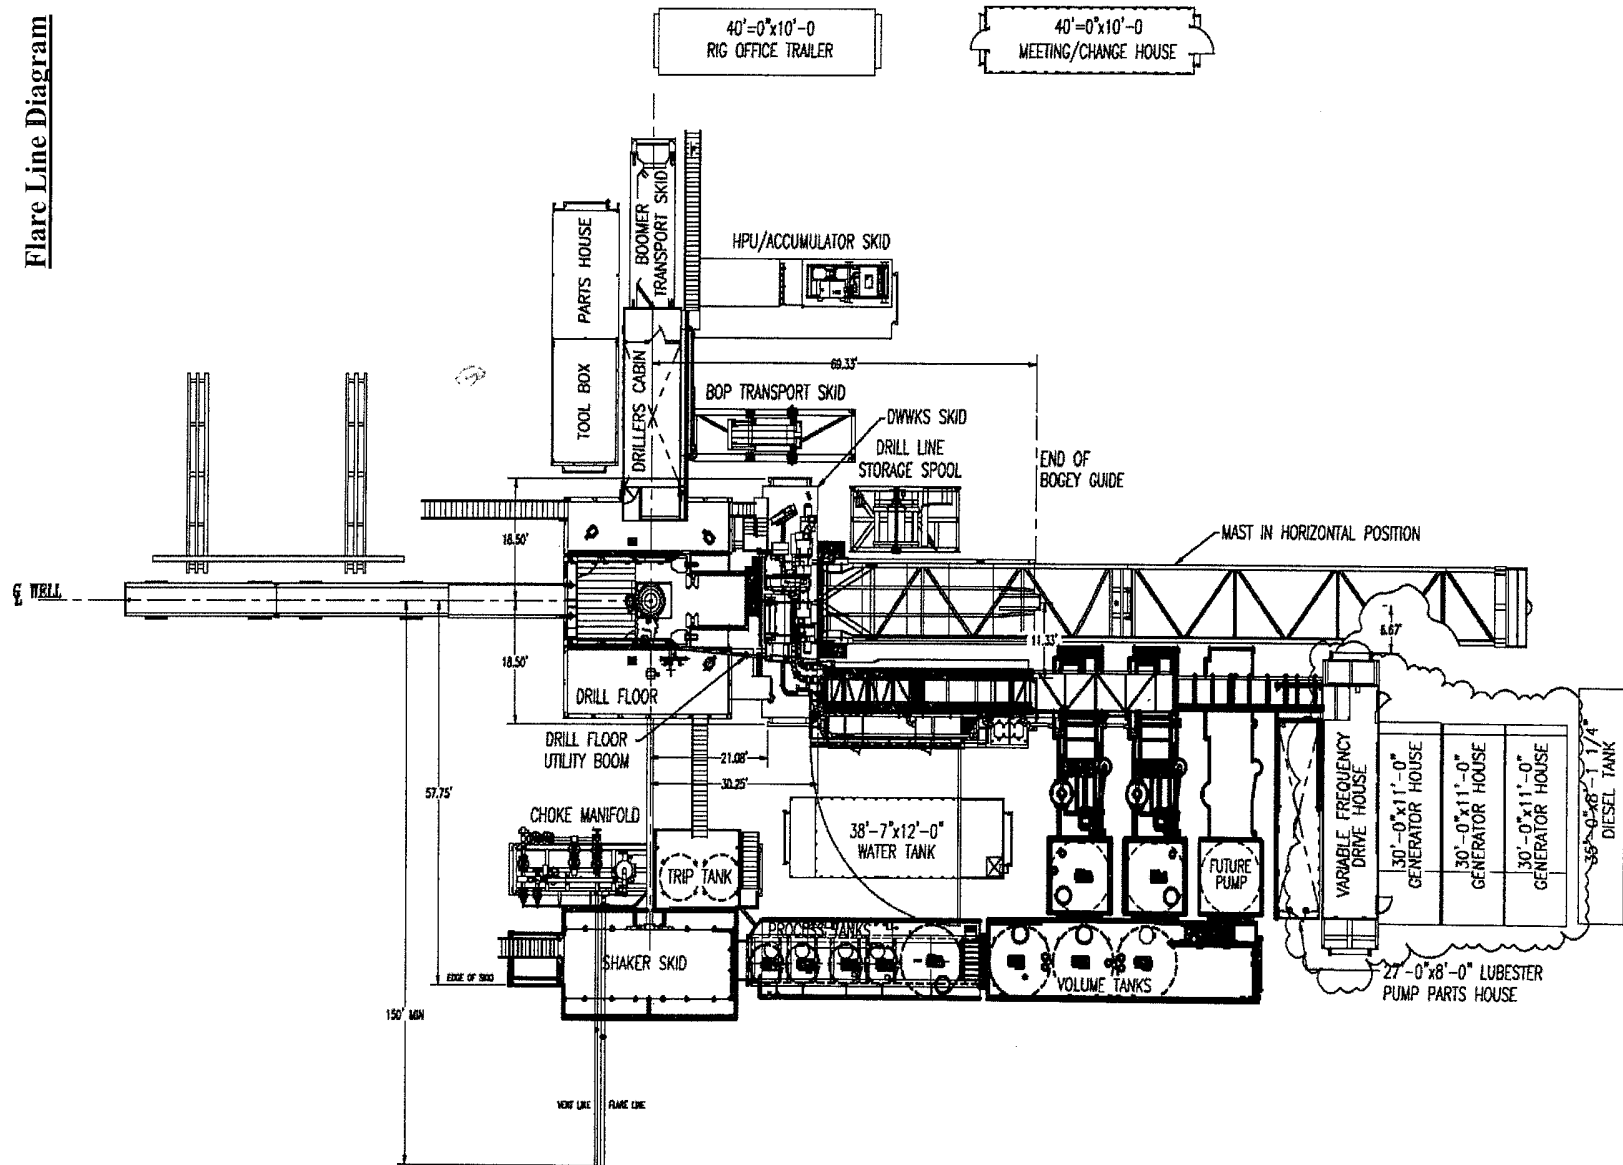

OXY FLEX III PAD (SCOMI Closed Loop System)

Level Area-No Caliche-For Offices and Living Quarters

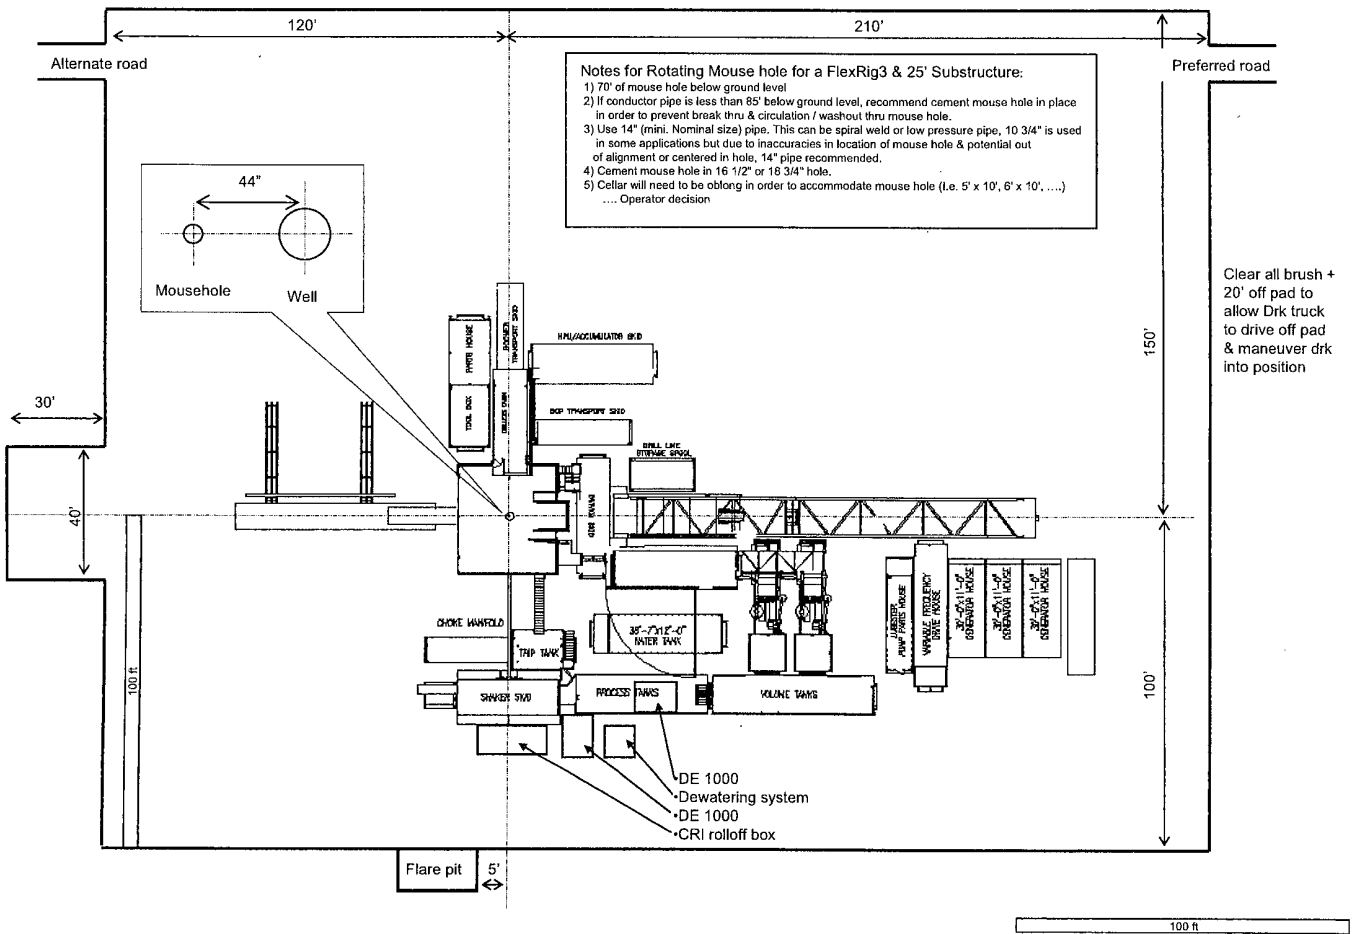

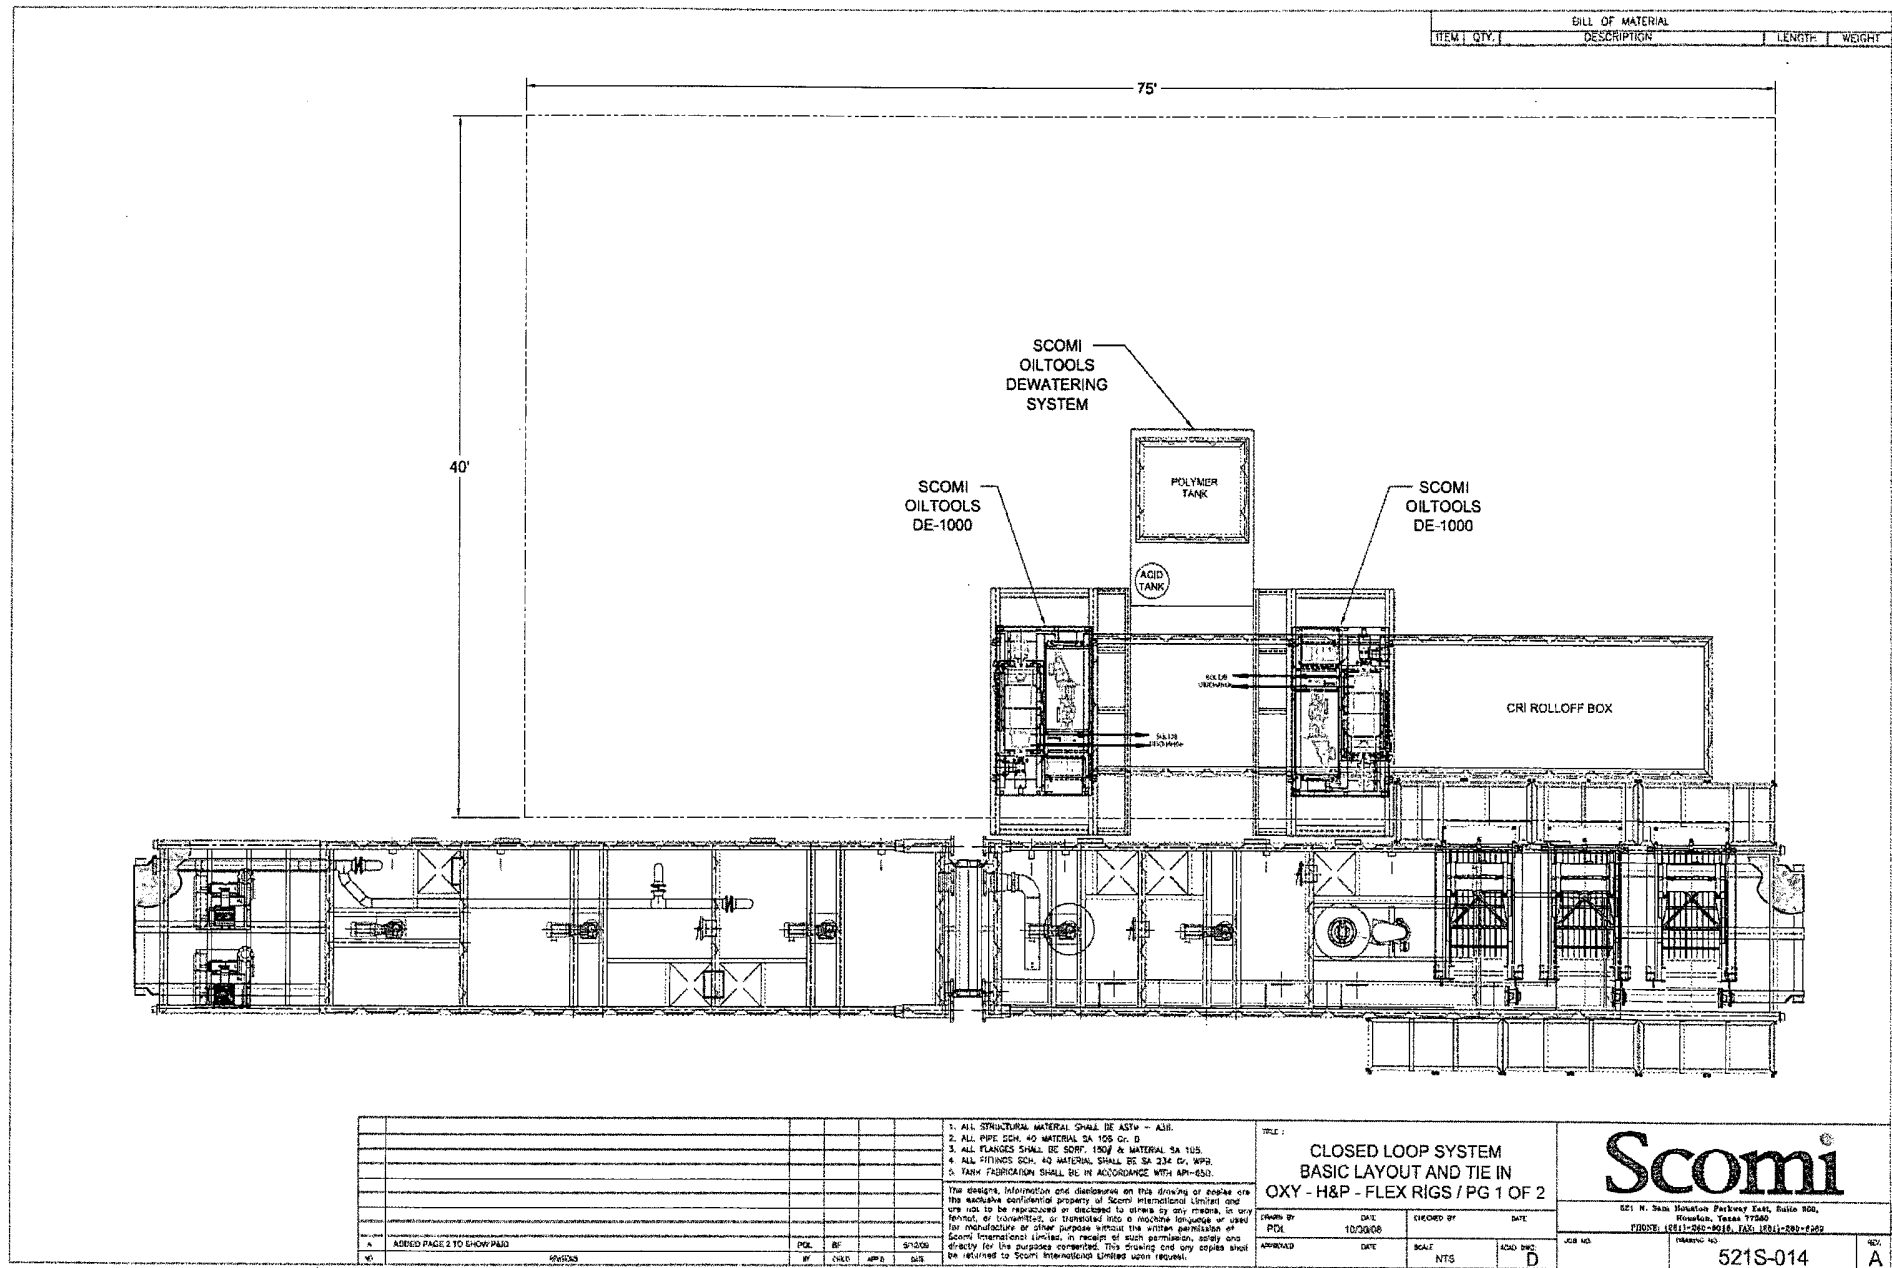

CERTIFICATE OF CONFORMITY


Supplier : CONTITECH RUBBER INDUSTRIAL KFT.
Equipment : 6 pcs. Choke and Kill Hose with installed couplings
Type : 3" x 10,67 m WP: 10000 psi
Supplier File Number : 412638
Date of Shipment : April. 2008
Customer : Phoenix Beattie Co.
Customer P.o. : 002491
Referenced Standards
/ Codes / Specifications : API Spec 16 C
Serial No.: 52754,52755,52776,52777,52778,52782

STATEMENT OF CONFORMITY

We hereby certify that the above items/equipment supplied by us are in conformity with the terms, conditions and specifications of the above Purchaser Order and that these items/equipment were fabricated inspected and tested in accordance with the referenced standards, codes and specifications and meet the relevant acceptance criteria and design requirements.

COUNTRY OF ORIGIN HUNGARY/EU

Signed :



ContiTech Rubber
Industrial Kft.
Quality Control Dept.
(1)

Position: Q.C. Manager

Date: 04. April. 2008



Material Identification Certificate

Cofflex Hose Certification

We hereby certify that these goods have been inspected by our Quality Management System, and to the best of our knowledge are found to conform to relevant industry standards within the requirements of the purchase order as issued to Phoenix Beattie Corporation.

05/23/09.

Coflex Hose Certification

Form No 100/12



Phoenix Beattie Corp

11635 Brittboore Park Drive
Houston, TX 77041
Tel: (832) 327-0141
Fax: (832) 327-0148
E-mail: mail@phoenixbeattie.com
www.phoenixbeattie.com

Delivery Note

Customer Order Number	370-369-001	Delivery Note Number	003078	Page	1
Customer / Invoice Address HELMERICH & PAYNE INT'L DRILLING CO 1437 SOUTH BOULDER TULSA, OK 74119		Delivery / Address HELMERICH & PAYNE IDC ATTN: JOE STEPHENSON - RIG 370 13609 INDUSTRIAL ROAD HOUSTON, TX 77015			

Customer Acc No	Phoenix Beattie Contract Manager	Phoenix Beattie Reference	Date
H01	JJL	006330	05/23/2008

Item No	Beattie Part Number / Description	Qty Ordered	Qty Sent	Qty To Follow
1	HP10CK3A-35-4F1 3" 10K 16C C&K HOSE x 35ft OAL CW 4.1/16" API SPEC FLANGE E/ End 1: 4.1/16" 10Kpsi API Spec 6A Type 6BX Flange End 2: 4.1/16" 10Kpsi API Spec 6A Type 6BX Flange c/w BX155 Standard ring groove at each end Suitable for H2S Service Working pressure: 10,000psi Test pressure: 15,000psi Standard: API 16C Full specification Armor Guarding: Included Fire Rating: Not Included Temperature rating: -20 Deg C to +100 Deg C	1	1	0
2	SECK3-HPF3 LIFTING & SAFETY EQUIPMENT TO SUIT HP10CK3-35-F1 2 x 160mm ID Safety Clamps 2 x 244mm ID Lifting Collars & element C's 2 x 7ft Stainless Steel wire rope 3/4" OD 4 x 7.75t Shackles	1	1	0
3	SC725-200CS SAFETY CLAMP 200MM 7.25T C/S GALVANISED	1	1	0


Continued...

All goods remain the property of Phoenix Beattie until paid for in full. Any damage or shortage on this delivery must be advised within 5 days.
Returns may be subject to a handling charge.

Coflex Hose Certification



Fluid Technology
Quality Document

QUALITY CONTROL INSPECTION AND TEST CERTIFICATE				CERT. N°: 746	
PURCHASER: Phoenix Beattle Co.				P.O. N°: 002491	
CONTITECH ORDER N°: 412638		HOSE TYPE: 3" ID Choke and Kill Hose			
HOSE SERIAL N°: 52777		NOMINAL / ACTUAL LENGTH: 10,67 m			
W.P. 68,96 MPa 10000 psi		T.P. 103,4 MPa 15000 psi		Duration: 60 ~ min.	
Pressure test with water at ambient temperature See attachment. (1 page) ↑ 10 mm = 10 Min. → 10 mm = 25 MPa					
COUPLINGS					
Type	Serial N°		Quality	Heat N°	
3" coupling with 4 1/16" Flange end	917 913		AISI 4130	T7998A	
			AISI 4130	26984	
INFOCHIP INSTALLED				API Spec 16 C Temperature rate: "B"	
All metal parts are flawless					
WE CERTIFY THAT THE ABOVE HOSE HAS BEEN MANUFACTURED IN ACCORDANCE WITH THE TERMS OF THE ORDER AND PRESSURE TESTED AS ABOVE WITH SATISFACTORY RESULT.					
Date: 04. April. 2008		Inspector		Quality Control   ContiTech Rubber Industrial Kft. Quality Control Dept. (1)	

Coflex Hose Certification

Form No 100/12



Phoenix Beattie Corp

11535 Brittmoore Park Drive
Houston, TX 77041
Tel: (832) 327-0141
Fax: (832) 327-0148
E-mail: mail@phoenixbeattie.com
www.phoenixbeattie.com

Delivery Note

Customer Order Number	370-369-001	Delivery Note Number	003078	Page	2
Customer / Invoice Address HELMERICH & PAYNE INT'L DRILLING CO 1437 SOUTH BOULDER TULSA, OK 74119		Delivery / Address HELMERICH & PAYNE IDC ATTN: JOE STEPHENSON - RIG 370 13609 INDUSTRIAL ROAD HOUSTON, TX 77015			

Customer Acc No	Phoenix Beattie Contract Manager	Phoenix Beattie Reference	Date
H01	JJL	006330	05/23/2008

Item No	Beattie Part Number / Description	Qty Ordered	Qty Sent	Qty To Follow
4	SC725-132CS SAFETY CLAMP 132MM 7.25T C/S GALVANIZED C/W BOLTS	1	1	0
5	00CERT-HYDRO HYDROSTATIC PRESSURE TEST CERTIFICATE	1	1	0
6	00CERT-LOAD LOAD TEST CERTIFICATES	1	1	0
7	00FREIGHT INBOUND / OUTBOUND FREIGHT PRE-PAY & ADD TO FINAL INVOICE NOTE: MATERIAL MUST BE ACCOMPANIED BY PAPERWORK INCLUDING THE PURCHASE ORDER, RIG NUMBER TO ENSURE PROPER PAYMENT	1	1	0

Phoenix Beattie Inspection Signature :

Received in Good Condition : Signature

Print Name

Date

All goods remain the property of Phoenix Beattie until paid for in full. Any damage or shortage on this delivery must be advised within 5 days. Returns may be subject to a handling charge.