




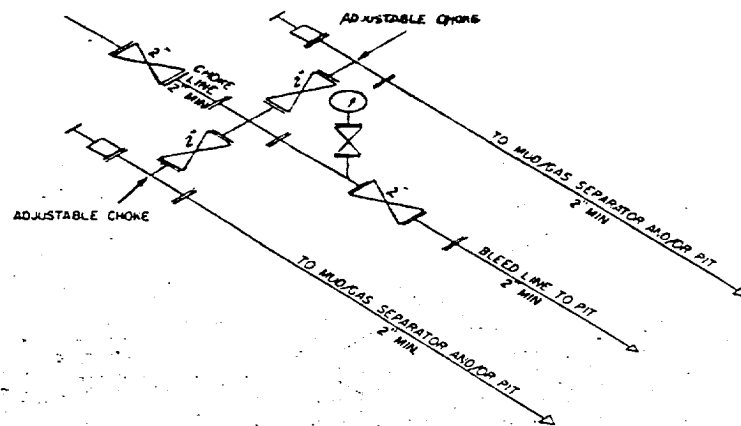

2M CHOKES MANIFOLD EQUIPMENT — CONFIGURATION MAY VARY

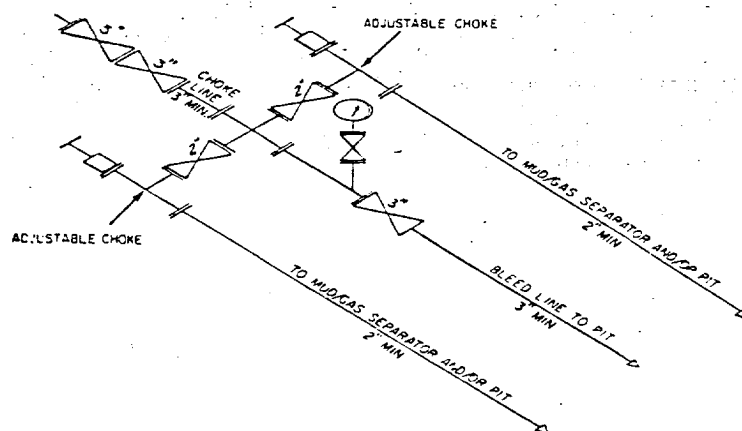

3M CHOKES MANIFOLD EQUIPMENT — CONFIGURATION MAY VARY

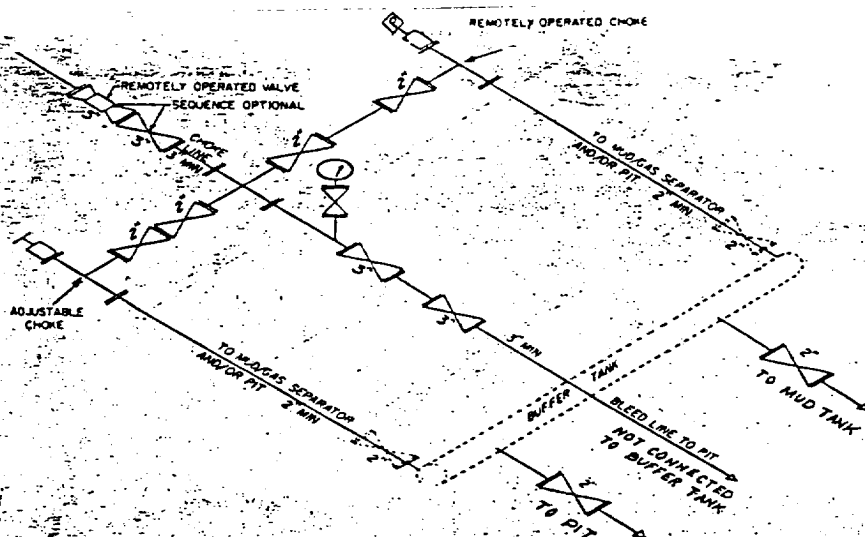

5M CHOKES MANIFOLD EQUIPMENT — CONFIGURATION MAY VARY

Although not required for any of the choke manifold systems, buffer tanks are sometimes installed downstream of the choke assemblies for the purpose of manifolded the bleed lines together. When buffer tanks are employed, valves shall be installed upstream to isolate a failure or malfunction without interrupting flow control. Though not shown on 2M, 3M, 10M, or 15M drawings, it would also be applicable to those situations.

Hand 2/26/90

ELF

RECEIVED

NOV 7 1989

**OCB
HOBBS OFFICE**