


MARSHALL PIPE & SUPPLY CO.

WELL: WENDELL BEST NO. 1

ELEMENT NO. 45733 (0-4000 PSI)

DATE: 5/20-23/86

B.H.P. DELTA PLOT

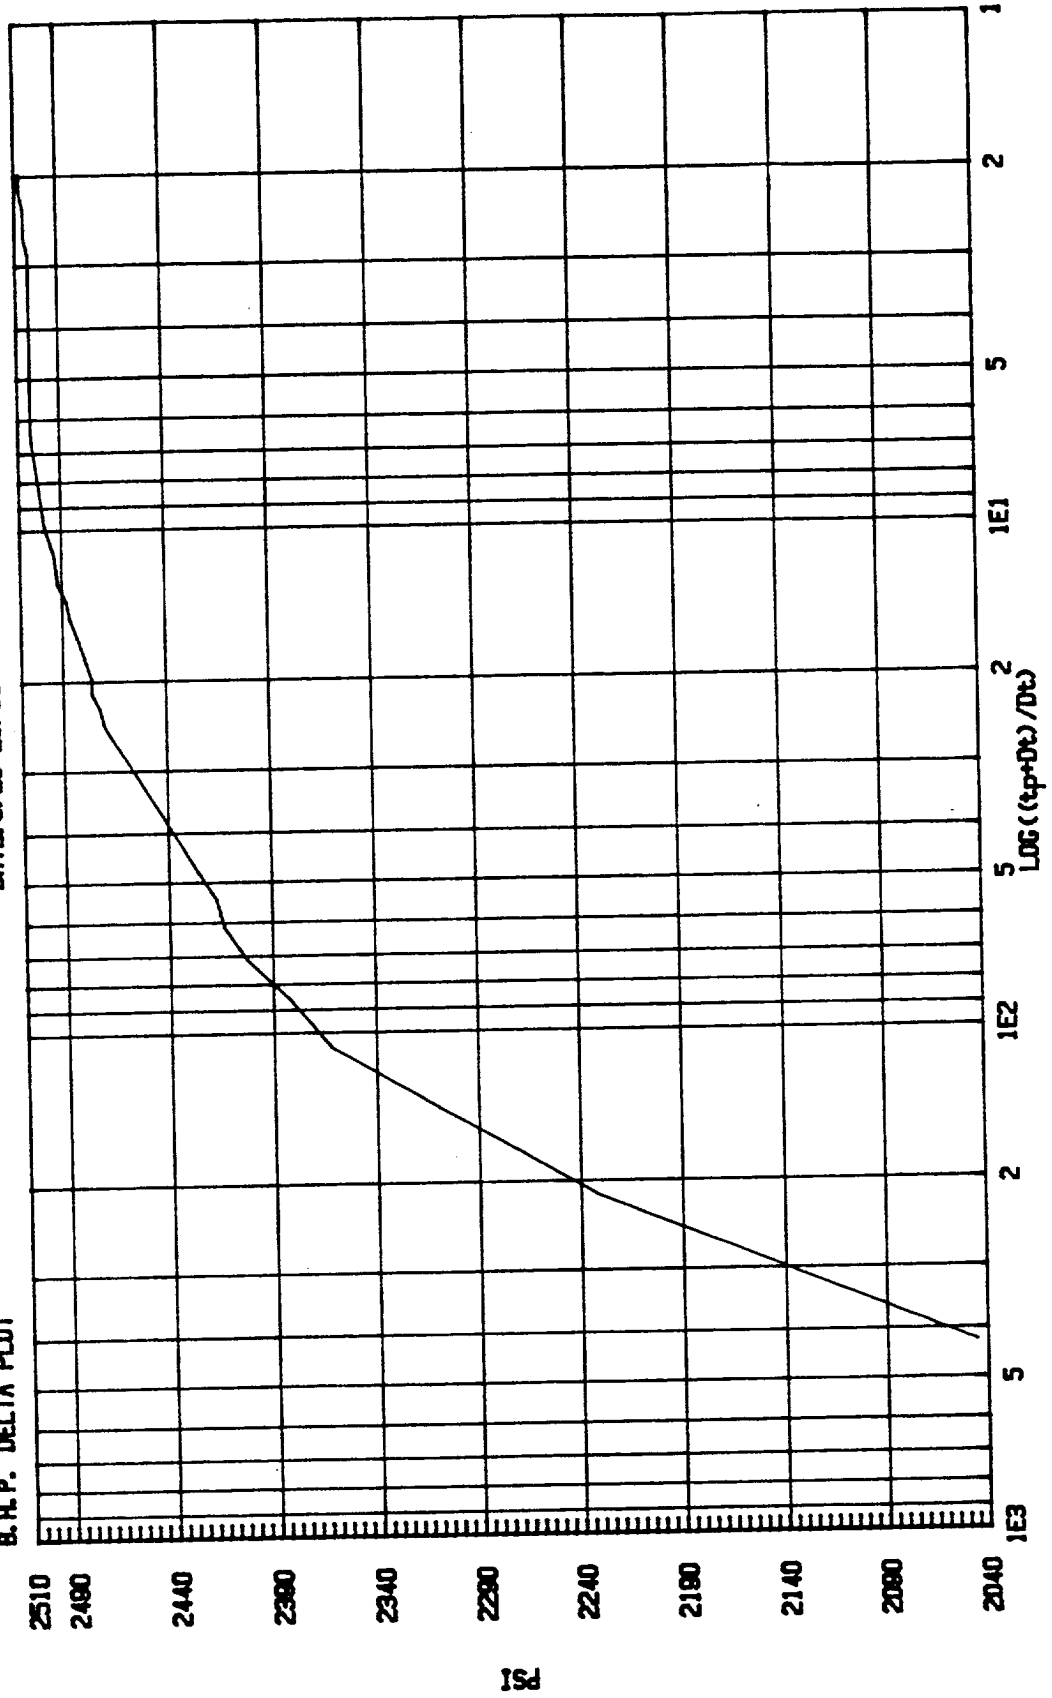

TEST CONDUCTED BY: JOHN WEST ENGINEERING COMPANY