


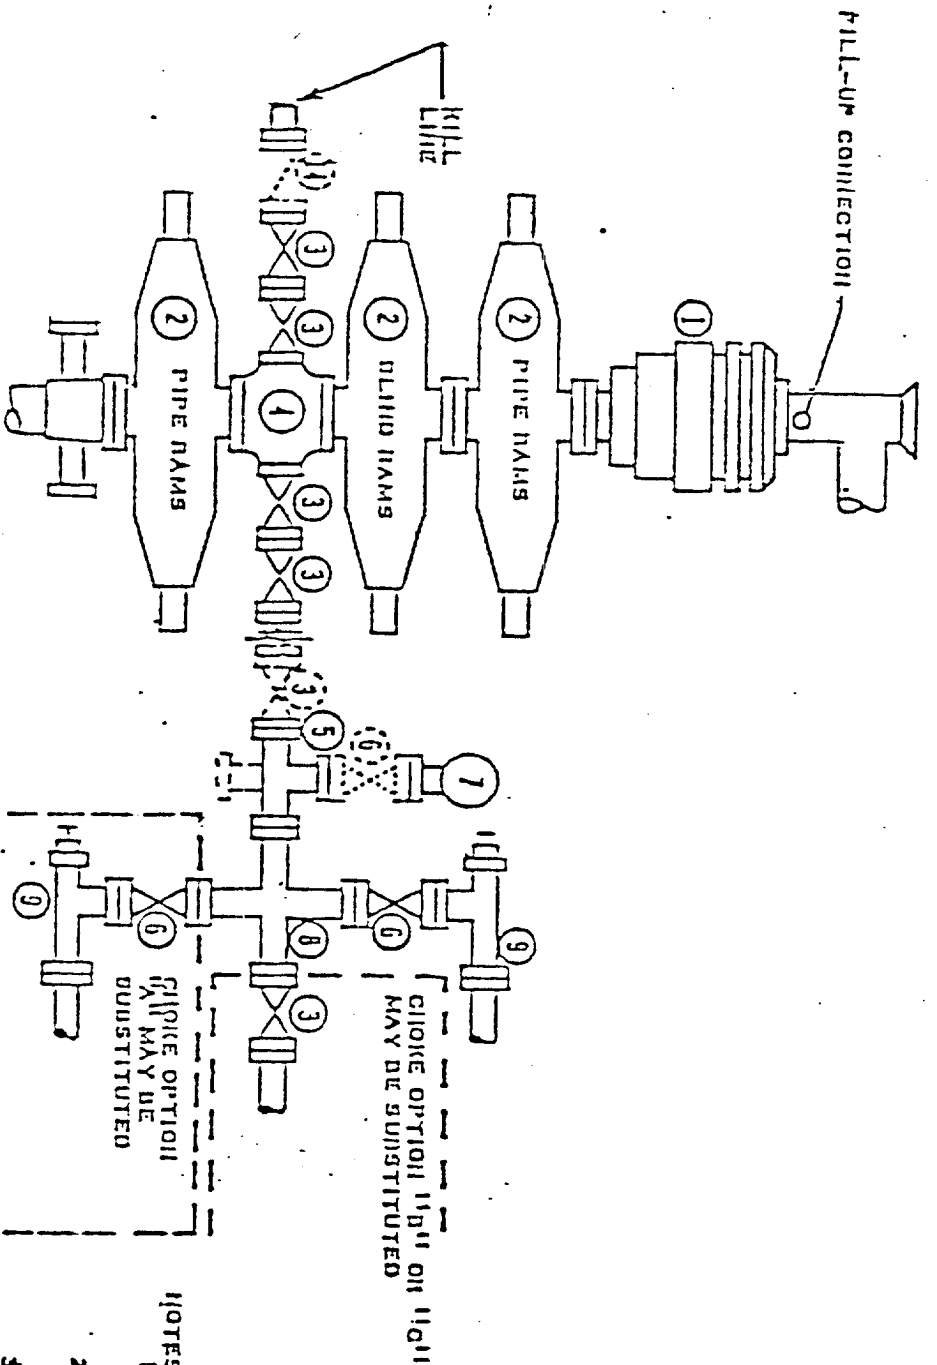

NOTES

1. 5000 PSI WP OR BETTER CLAMP FLANGES MAY BE SUBSTITUTED FOR FLANGES
2. ONE ADJUSTABLE CHOKE MAY BE REPLACED WITH A POSITIVE CHOKE
3. VALVES MAY BE EITHER HAND OR POWER OPERATED BUT, IF POWER OPERATED, THE VALVES FLANGED TO THE BOP MUST BE CAPABLE OF BEING OPENED AND CLOSED MANUALLY ON CLOSE OR POWER FAILURE AND BE CAPABLE OF BEING OPERATED MANUALLY

1. 5000 PSI WORKING PRESSURE BLOWOUT PREVENTER (BOP)
2. 1500 PSI TYPE BOP (8)
3. 1500 PSI VALVE
4. 1500 PSI VALVE
5. 1500 PSI VALVE
6. 1500 PSI VALVE
7. 1500 PSI VALVE
8. 1500 PSI VALVE
9. 1500 PSI VALVE
10. 1500 PSI VALVE
11. 1500 PSI VALVE
12. 1500 PSI VALVE
13. 1500 PSI VALVE
14. 1500 PSI VALVE

5000 PSI WORKING PRESSURE  
BLOWOUT PREVENTER (BOP)  
(SERIES 1500 FLANGES OR BETTER)