




1000 # Spring
American Valve & Meter
Jerry Martin
Date of Calib 8-1-01
Shaun Myers LFT
Test Date 10-10-01
State P # 14
Q18P @ 11,040

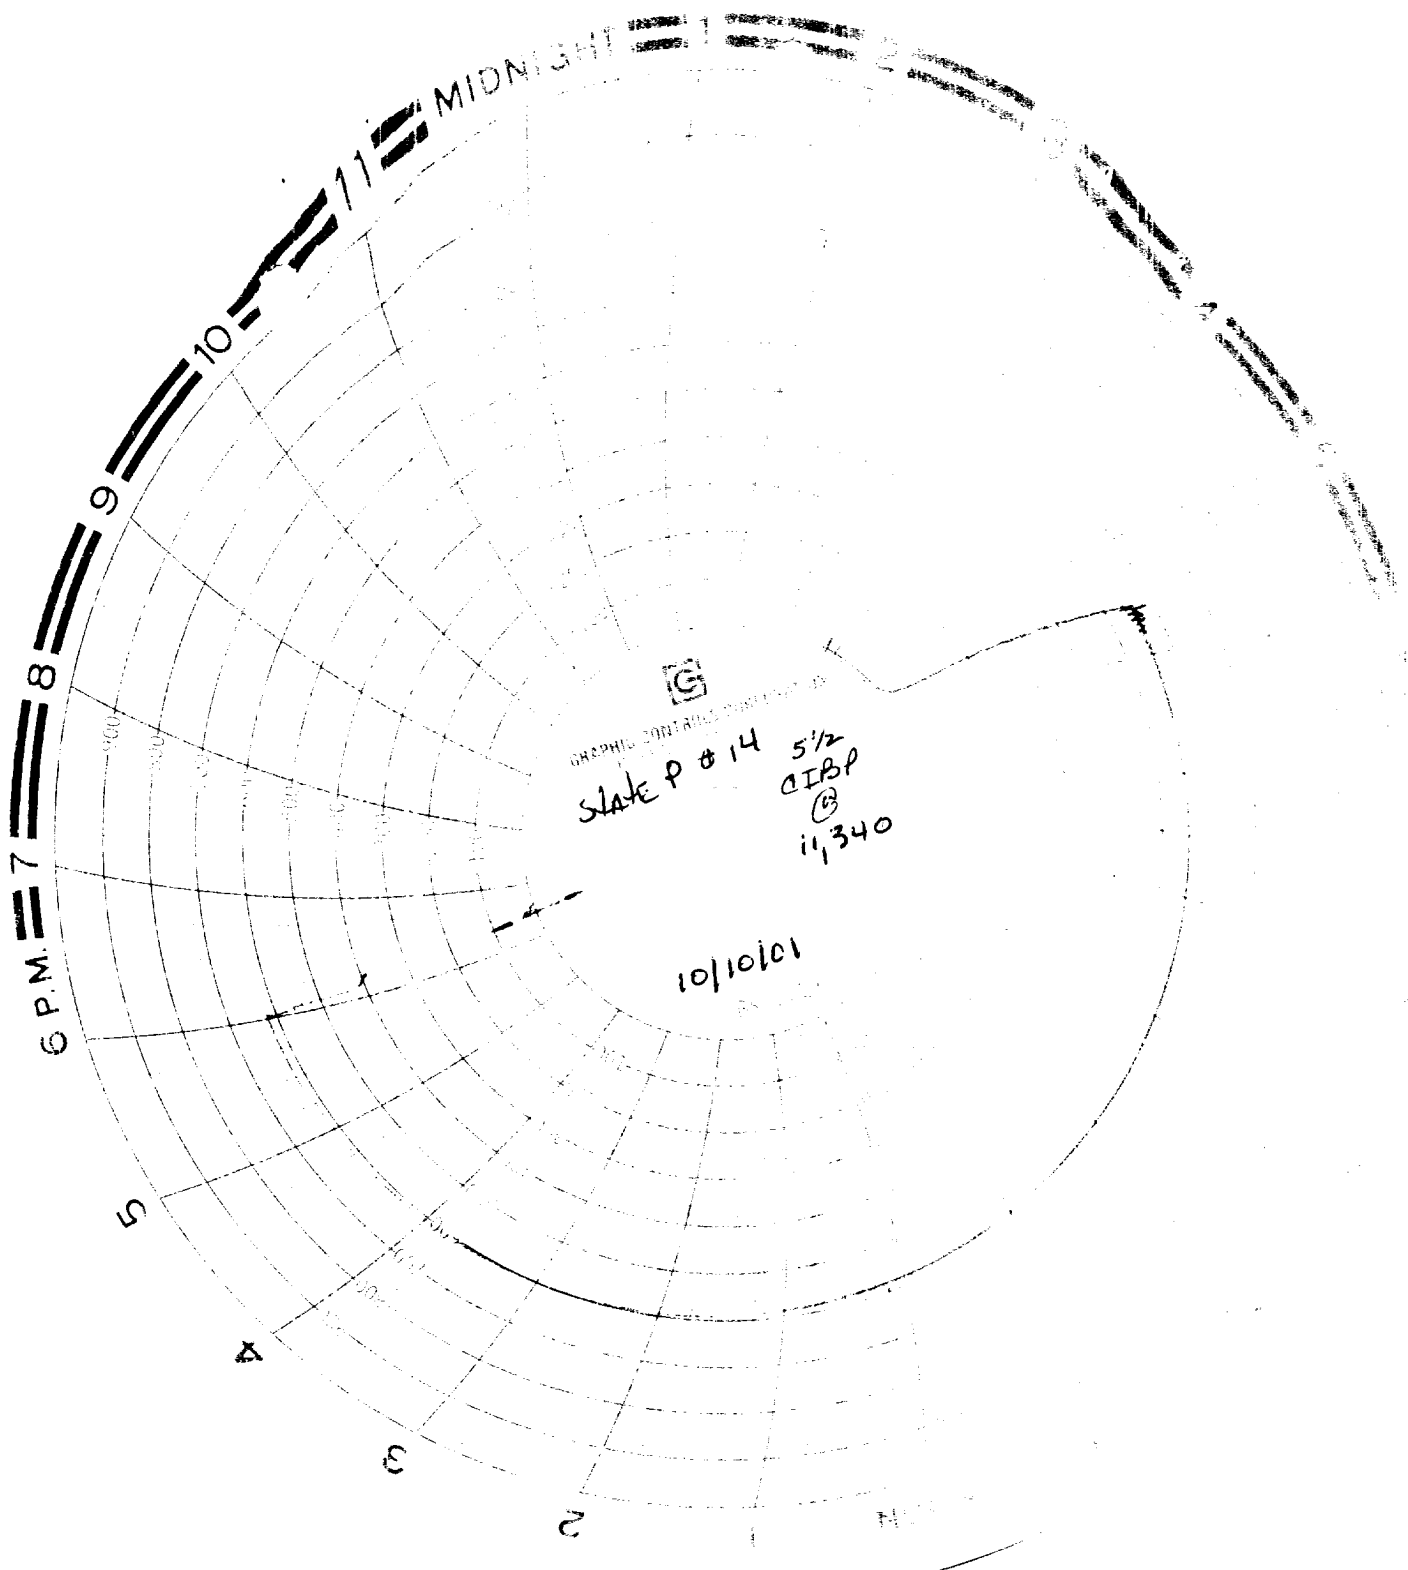