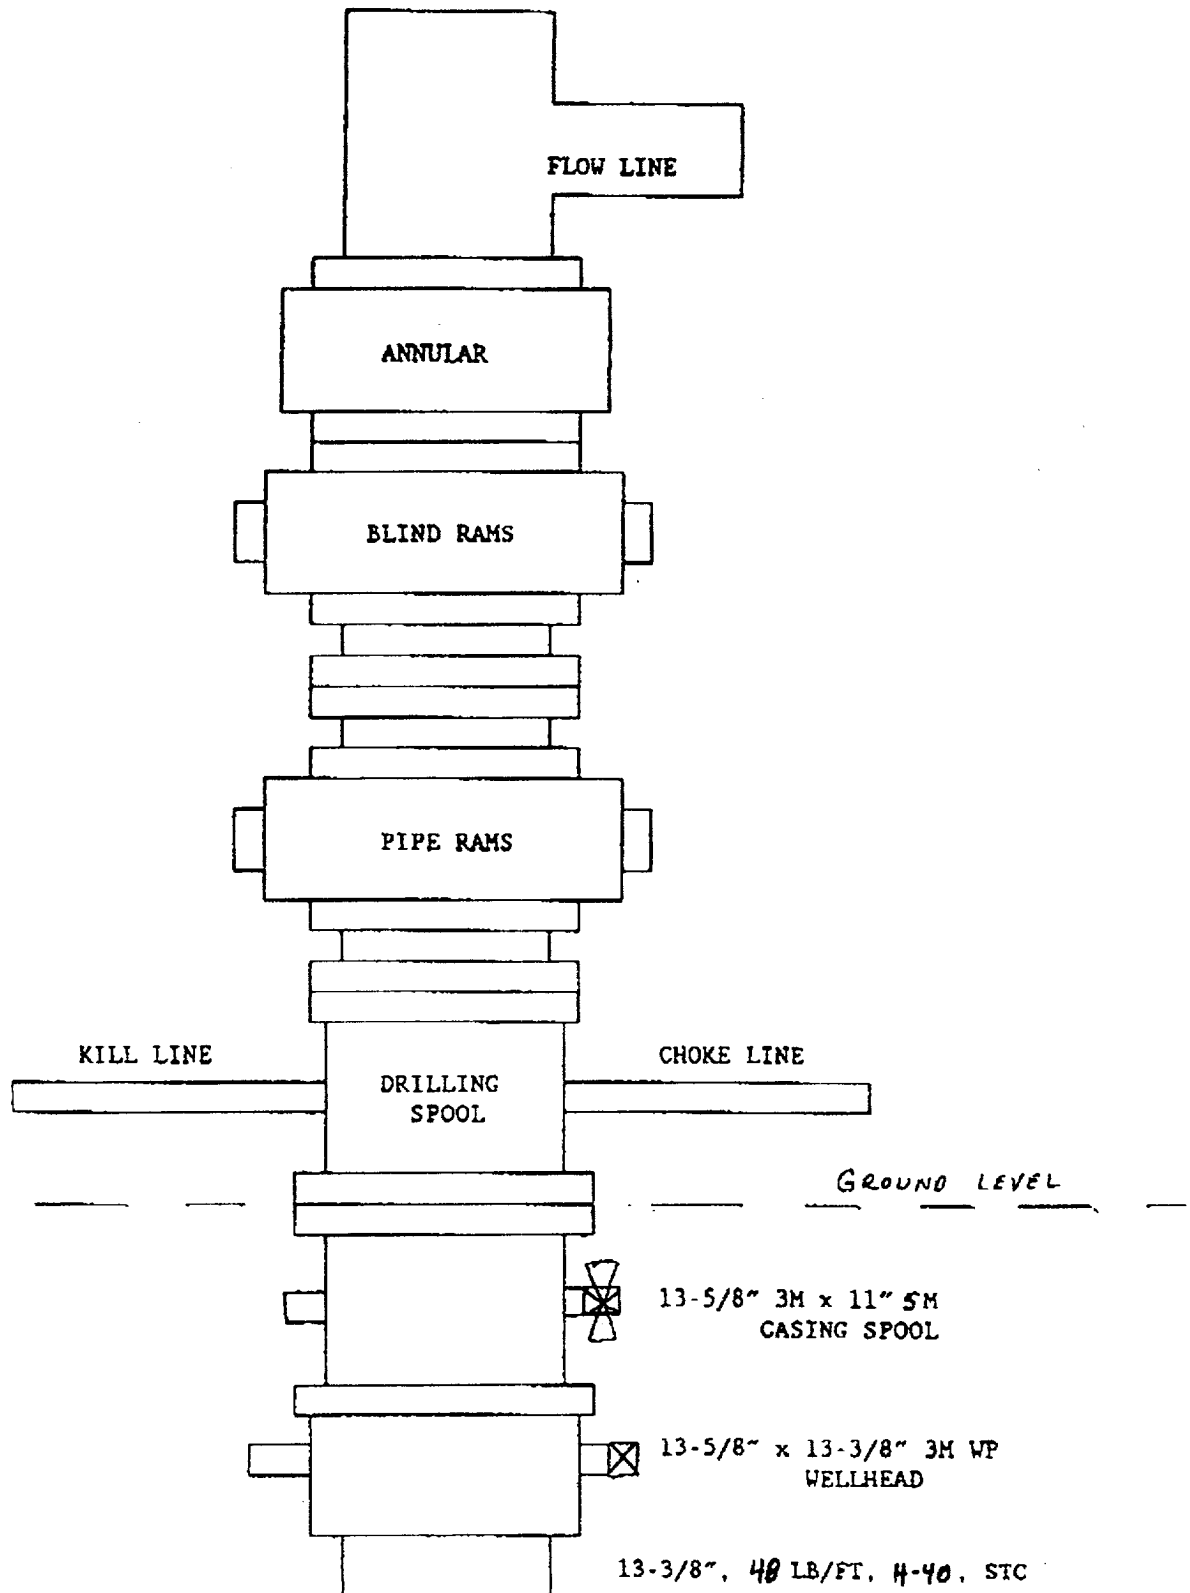


*ENERGEN RESOURCES CO. RATION**BEADLE # 1***BOP EQUIPMENT**

MINIMUM BOP REQUIREMENT 5000 PSI W.P.

TOTAL P.02

ABOVE DATE DOES NOT
INDICATE WHEN
CONFIDENTIAL LOGS
WILL BE RELEASED

ELF