


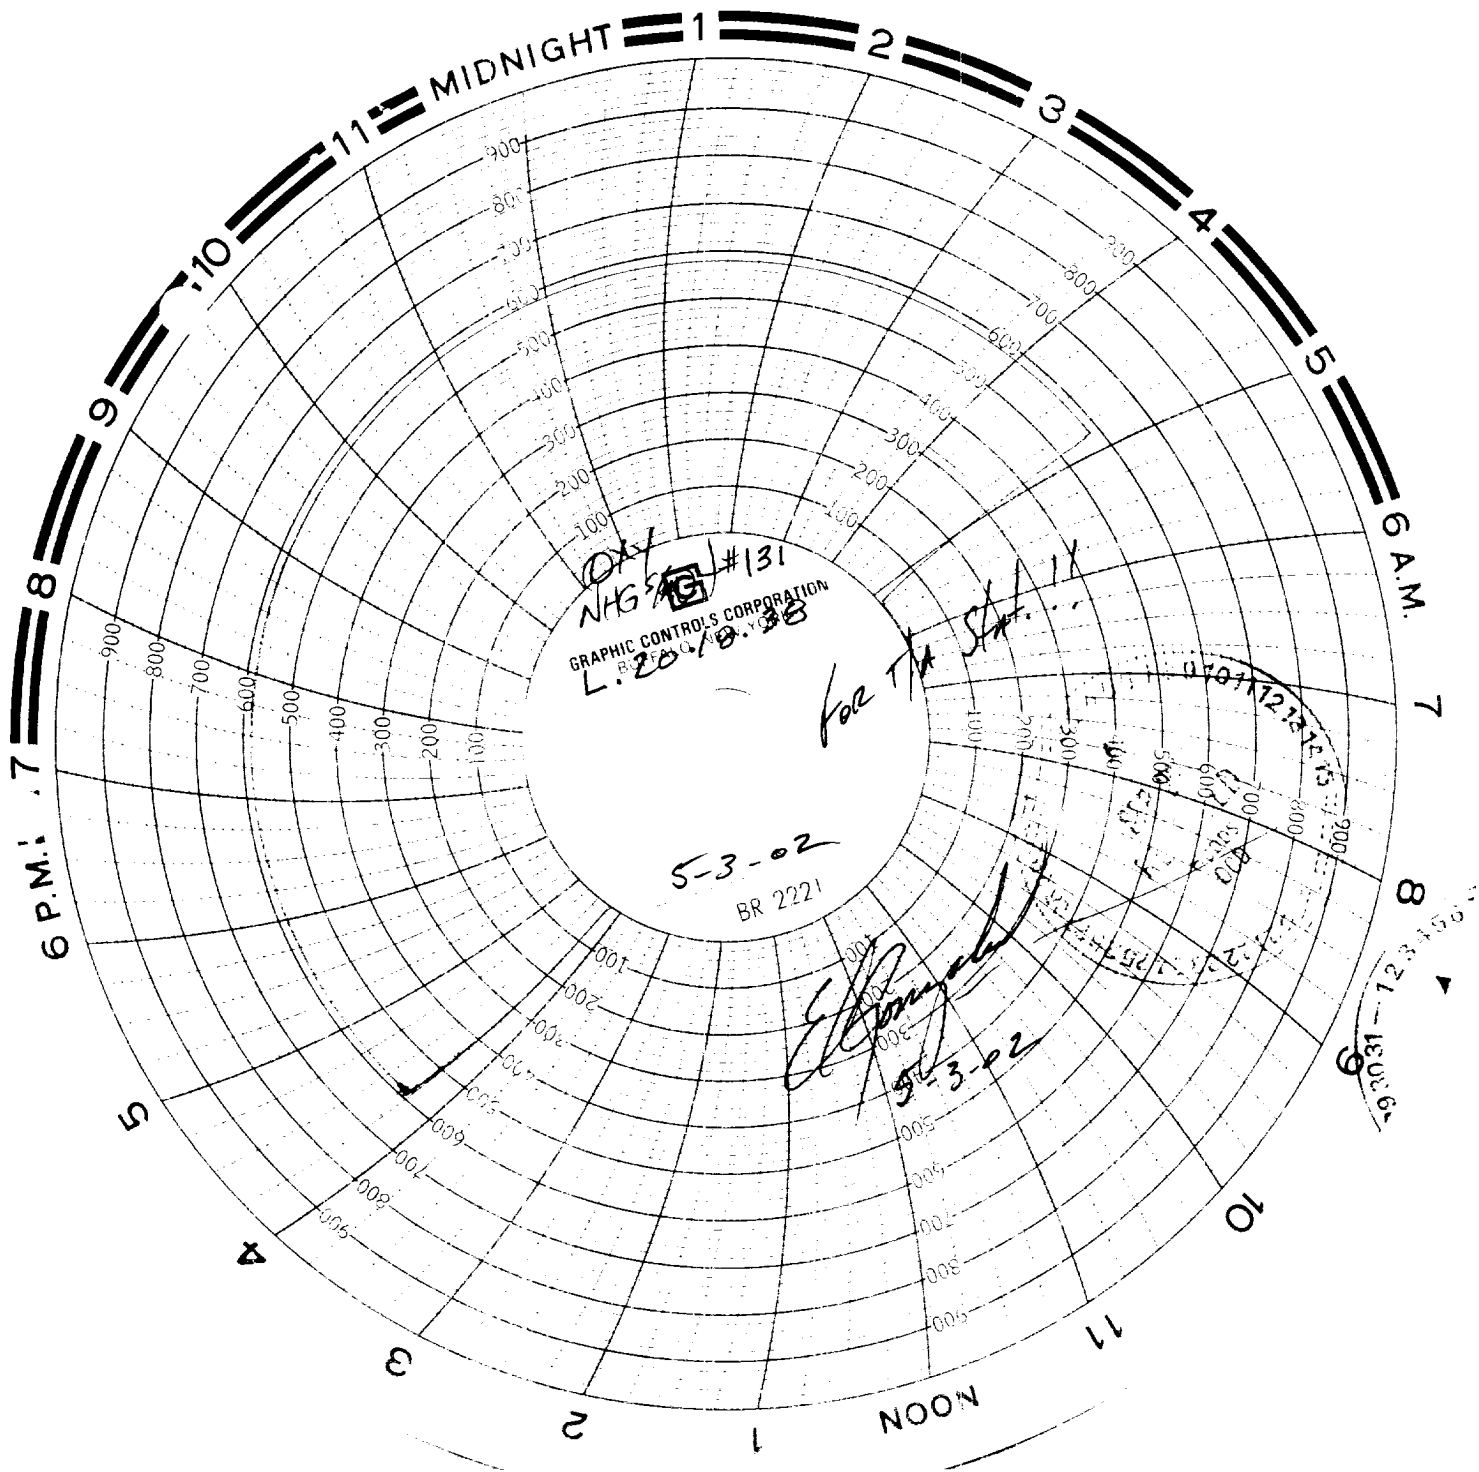

DX4
NHG S/A ut # 121
L. 20.18.38

Start PSI 580 #
fin " 580 #

Time 31 min

Caldate 5.2.02

Spring 1000 #

Clock 60 min

Tag slight low

Aug. 1

Start 2

Alt comp 11

SI/week

Test for T/A 5/21

In/comp

El Pomaba
5.3.02