


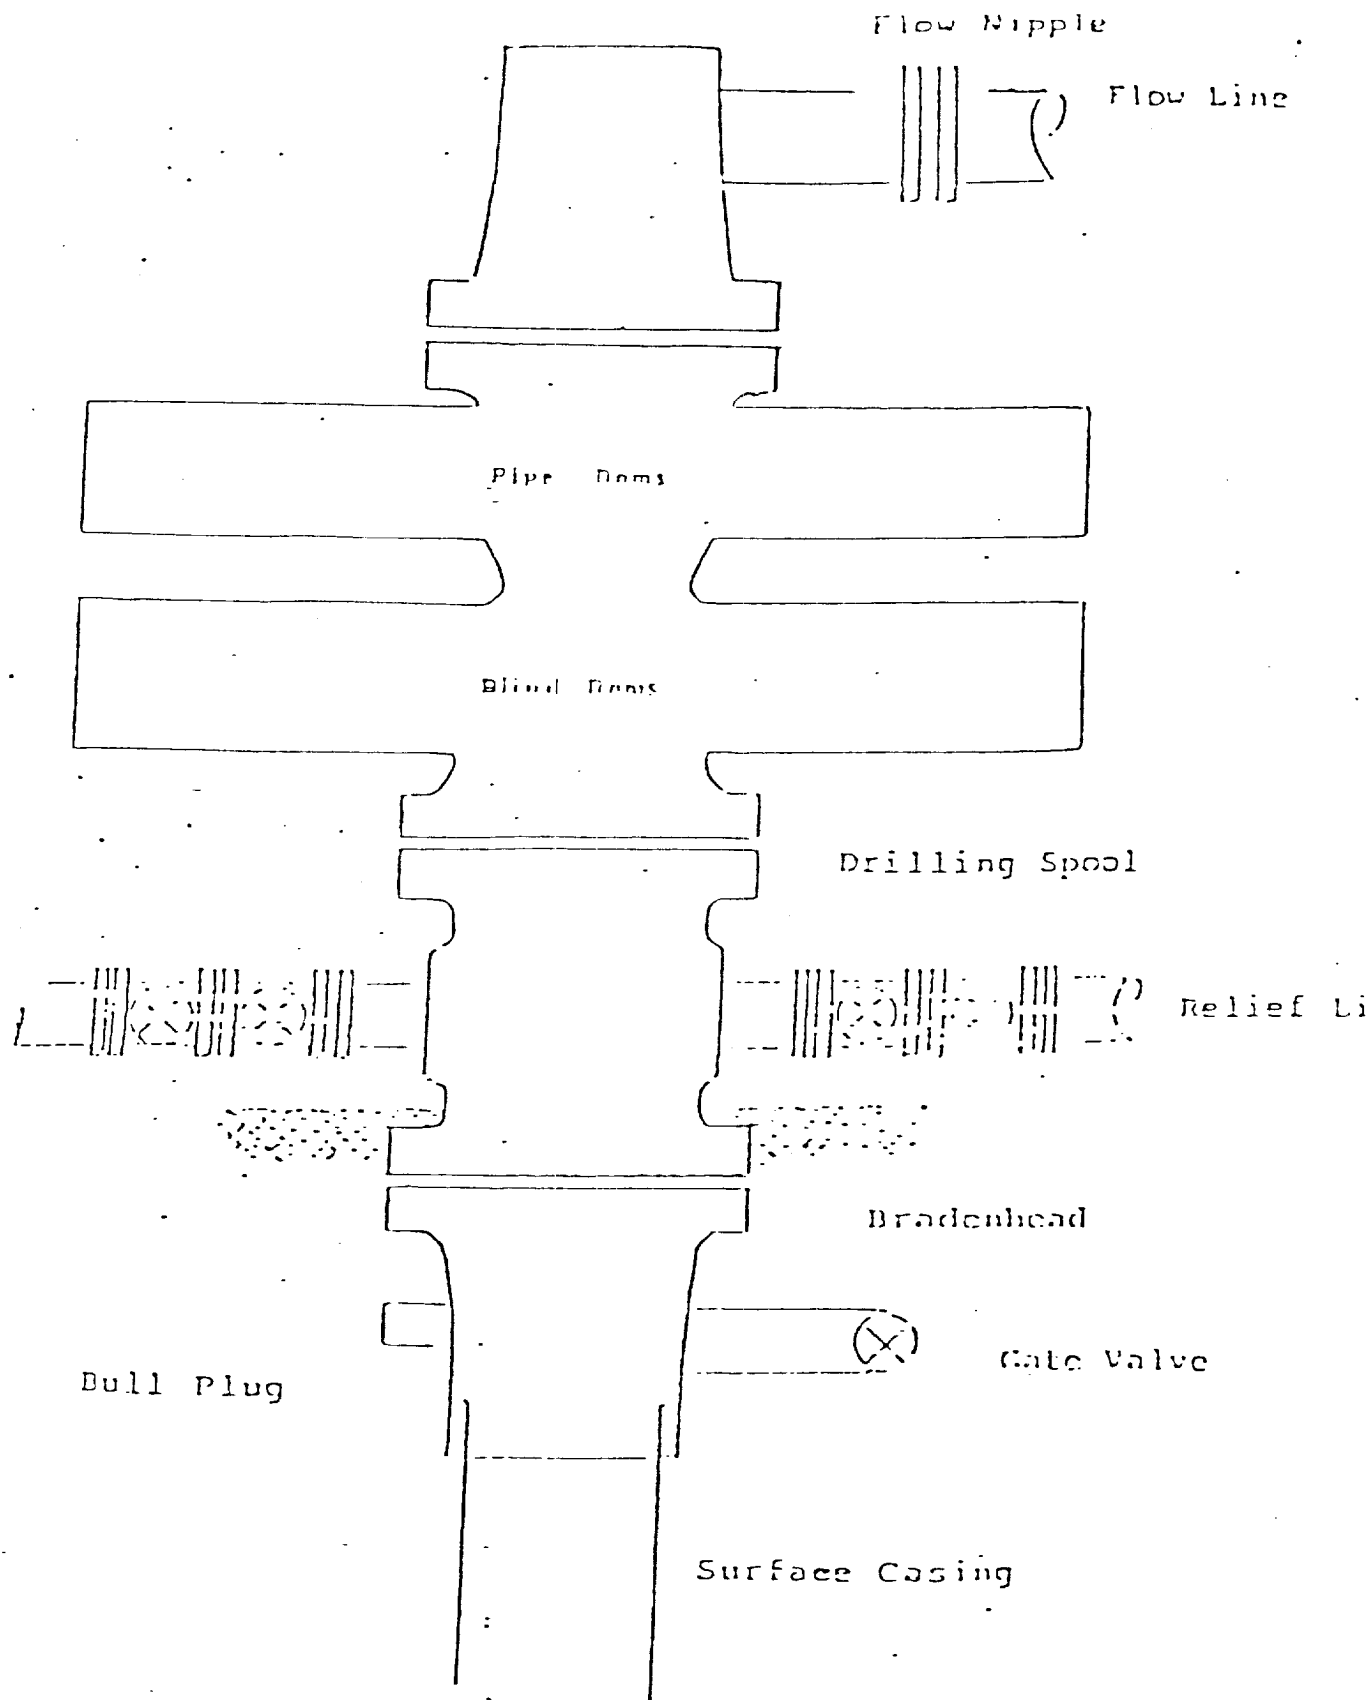

Series 900 Double Gate BOP, rated
at 3000 psi Working Pressure

Blowout Preventer Arrangement

Steve Sell
Marathon State #1
330' FSL and 330' FWL of S18-
Township 17 South, Range 34E

Received
JUL 21 1996
S.C.P.
13255 EXD/11

1000
1000
1000