


SEALE FEDERAL #2 BACKPRESSURE TEST 8-20-56

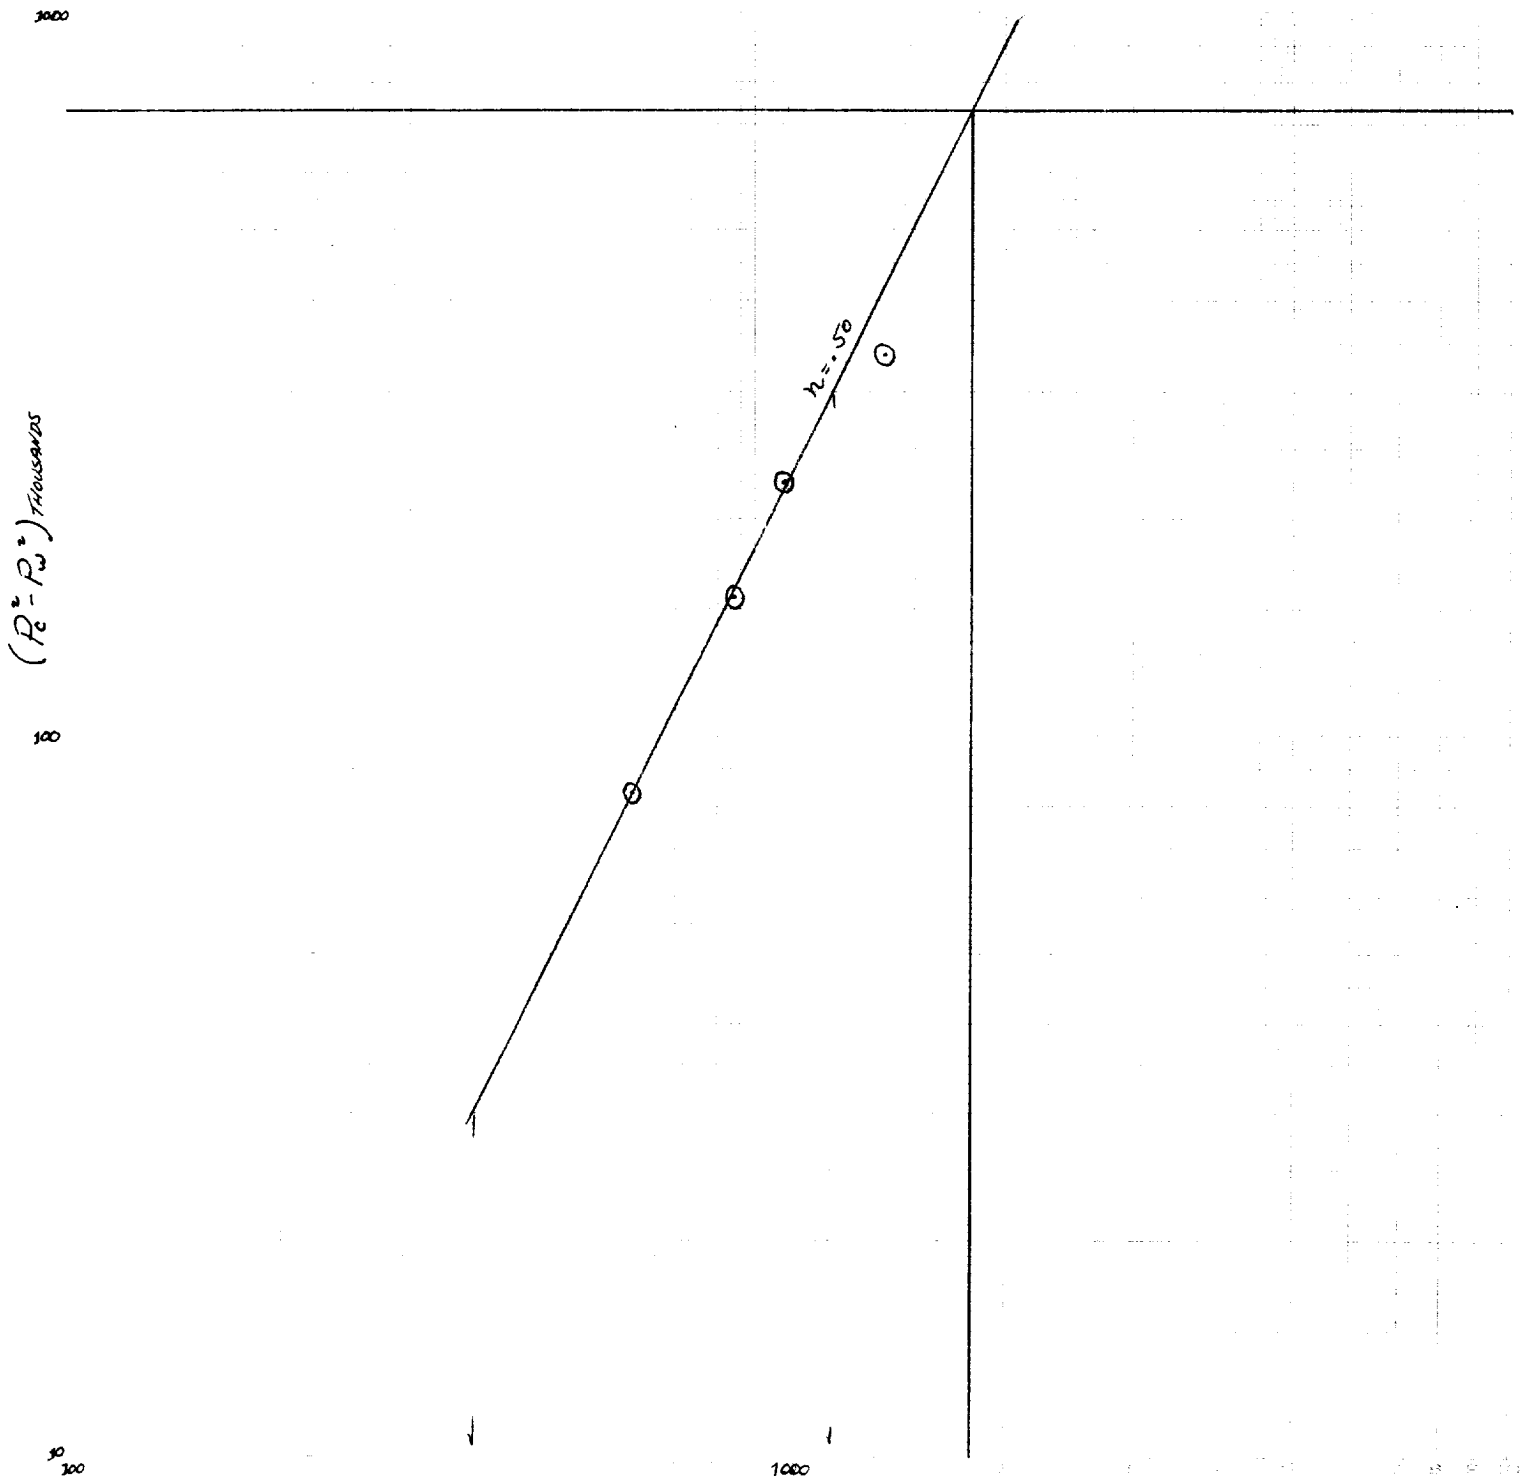

Q - MCFD

ILLEGIBLE