


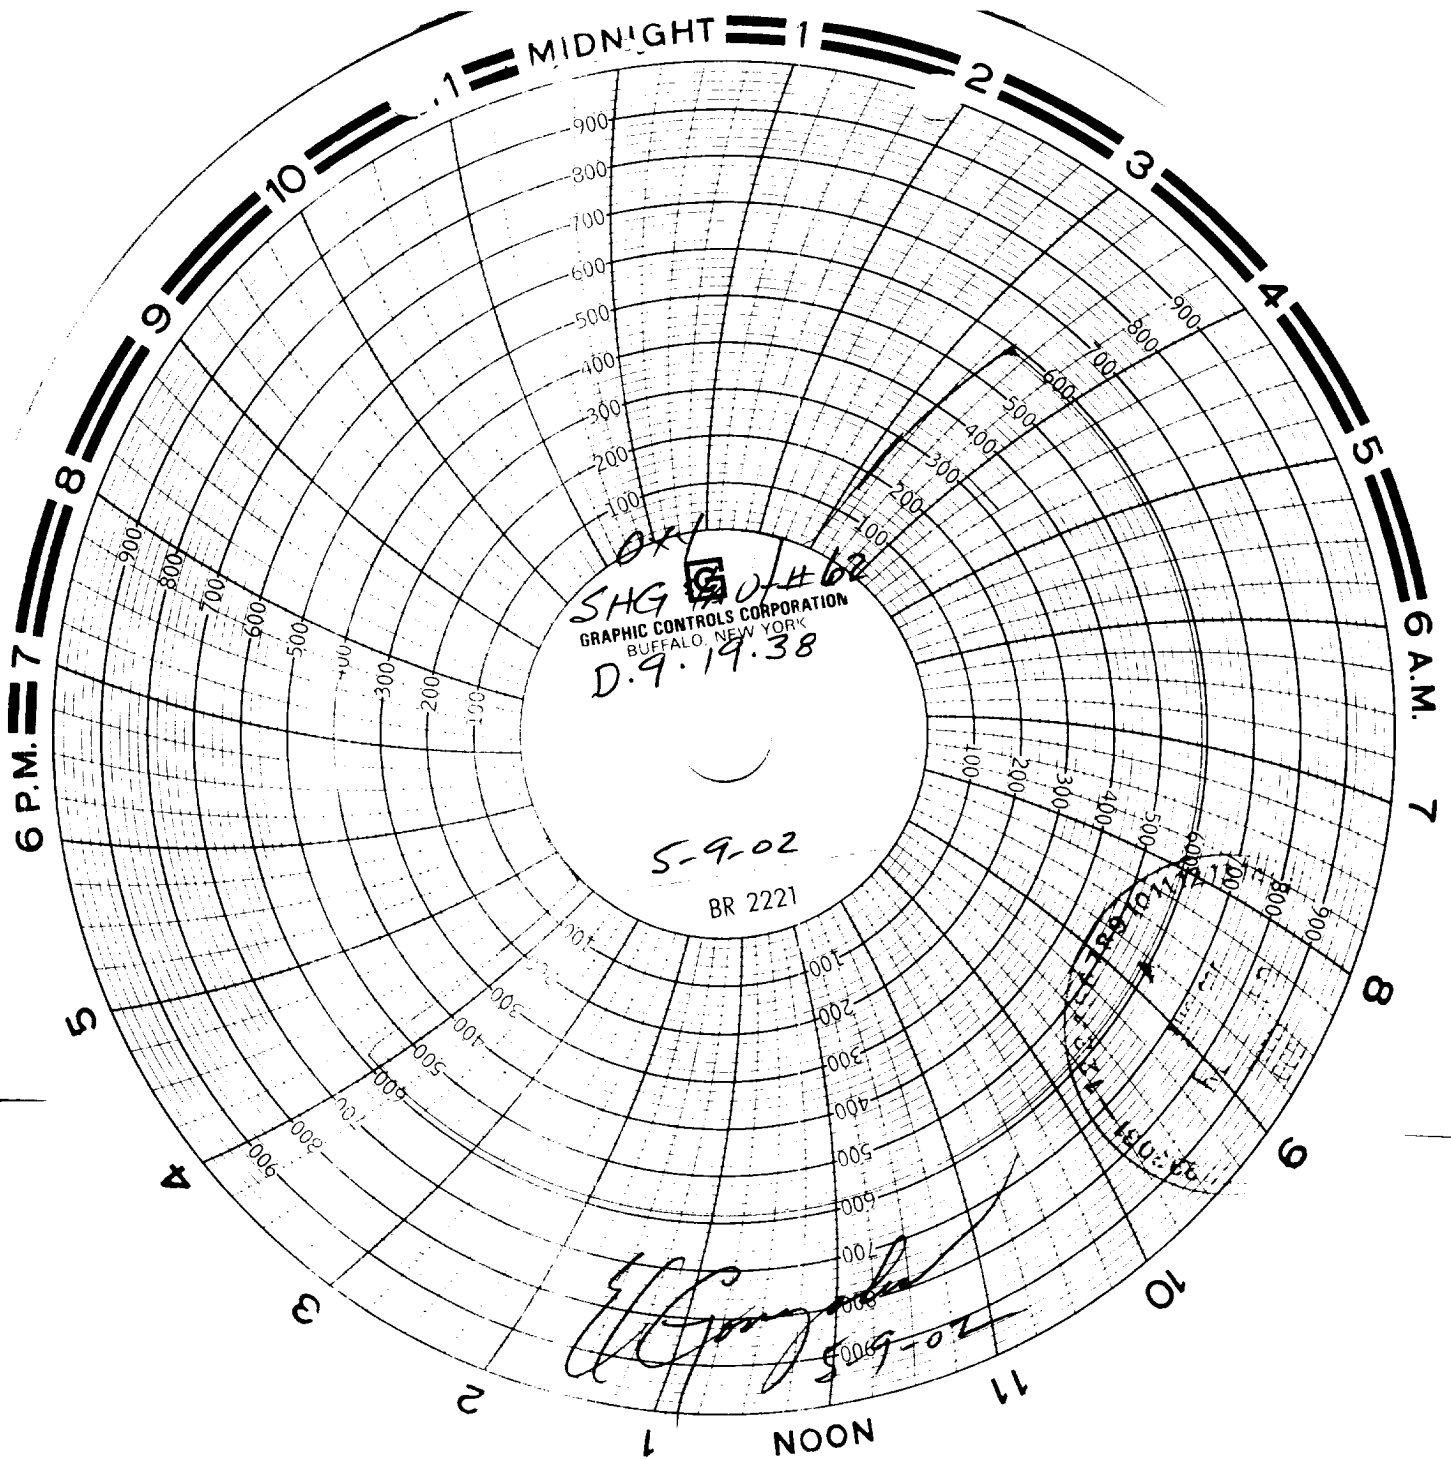

044
SHG SHOT #62
L.A. 19.38

START PSI 590⁺
FIN 585⁺
Time 31 min

Calibrate 4.9.02
Spring 1000⁺
Clock 60 min

~~SE~~ → Test for
T/A stat
IN comp

T69 PSI N/A
C69 " ~~6~~
Surt N/A Cur L to Surface

E. Gonzalez
K. 9.02