
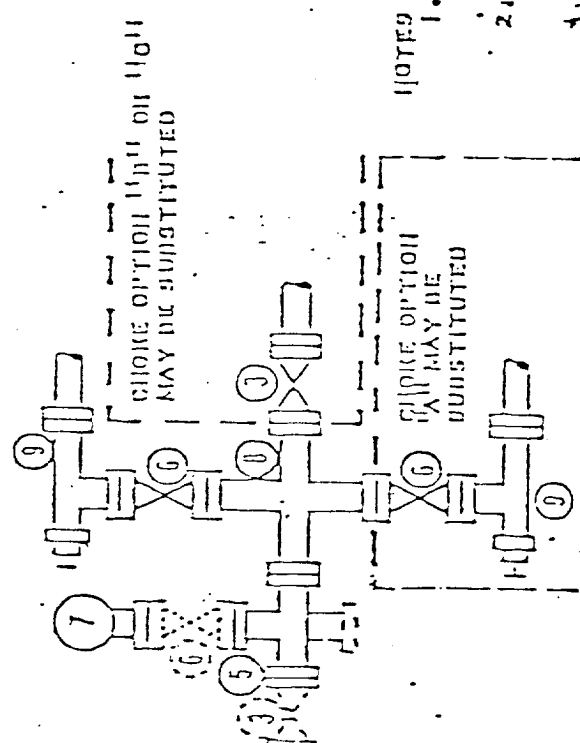


OPTIONAL EQUIPMENT


(8)

FILL-UP CONNECTION

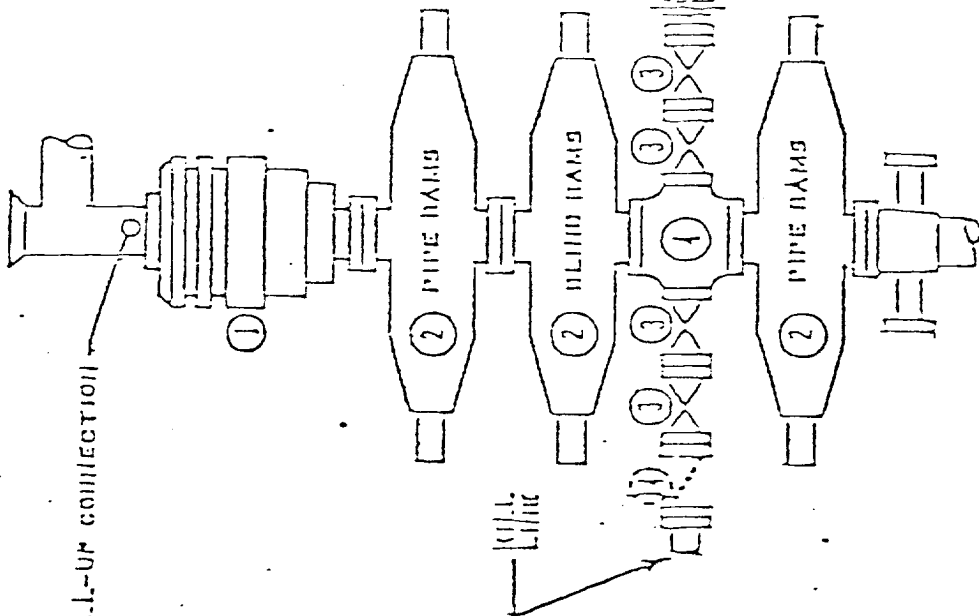

NOTES

- 1. 5000 PSI WP OR BETTER CLAMP HUNS MAY BE SUBSTITUTED FOR FLANGES
- 2. ONE ADJUSTABLE CHOICE MAY BE REPLACED WITH A POSITIVE CHOICE
- 3. VALVES MAY BE EITHER HAND OR POW OPERATED BUT, IF POWER OPERATED, THE VALVES FLANGED TO THE POW MUST BE CAPABLE OF BEING OPENED AND CLOSED MANUALLY OR CLOSE ON POWER FAILURE AND BE CAPABLE OF BEING OPENED MANUALLY

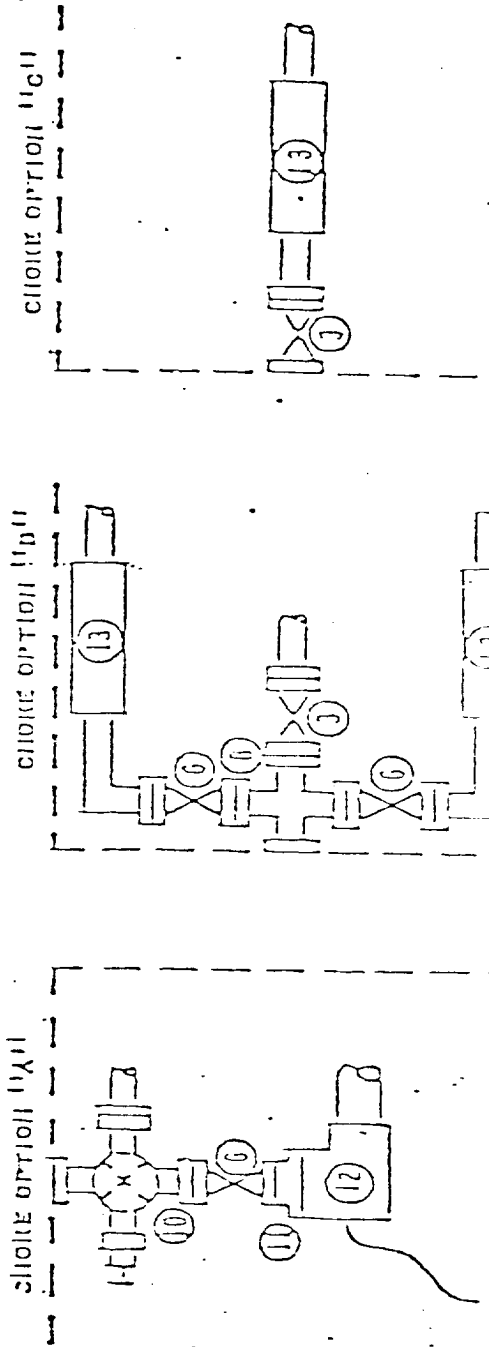

- 1 5000 PSI WP OR BETTER CLAMP HUNS
- 2 5000 PSI WP OR BETTER CLAMP HUNS
- 3 3" SEN, 1500 VALVE
- 4 5000 PSI WP OR BETTER CLAMP HUNS
- 5 3" SEN, 1500 X 2" SEN, 1500 STEEL TEE
- 6 2" SEN, 1500 VALVE
- 7 2" MAN PRESSURE GAUGE
- 8 3" SEN, 1500 X 2" SEN, 1500 STEEL CROSS
- 9 2" SEN, 1500 ADJ, CHOICE
- 10 2" SEN, 1500 ADJ, CHOICE OR 2" SEN, 1500 HUNG VALVE ON SIDE OUTLET OF 2" SEN, 1500 STEEL TEE
- 11 ADAPTER, 2" SEN, 1500 X 10,000 L FLANGE MATHING 1" INLET
- 12 10,000 LB WP REMOTE CHOICE
- 13 HYDRAULIC CHOICE, 2000 LB WP OR BETTER
- 14 3" SEN, 1500 CHECK VALVE

5000 PSI WORKING PRESSURE
BLOWOUT PREVENTER 1100K-L
(SERIES 1500 FLANGES OR BETTER)

RECEIVED
JAN 27 1984
O. C. B.
HOMES OFFICE