


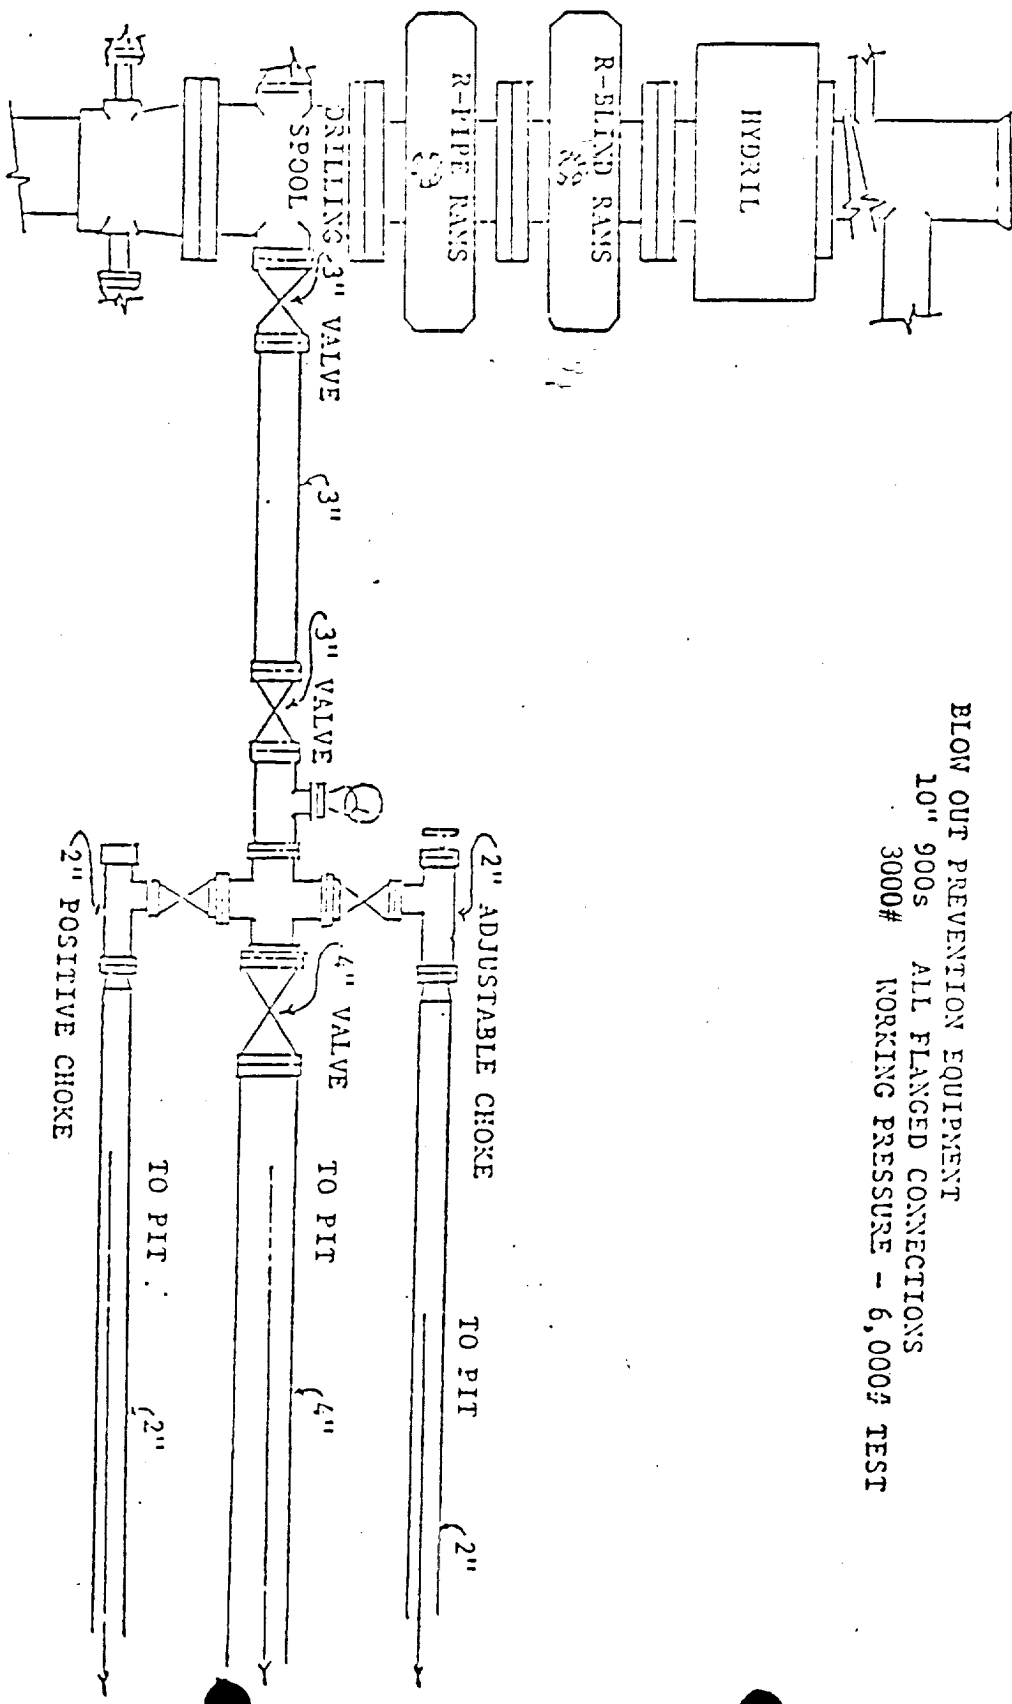

BLOW OUT PREVENTION EQUIPMENT
 10" 900S ALL FLANGED CONNECTIONS
 3000# WORKING PRESSURE - 6,000# TEST

RECEIVED

JUL 10 1991

6-23

HOBBS OFFICE