


MATERIALS					
ITEM	DESCRIPTION	REQ'D	ITEM	DESCRIPTION	REQ'D
1	POLE, 110'	1	17	NEUTRAL CONDUCTOR	-
2	CROSSARM, 3/2"x4 1/2"x8"	1	18	ARMOR ROD	1
3	BRACE, WOOD	2	19	POLE GROUND WIRE, #6 AL.	5*
4	STUD RAIL	1			
5	RIDGE PIN, 1 1/2"	1			
6	SPOOL INSULATOR	1			
7	STEEL PIN, 5/8"x5"	2			
8	LAK SCREW, 1/2"x4"	1			
9	CARRAGE BOLT, 3/8"x4 1/2"	2			
10	MACHINE BOLT, 5/8"x10"	2			
11	MACHINE BOLT, 5/8"x14"	1			
12	WASHER, 2 1/2" SQ.	5			
13	PHASE CONDUCTOR	-			
14	ARMOR ROD	3			
15	TIE WIRE, #6 AL.	1#			
16	PIN INSULATOR, 9 KV	3			

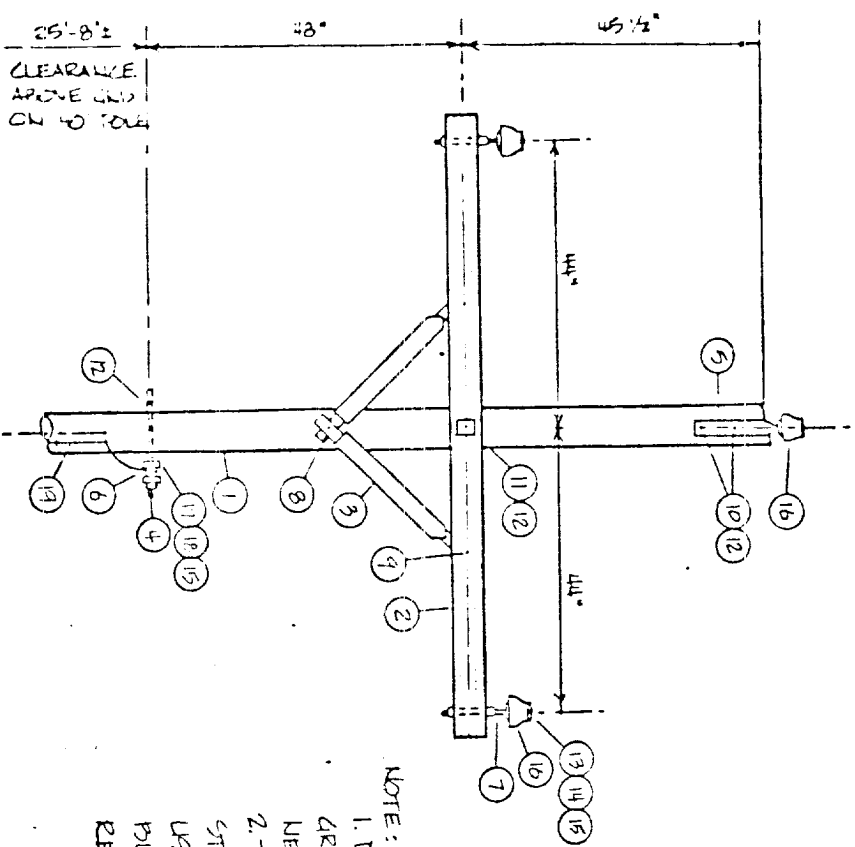

NOTE:
 1. DO NOT INSTALL
 GROUND WIRE FIRST
 NEUTRAL CONDUCTOR
 2. THIS CONSTRUCTION
 STANDARD TO BE
 USED ON ALL LINES
 BUILT ON NATIONAL
 RESOURCE LANDS

DATE: 7-15-71	TITLE: PRIMARY IN LINE POLE
DRAWN BY: J. Morrill	12,000 VOLT AXR
DESIGN BY:	
CHECKED BY: SK	CONOCO
APPROVED BY: SK	PRODUCTION DEPT.
SCALE: 1/2" = 1'	JOB:
	ELEL. SPELLO
	ES-26
	HOBBS DIVISION
	DRAWING NO.: