


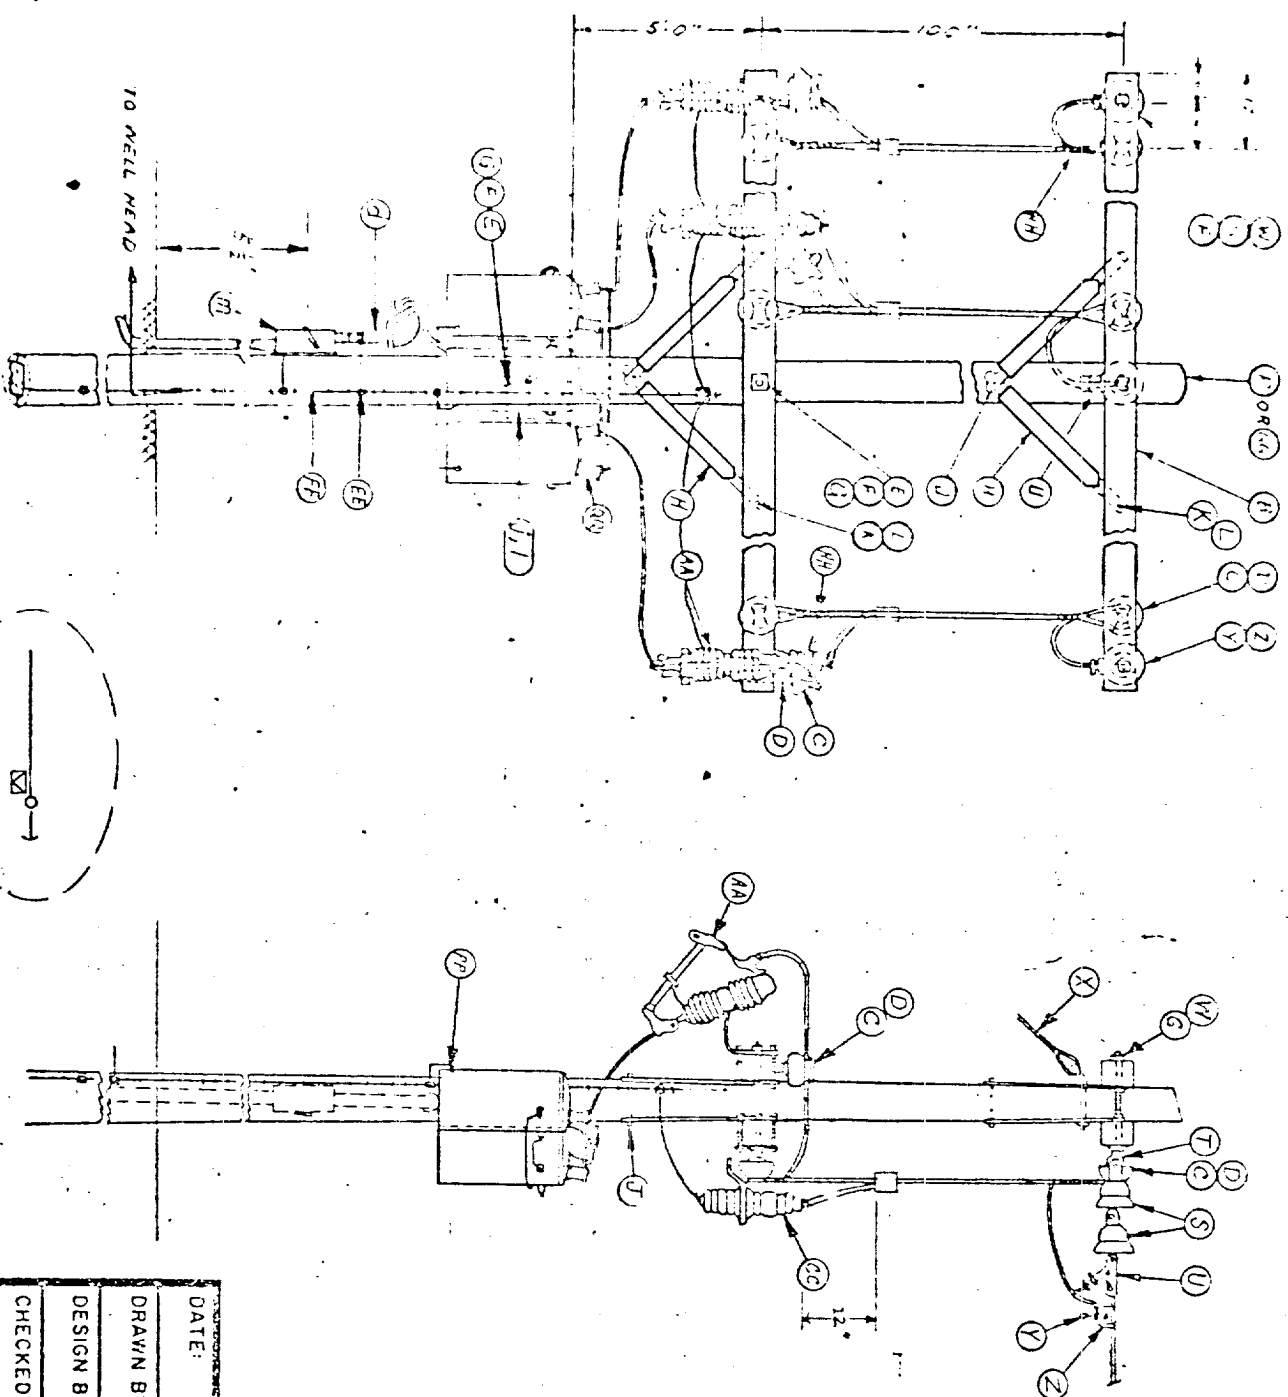

ITEM	QTY	REF
A	4	
B	5	
C	2	
D	3	
E	24	
F	12	
G	8	
H	4	
J	8	
K	8	
L	8	
PCSG	1	ES-1A, NOTE 5
S	6	
T	3	
U	3	
W	5	
X	1	
Y	3	
Z	3	
AA	3	
CC	3	
EE	8	
FE	1	
HH	6	
II	1	
J.I	1	ES-1A, NOTE 2
MM	1	
PP	3	
QQ	6	

NOTE:
 1. CENTER PHASE ON PANK WILL HAVE EPOXY INSULATOR, KEARNEY # 323015-24 INS. (REF. REFER TO DRAWG. ES-28)
 2. ALL WIRE FROM POINT 'U' WILL BE INSULATED TYPE WIRE ON TRANSFORMER PANK.

DATE:	12-13-71	TITLE:	SINGLE ACIE SUB TA.
DRAWN BY:	AKD	TITLE:	1PH TRANS. SUBST. MOUNT
DESIGN BY:	AKD	PRIN. DESK. END.	16500/480V ACGR
CHECKED BY:		PRODUCTION DEPT.	CONOCO
APPROVED BY:		JOB:	MOBBS DIVISION
SCALE:	NONE	DRAWING NO.:	ES-9
			ELEC SPECS