


MATERIALS				
ITEM	DESCRIPTION	REQ'D.	ITEM	DESCRIPTION
1	POLE, 40'	1	17	NEUTRAL CONDUCTOR
2	CROSSARM, 3/4" x 4 1/2" x 8'	1	18	ARMOR ROD
3	BRACE, WOOD	2	19	POLE GROUND WIRE, #6 CU.
4	STUD RAIL	1		
5	RIDGE PIN, 1 1/2"	1		
6	STEEL INSULATOR	2		
7	STEEL PIN, 5/8" x 5"	2		
8	LVX SCREW, 1/2" x 4"	1		
9	CARRIAGE BOLT, 3/8" x 4 1/2"	2		
10	MACHINE BOLT, 9/8" x 10"	2		
11	MACHINE BOLT, 5/8" x 14"	1		
12	WASHER, 2 1/2" SQ.	5		
13	PHASE CONDUCTOR	-		
14	ARMOR ROD	3		
15	THE WIRE, #6 AL.	1#		
16	PIN INSULATOR, 9 KV	3		

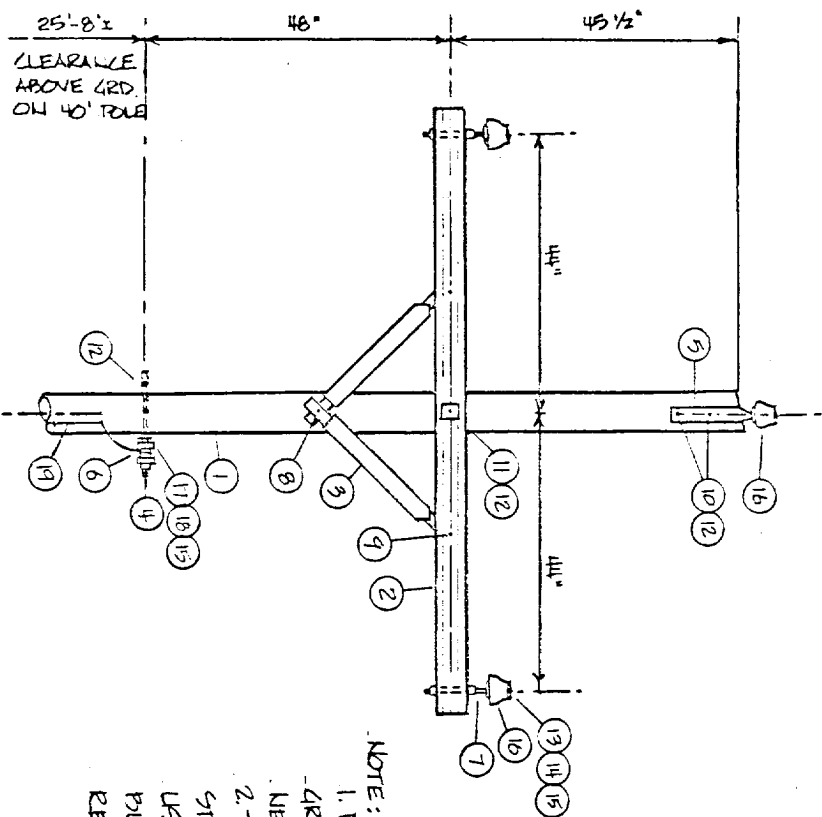

NOTE:
 1. DO NOT INSTALL
 GROUND WIRE FIRST
 NEUTRAL CONDUCTOR
 2. THIS CONSTRUCTION
 STANDARD TO BE
 USED ON ALL LINES
 BUILT ON NATIONAL
 RESOURCE LANDS

DATE: 7-15-71	TITLE: PRIMARY 11 KV LINE POLE
DRAWN BY: J. FORTWILL	12,000 VOLT AXLR.
DESIGN BY:	CONOCO
CHECKED BY: SK	PRODUCTION DEPT.
APPROVED BY: SK	HOBBS DIVISION
SCALE: 1/2" = 1'	J.B.L. SPELLO
	DRAWING NO: ES-26