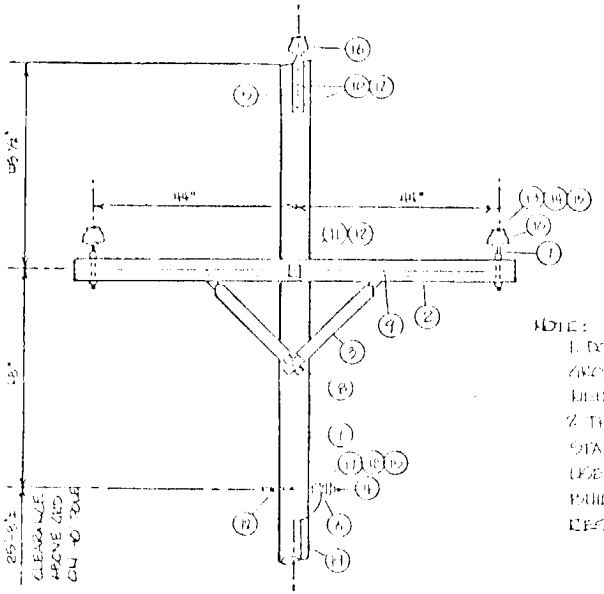

NOTE:
1. DO NOT INSTALL GROUND WIRE, PAST NEUTRAL CONDUCTOR.
2. THIS CONSTRUCTION STANDARD TO BE USED ON ALL LINES BUILT ON NATIONAL RESOURCE LANDS

MATERIALS

ITEM	DESCRIPTION	REQ'D	ITEM	DESCRIPTION	REQ'D
1	POLE, 40'	1	17	NEUTRAL CONDUCTOR	—
2	CROSSARM, 2½"x4½"x8'	1	18	ARMOR ROD	1
3	BRACE, WOOD	2	19	POLE GROUND WIRE, #6 CU.	5'
4	GROUND ROD	1			
5	PINTLE PIN, 1½"	1			
6	STYLE INSULATOR	1			
7	STEEL PIN, ⅝"x9"	2			
8	LAG SCREW, ½"x4"	1			
9	CARRIAGE BOLT, ⅝"x4½"	2			
10	MACHINE BOLT, ⅝"x10"	2			
11	MACHINE BOLT, ⅝"x4½"	1			
12	WASHER, 2½" SQ.	5			
13	PHASE CONDUCTOR	—			
14	ARMOR ROD	3'			
15	TIE WIRE, #2 AL.	1'			
16	PIN INSULATOR, 15 KV	3			

DATE: 7-15-77	TITLE: PRIMARY IN LINE POLE ... 12,500 VOLT MGR.
DRAWN BY: L. Truscott	
DESIGN BY:	CONOCO
CHECKED BY: SK	PRODUCTION DEPT. HOBBS DIVISION
APPROVED BY: SK	JOB: 12.EL. SPECS. / DRAWING NO.: ES-26
SCALE: 1"=1'-0"	