


MATERIALS					
ITEM	DESCRIPTION	REQD	ITEM	DESCRIPTION	REQD
1	POLE, 10'	1	17	NEUTRAL CONDUCTOR	1
2	GRASSHOPPER, 3/4" x 1/2" x 8"	1	18	ARMOR ROD	1
3	BRACE, WOOD	2	19	POLE GROUND WIRE, 6/4"	5
4	STEEL RAIL	2			
5	STEEL PIN, 1/2"	1			
6	STEEL INSULATOR	1			
7	STEEL PIN, 7/8" x 8"	2			
8	1/2" x 8" x 1/2" x 1/2"	2			
9	1/2" x 8" x 1/2" x 1/2"	2			
10	MACHINE BOLT, 3/4" x 10"	2			
11	MACHINE BOLT, 1/2" x 10"	1			
12	WASHER, 2 1/2" x 3/4"	1			
13	PHASE CONDUCTOR	3			
14	ARMOR ROD	3			
15	TIE WIRE, 1/2" AL	1			
16	PIN INSULATOR, 9 KV	3			

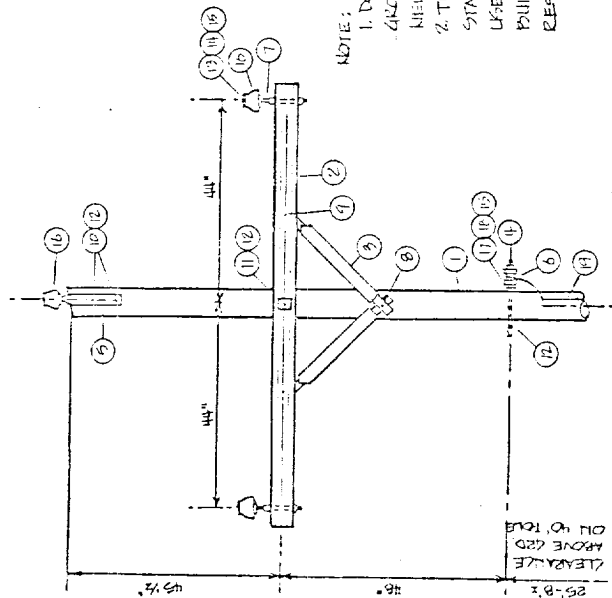

NOTE:
 1. DO NOT INSTALL
 GROUND WIRE, PAST
 NEUTRAL CONDUCTOR
 2. THIS CONSTRUCTION
 STANDARD TO THE
 USED ON ALL LINES
 BUILT ON NATIONAL
 RESOURCE LANDS

DATE: 7-15-77	TITLE: PRIMARY III LINE POLE 12,500 VOLT ASR
DRAWN BY: J. T. M. III	CONOCO
DESIGN BY:	
CHECKED BY: SK	
APPROVED BY: SK	PRODUCTION DEPT. HOBBS DESIGN JOB: DRAWING NO.
SCALE: 1/8" = 1'-0"	13 EL. SPEC'S ES-26