


MATERIALS					
ITEM	DESCRIPTION	REQ'D	ITEM	DESCRIPTION	REQ'D
1	POLE, 110'	1	17	NEUTRAL CONDUCTOR	1
2	CROSSARM, 2 1/2" x 4 1/2" x 8'	1	18	ARMOR ROD	1
3	PRACE WOOD	2	19	POLE GROUND WIRE, #5 AL.	5*
4	STUD RACK				
5	RIDGE PIN, 1/2"	1			
6	STEEL INSULATOR	2			
7	STEEL PIN, 1/8" x 5"	1			
8	LAM, 6X8ELL 1/2" x 4"	2			
9	CARRIAGE BOLT, 3/8" x 4 1/2"	2			
10	MACHINE BOLT, 1/2" x 10"	2			
11	MACHINE BOLT, 1/2" x 10"	1			
12	WASHER, 2 1/2" SQ.	3			
13	PHASE CONDUCTOR	3			
14	ARMOR ROD	3			
15	TIE WIRE, #6 AL.	1#			
16	PIN INSULATOR, 4KV	3			

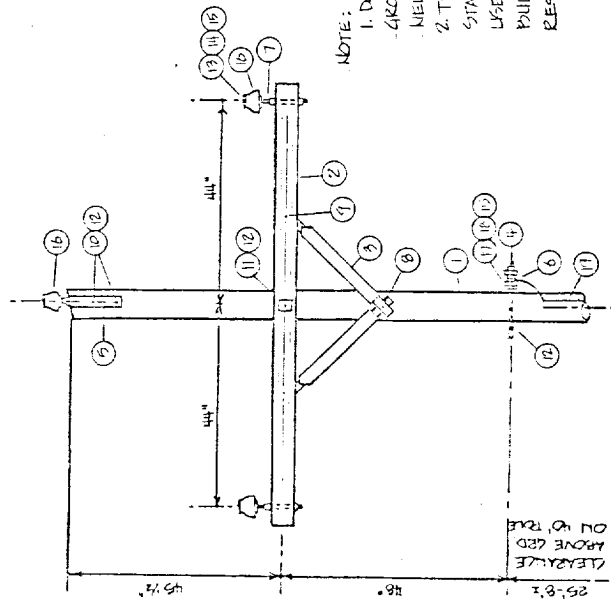

NOTE:
 1. DO NOT INSTALL
 GROUND WIRE FIRST
 NEUTRAL CONDUCTOR
 2. THIS CONSTRUCTION
 STANDARD TO BE
 USED ON ALL LINES
 BUILT ON NATIONAL
 RESOURCE LANDS

DATE: 7-15-77	TITLE: PRIMARY 110 LINE POLE
DRAWN BY: J. TRIVETT	12,500 VOLT A.S.P.
DESIGN BY:	CONOCO
CHECKED BY: SK	PRODUCTION DEPT.
APPROVED BY: SK	JOB:
SCALE: 1/4" = 1'-0"	12. EL. SPEC'S
	DRAWING NO. E-2-26