


MATERIALS					
ITEM	DESCRIPTION	REQ'D	ITEM	DESCRIPTION	REQ'D
1	POLE, 40'	1	11	NEUTRAL CONDUCTOR	1
2	CROSSARM, 3/4" x 4 1/2" x 6'	1	12	ARMOR ROD	1
3	PLATE, WOOD	2	13	POLE GROUND WIRE, #6 AL	50
4	STUD, WOOD	1			
5	WIDE, 1/4" x 1/2"	1			
6	STEEL INSULATOR	1			
7	STEEL PIN, 1/8" x 5"	2			
8	LV, 1/2" x 1/2" x 1/2"	1			
9	CARRAGE BOLT, 3/8" x 4 1/2"	2			
10	MACHINE BOLT, 3/8" x 10"	2			
11	WASHER, 3/8" x 1/4"	5			
12	PLATE CONDUCTOR	1			
13	ARMOR ROD	1			
14	THE WIRE, #6 AL	1			
15	PM INSULATOR, 9 KV	3			

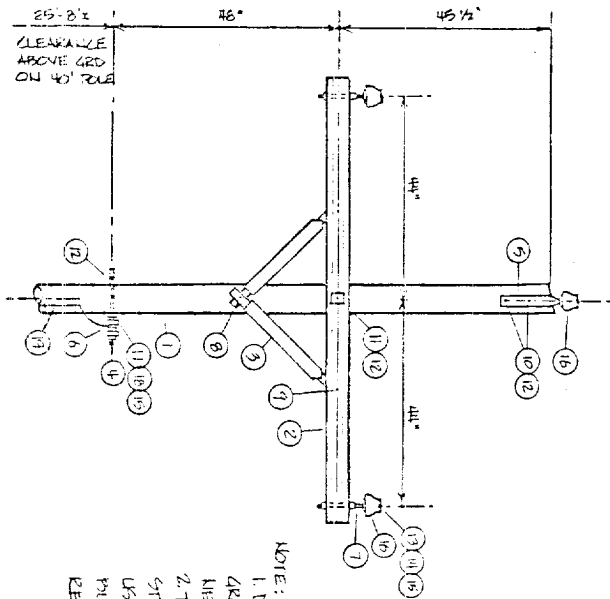

NOTE:
 1. DO NOT INSTALL
 GROUND WIRE FIRST
 2. THIS CONSTRUCTION
 STANDARD TO PSE
 USED ON ALL LINES
 BUILT ON NATIONAL
 RESOURCE LANDS

DATE: 7-15-71	TITLE: PRIMARY 44 LINE POLE
DRAWN BY: J. H. H. H.	12,500 VOLT ASPR.
DESIGN BY:	
CHECKED BY: SV	PRODUCTION DEPT.
APPROVED BY: SV	HOBB'S DIVISION
SCALE: 1/4" = 1'	DRAWING NO.: ES-26