


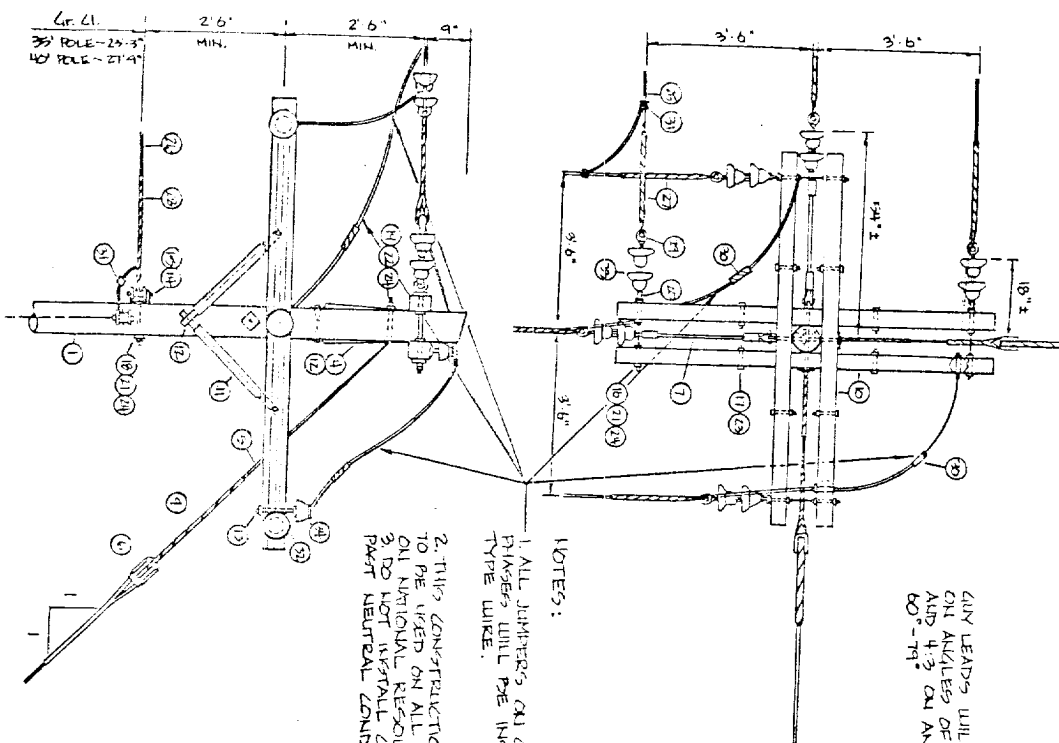

CUT LEADS WILL BE 1:1 ON ANGLES OF 80°-90° AND 4:3 ON ANGLES OF 60°-74°

NOTES:

1. ALL JUMPERS AND CONDUCTOR SPICES WILL BE INSULATED TYPE WIRE.
2. THIS CONSTRUCTION STANDARD TO BE USED ON ALL LINES BUILT ON NATIONAL RESOURCE LANDS. DO NOT INSTALL GROUND WIRE PAST NEUTRAL CONDUCTOR.

MATERIALS		
ITEM	DESCRIPTION	QTY
1	POLE	1
2	ANCHOR, 8"	2
3	ANCHOR, 20"	2
4	CUT ATTACHMENT PLATE	2
5	CUT ANGLE, 1/2" x 1/4"	2
6	CUT INSULATOR, 1000	2
7	IRON WIRE, 1/2" DIA., LENGTH - 32000-48	2
8	CLAMP, 3/8" DIA.	2
9	CUT GRIP, 3/8"	2
10	60000 ALUM, 8"	2
11	PEALE, 3/8" DIA.	2
12	1/4" SCREW, 1/2"	2
13	STEEL PIN, 3/8" x 5"	2
14	BAK, 1-POLE	2
15	WOOD INSULATOR, 34	2
16	POLE, D.A., 5/8" x 10"	2
17	POLE, EACH, 3/8" x 1/2"	2
18	POLE, EACH, 3/8" x 1/2"	2
19	POLE, EACH, 3/8" x 1/2"	2
20	POLE, EACH, 3/8" x 1/2"	2
21	POLE, EACH, 3/8" x 1/2"	2
22	POLE, EACH, 3/8" x 1/2"	2
23	POLE, EACH, 3/8" x 1/2"	2
24	POLE, EACH, 3/8" x 1/2"	2
25	POLE, EACH, 3/8" x 1/2"	2
26	POLE, EACH, 3/8" x 1/2"	2
27	POLE, EACH, 3/8" x 1/2"	2
28	POLE, EACH, 3/8" x 1/2"	2
29	POLE, EACH, 3/8" x 1/2"	2
30	POLE, EACH, 3/8" x 1/2"	2
31	POLE, EACH, 3/8" x 1/2"	2
32	POLE, EACH, 3/8" x 1/2"	2
33	POLE, EACH, 3/8" x 1/2"	2
34	POLE, EACH, 3/8" x 1/2"	2

DATE: 7-10-77	TITLE: PRIMARY ANGLE STRUCTURE
DRAWN BY: TYPHILL	60°-90° 12500 VOLT WGR
DESIGN BY:	
CHECKED BY: SP	PRODUCTION DEPT: CONOCO
APPROVED BY: SP	HOBBS DIVISION
SCALE: 1/8" = 1'	ES-27