


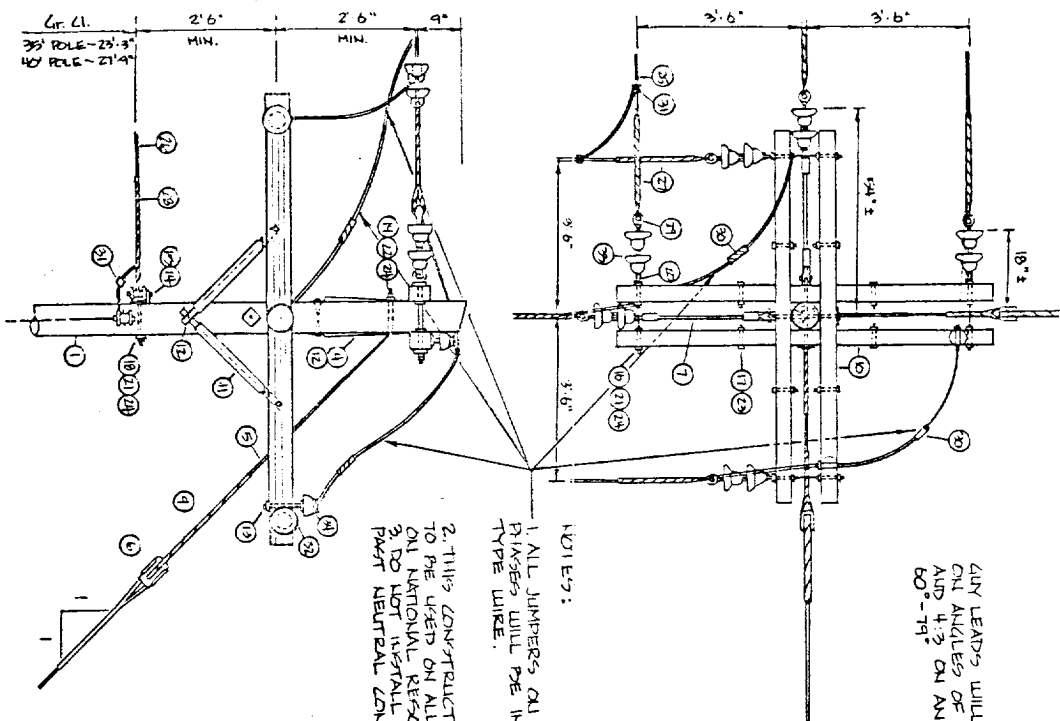

CONDUCTORS WILL BE 11
ON ANGLES OF 80°-90°
AND 4-3 ON ANGLES OF
80°-79°

NOTES:
1. ALL JUMPERS AND CONDUCTOR
SPICES WILL BE INSULATED
TYPE WIRE.

2. THIS CONSTRUCTION STANDARD
TO BE USED ON ALL LINES BUILT
ON NATIONAL REINFORCED LEADINGS.
3. NO HOT INSTALL GROUND WIRE
PART NEUTRAL CONDUCTOR.

ITEM	DESCRIPTION	QUANTITY
1	POLE	1
2	ANCHOR, 5"	2
3	AUT. HOR. ROD 5/8" x 7'	2
4	CUT ATTACHMENT PINS	24
5	CUT CABLE, 3/8" U/L	24
6	CUT INSULATOR, 500	2
7	EXPOS. INSULATOR, KEENEY #3205-24	2
8	CLAMP, 3-POL.	2
9	CUT GIRD, 3/8"	1
10	CUT 25 AER, 5"	1
11	PLATE, 30" x 12"	1
12	1/4" x 8" x 1/2"	1
13	STEEL, PIN 7/8" x 5"	2
14	SPAC, 1-POINT	2
15	SPAC, 1-POINT	2
16	POL. D.A. 5/8" x 12"	2
17	POL. BUSH, 3/8" x 1/2"	2
18	POL. BUSH, 1/2" x 1/2"	2
19	POL. BUSH, 1/2" x 1/2"	2
20	END BUSH, 1/2" x 1/2"	2
21	WASHER, 3/4" x 1/2"	2
22	WASHER, 3/4" x 1/2"	2
23	LOCK WIT, 1/2"	2
24	LOCK WIT, 1/2"	2
25	PHASE CONDUCTOR, NO.	2
26	NEUTRAL CONDUCTOR, NO.	2
27	REF. DE. NO.	2
28	REF. DE. NO.	2
29	REF. DE. NO.	2
30	REF. DE. NO.	2
31	REF. DE. NO.	2
32	REF. DE. NO.	2
33	REF. DE. NO.	2
34	REF. DE. NO.	2

DATE: 7-15-77	TITLE: PRIMARY ANGLE STRUCTURE	
DRAWN BY: TWYTHILL	60°-90° 12500 VOLT ACSR	
DESIGN BY:	CONOCO	
CHECKED BY: SY	PRODUCTION DEPT:	HOBBS DIVISION
APPROVED BY: SY	JOB:	DRAWING NO.: ES-27
SCALE: 1/8" = 1'	ELIC. SPEEDS:	