


MATERIALS			
ITEM	DESCRIPTION	QTY	REMARKS
1	POLE, 40'	1	
2	ARM, 3/4" x 1/2" x 8'	1	
3	BRACE, WOOD	1	
4	STUD BALK	2	
5	BRIDGE PIN, 1/2"	1	
6	STEEL INSULATOR	2	
7	STEEL PIN, 3/8" x 5"	2	
8	WIRE, 3/8" x 1/2"	2	
9	CABLE, 3/8" x 1/2"	2	
10	MACHINE BOLT, 3/8" x 1/2"	2	
11	MACHINE BOLT, 3/8" x 1/2"	2	
12	WASHER, 3/8" x 1/2"	2	
13	WASHER, 3/8" x 1/2"	2	
14	ARMOR ROD	1	
15	THE WIRE, 3/8" x 1/2"	1	
16	PIN INSULATOR, 9 KV	2	

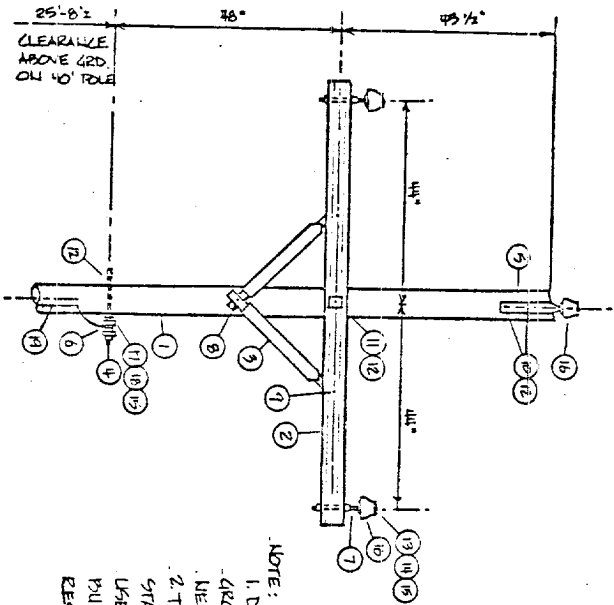

NOTE:
1. DO NOT INSTALL
GROUND WIRE FIRST
NEUTRAL CONDUCTOR
2. THIS CONSTRUCTION
STANDARD TO BE
USED ON ALL LINES
BUILT ON NATIONAL
RESOURCE LANDS

DATE: 1-15-71	TITLE: PRIMARY 11 KLV POLE
DRAWN BY: [signature]	12,500 VOLT XCR
DESIGN BY:	
CHECKED BY: [signature]	CONOCO
APPROVED BY: [signature]	HOOPS DIVISION
SCALE: 1/4" = 1'-0"	12 EL. SPECS.
	ES-26