


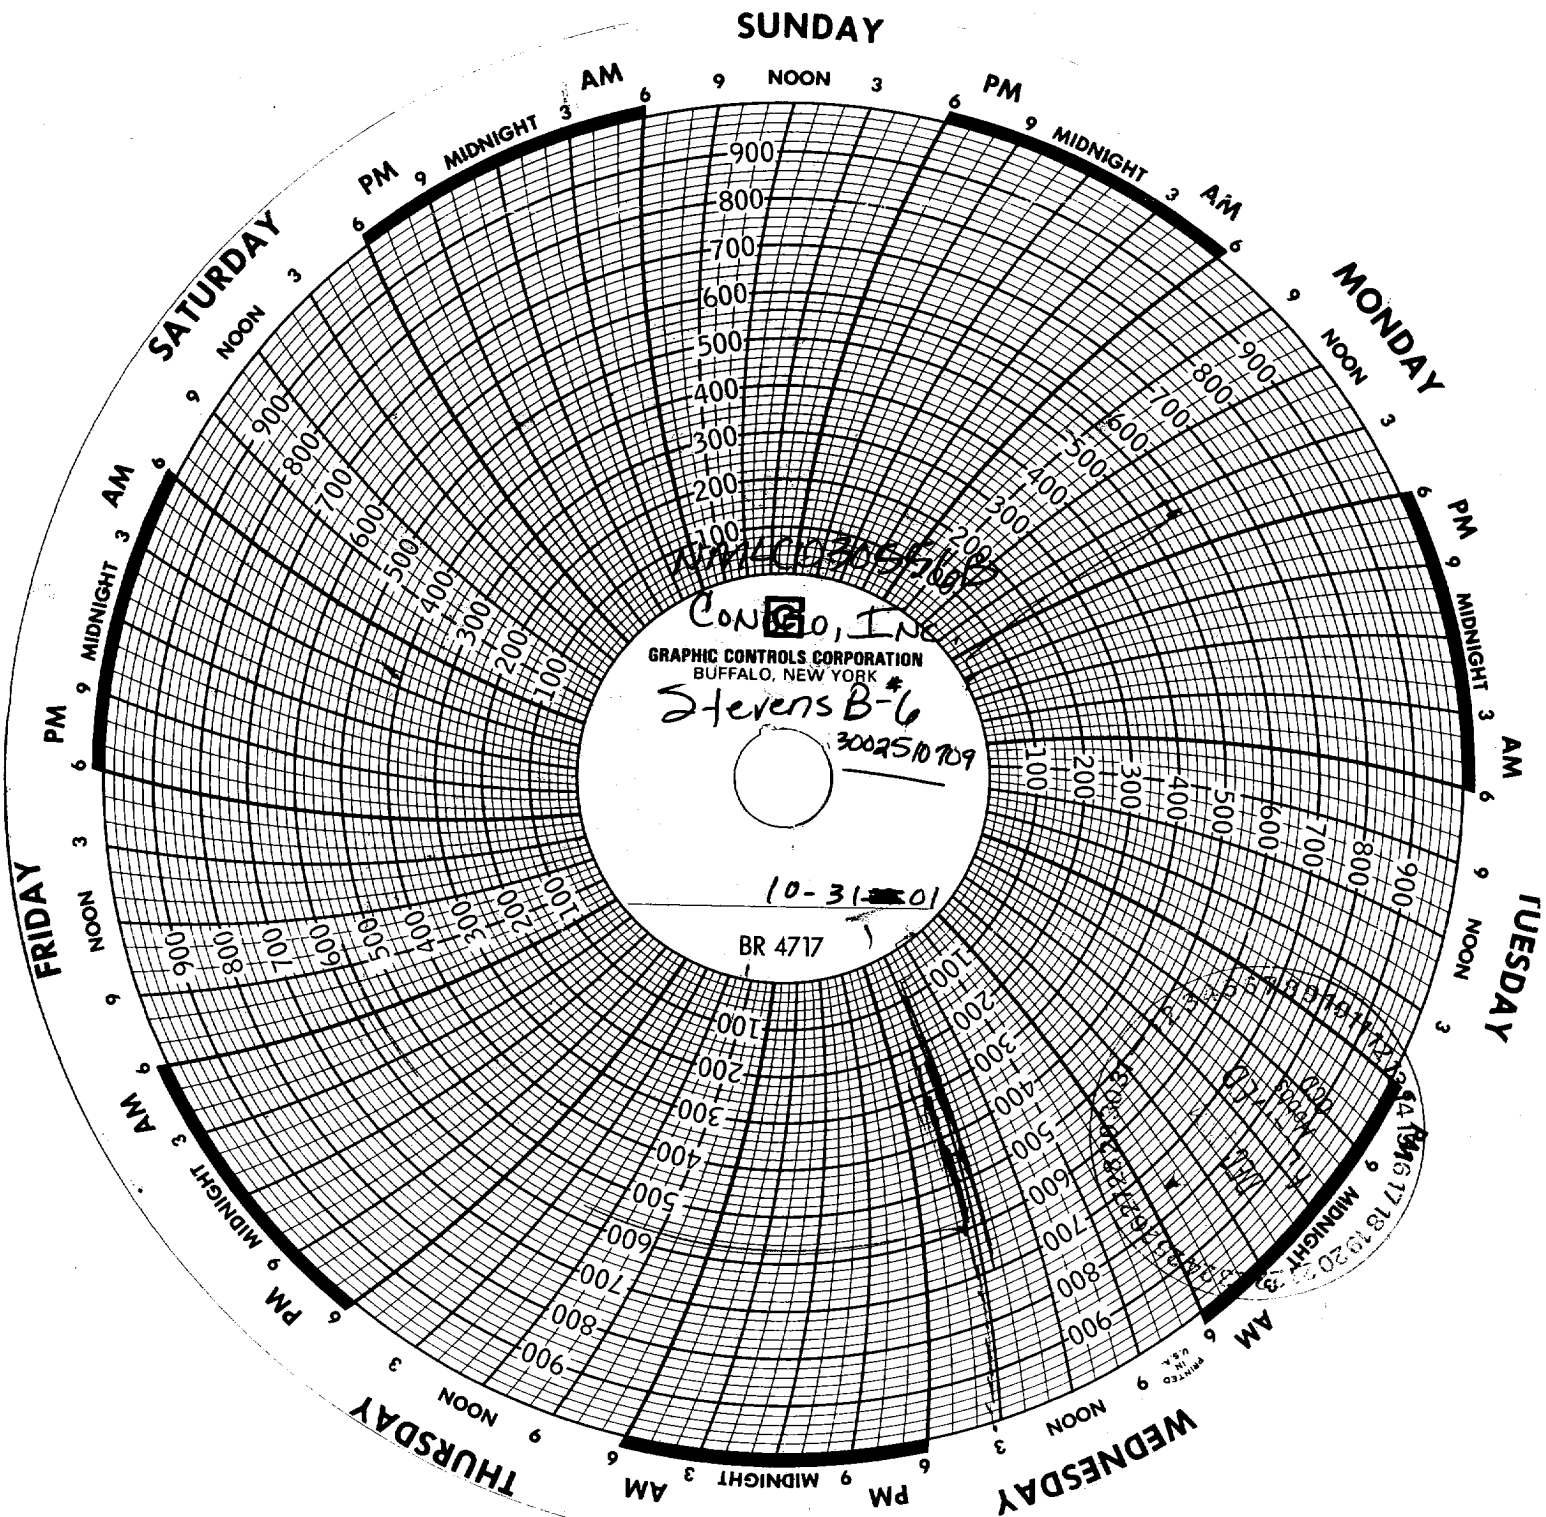

Pool Company - MARK Bmd.
Well tested to 580#
Lost 20# in 30 minutes
Remaining pressure 560#
Good CIT.
* Pen stop inking, but is legible
enough to verify A GOOD Test.

P. Hutchings
BLM

RECEIVED
JAN 17 - 11 51 AM '85