


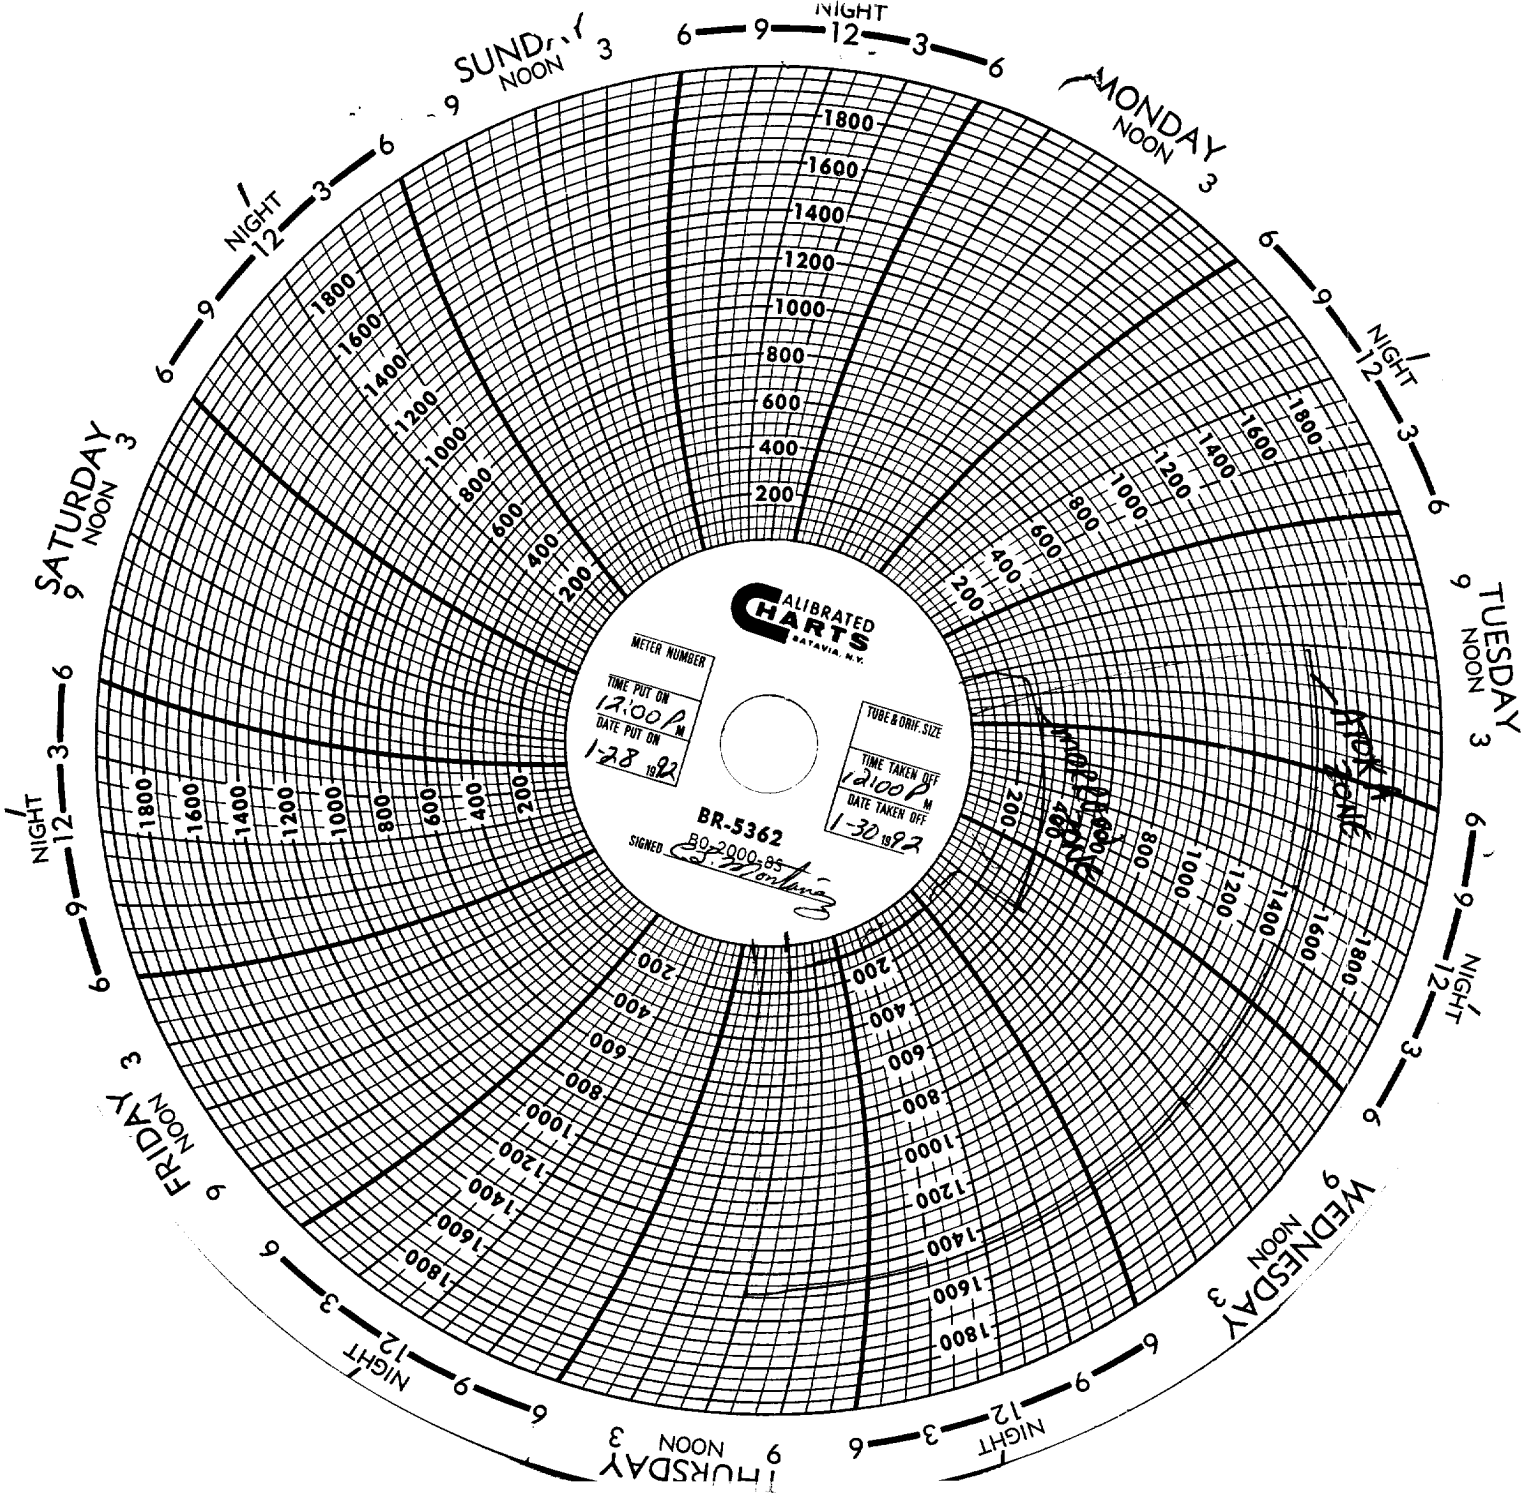

7P 11
C.P. 1470

1-28-92
1-29-92
1-30-92

1-28-92 SHUT IN BOTH ZONES
1-29-92 OPEN MORROW ZONE 24HRS
1-30-92 UNABLE to Flow ATOKA ZONE
TEST Complete.

RECEIVED

FEB 06 1992

HON